


- 8 SEE BATTERY INSTL FOR ADDITIONAL INFORMATION
- 7 REST WIRE IN FRAME RAIL WHEN APPLICABLE.
- 6 CLAMP 83610-01-000, SCREW G39-08-12U
- 5 CLAMP 10497-03-000, SCREW G39-08-12U
- 4 USE TIE-WIRE 8343-04-000 TO SECURE WIRES TO FLOOR SUPPORT FRAME AT LEAST ONCE EVERY 600MM.
- 3 SECURE CORD AWAY FROM ALL MOVING PARTS AND EXHAUST WITH WIRE-TIE 93147-01-000 AS REQUIRED
- 2 SEE WIRING INSTL-FRONT END FOR ADDITIONAL INFORMATION.
- 1 SEE SHEET 5 FOR ADDITIONAL INFORMATION.

NOTES:

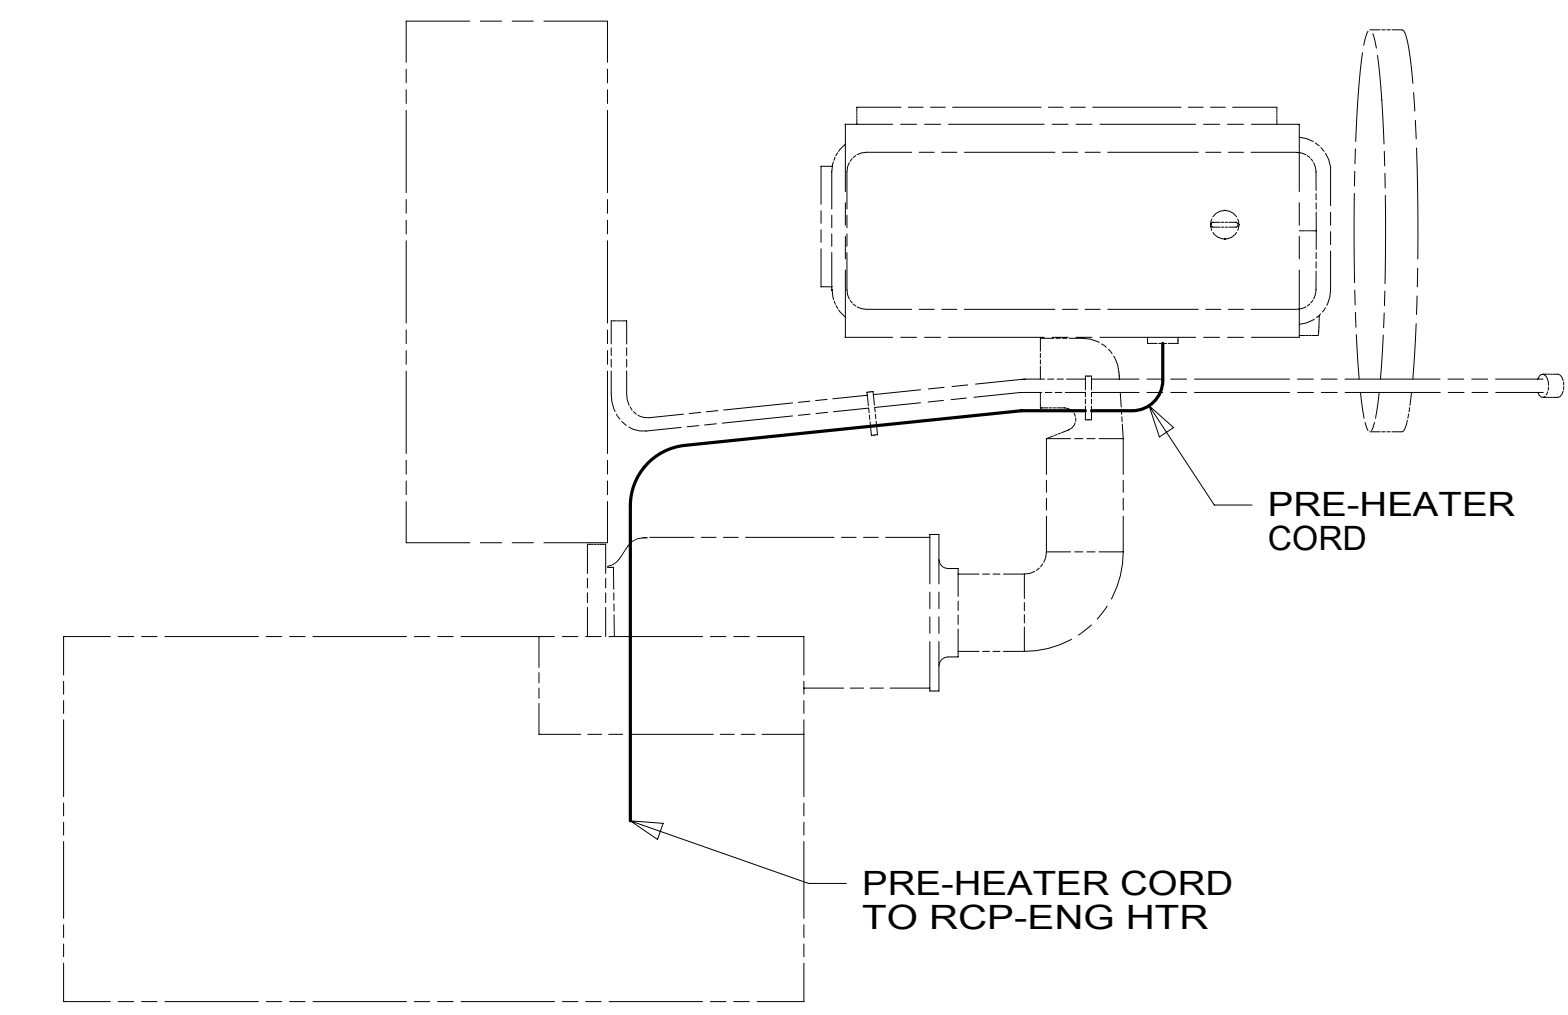

DETAIL AA 3

- 282 SOLAR PANEL - 100 WATT
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

**WINNEBAGO**  
COPYRIGHT 2016 WINNEBAGO INDUSTRIES, INC.

DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS
DFFR:	
UNSPECIFIED TOLERANCES:	MATERIAL:
WHOLE DIM (X) : 3	
ONE-PLACE (X.X) : 1.5	
TWO-PLACE (X.XX) : 0.50	
ANGLE : 1°	
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	WEIGHT: (LBS) FIRST USED: <b>16 P40R</b>
<b>DESCRIPTION: WIRING INSTL-CHASSIS</b>	
SHEET: <b>1 OF 5</b>	ITEM/PART NO: <b>000211659 / 30207501000</b>
REF:	REV:

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

8 7 6 5 4 3 2 1

D  
C  
B  
A

RELAY  
063912-02-000

PANEL-CLOSEOUT  
175347-08-CHT  
SCREW  
G11-08-12U (4)

CIRCUIT BREAKERS  
DETAIL CA

CB

PANEL-CLOSEOUT,  
ELECTRICAL  
175347-02-CHT (2)  
SCREW  
G39-10-12U (4)

LABEL  
98379-04-000

LABEL  
98379-09-000

CHASSIS  
BATTERIES  
(REF)

FUSE BLOCK  
(CHASSIS SUPPLIED)  
(REF)

FREIGHTLINER  
STARTER CABLE

VIEW BA

FOR ELECTRICAL  
TORQUE  
SPECIFICATIONS  
SEE DWG NO.  
128783-01-000

FOR  
ELECTRICAL  
CALLOUTS  
SEE DWG NO.  
121339-01-000

265 CODES/STANDARDS-CSA/CMVSS


1B1 CODES/STANDARDS USA

1B1 265

DESCRIPTION:  
**WIRING INSTL-CHASSIS**

SHEET: 2 OF 5 ITEM/PART NO: 000211659 / 30207501000 REV

8 7 6 5 4 3 2 1 19-Jan-2017

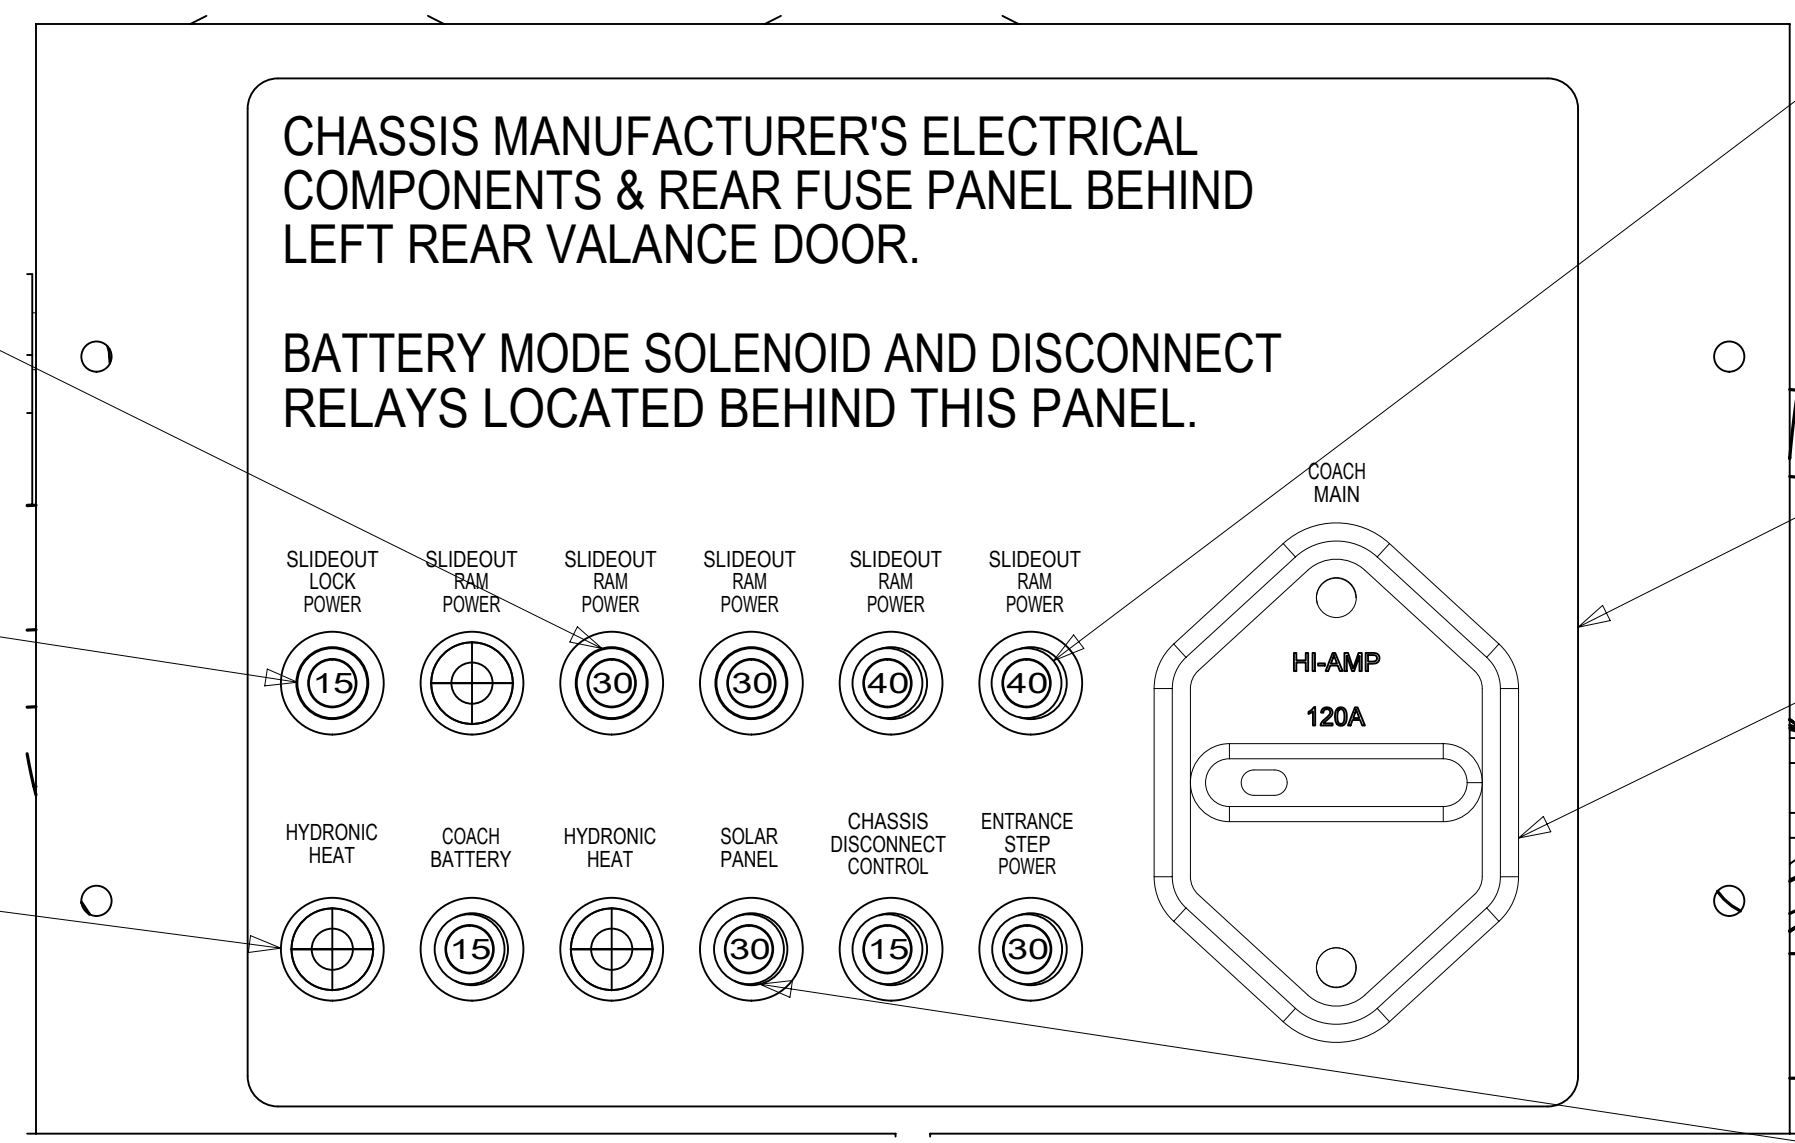

CHASSIS MANUFACTURER'S ELECTRICAL COMPONENTS & REAR FUSE PANEL BEHIND LEFT REAR VALANCE DOOR.

BATTERY MODE SOLENOID AND DISCONNECT RELAYS LOCATED BEHIND THIS PANEL.

DETAIL CA


CIRCUIT BREAKER-40 AMP  
93655-03-000 (2)  
SCREW  
G19-10-08U (2) 5

LABEL-CIRCUIT BREAKER  
093236-82-000


CIRCUIT BREAKER-120 AMP  
188890-01-000  
SCREW  
G39-10-12U (2)

CIRCUIT BREAKER-30 AMP  
093655-02-000  
SCREW  
G52-06-05U  
SPACER-CIRCUIT BREAKER  
141789-01-000


282

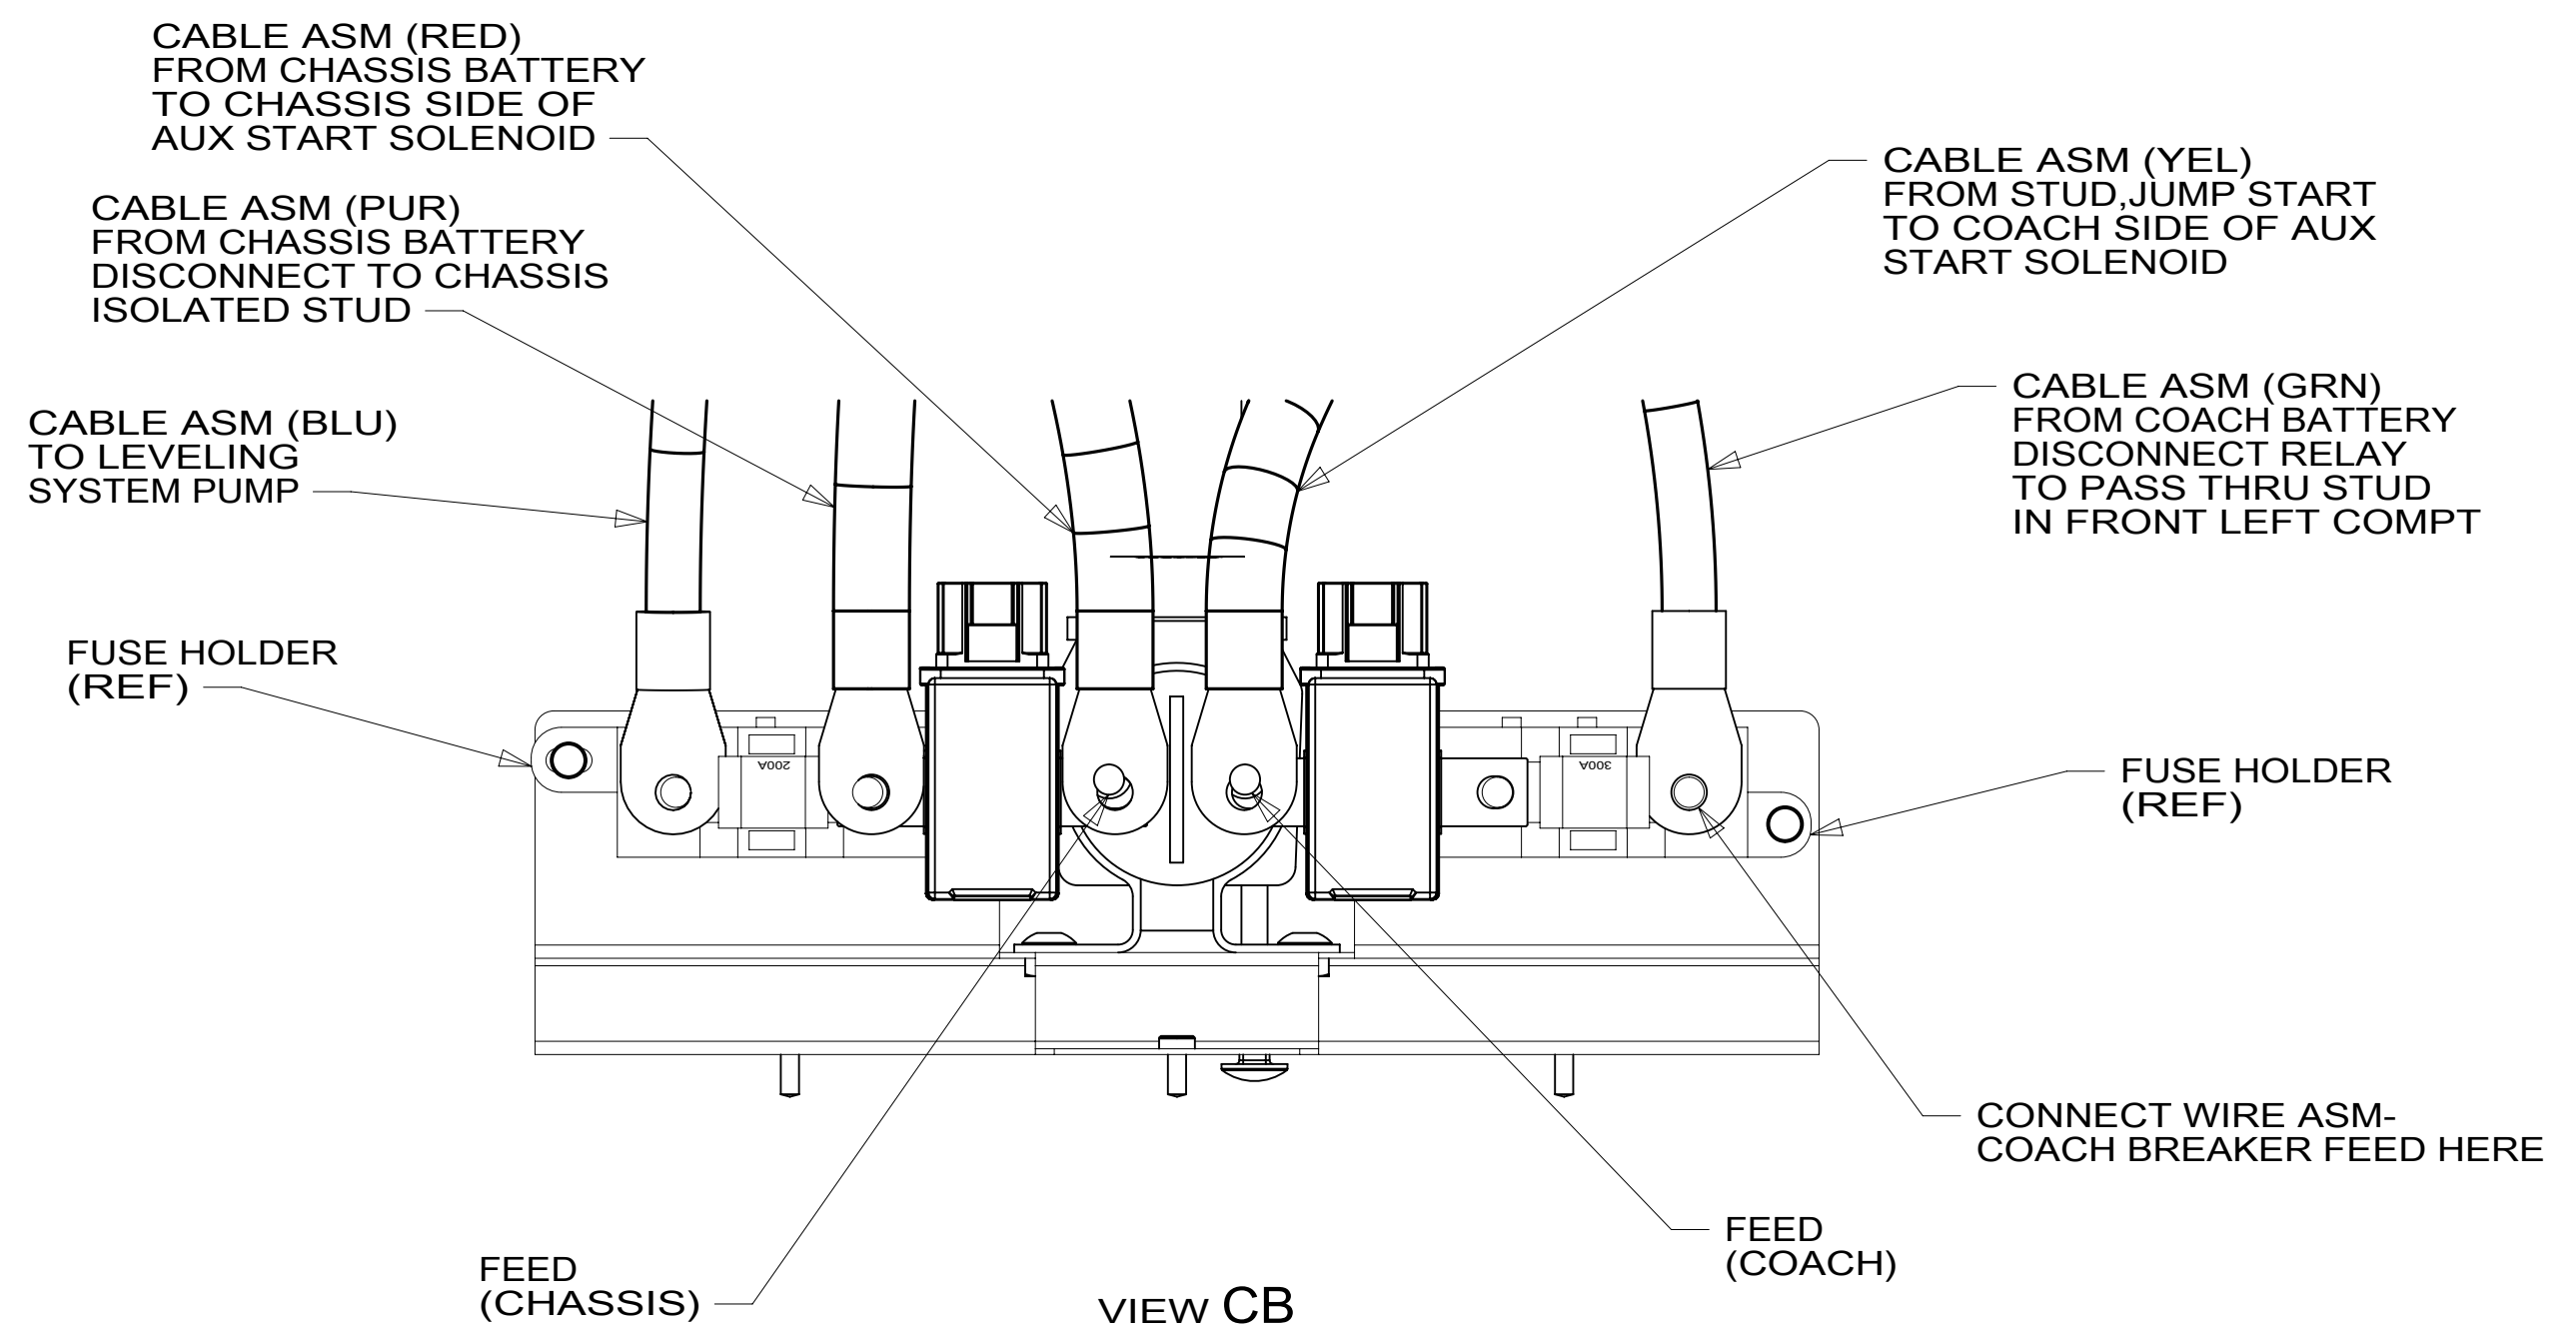

VIEW CB

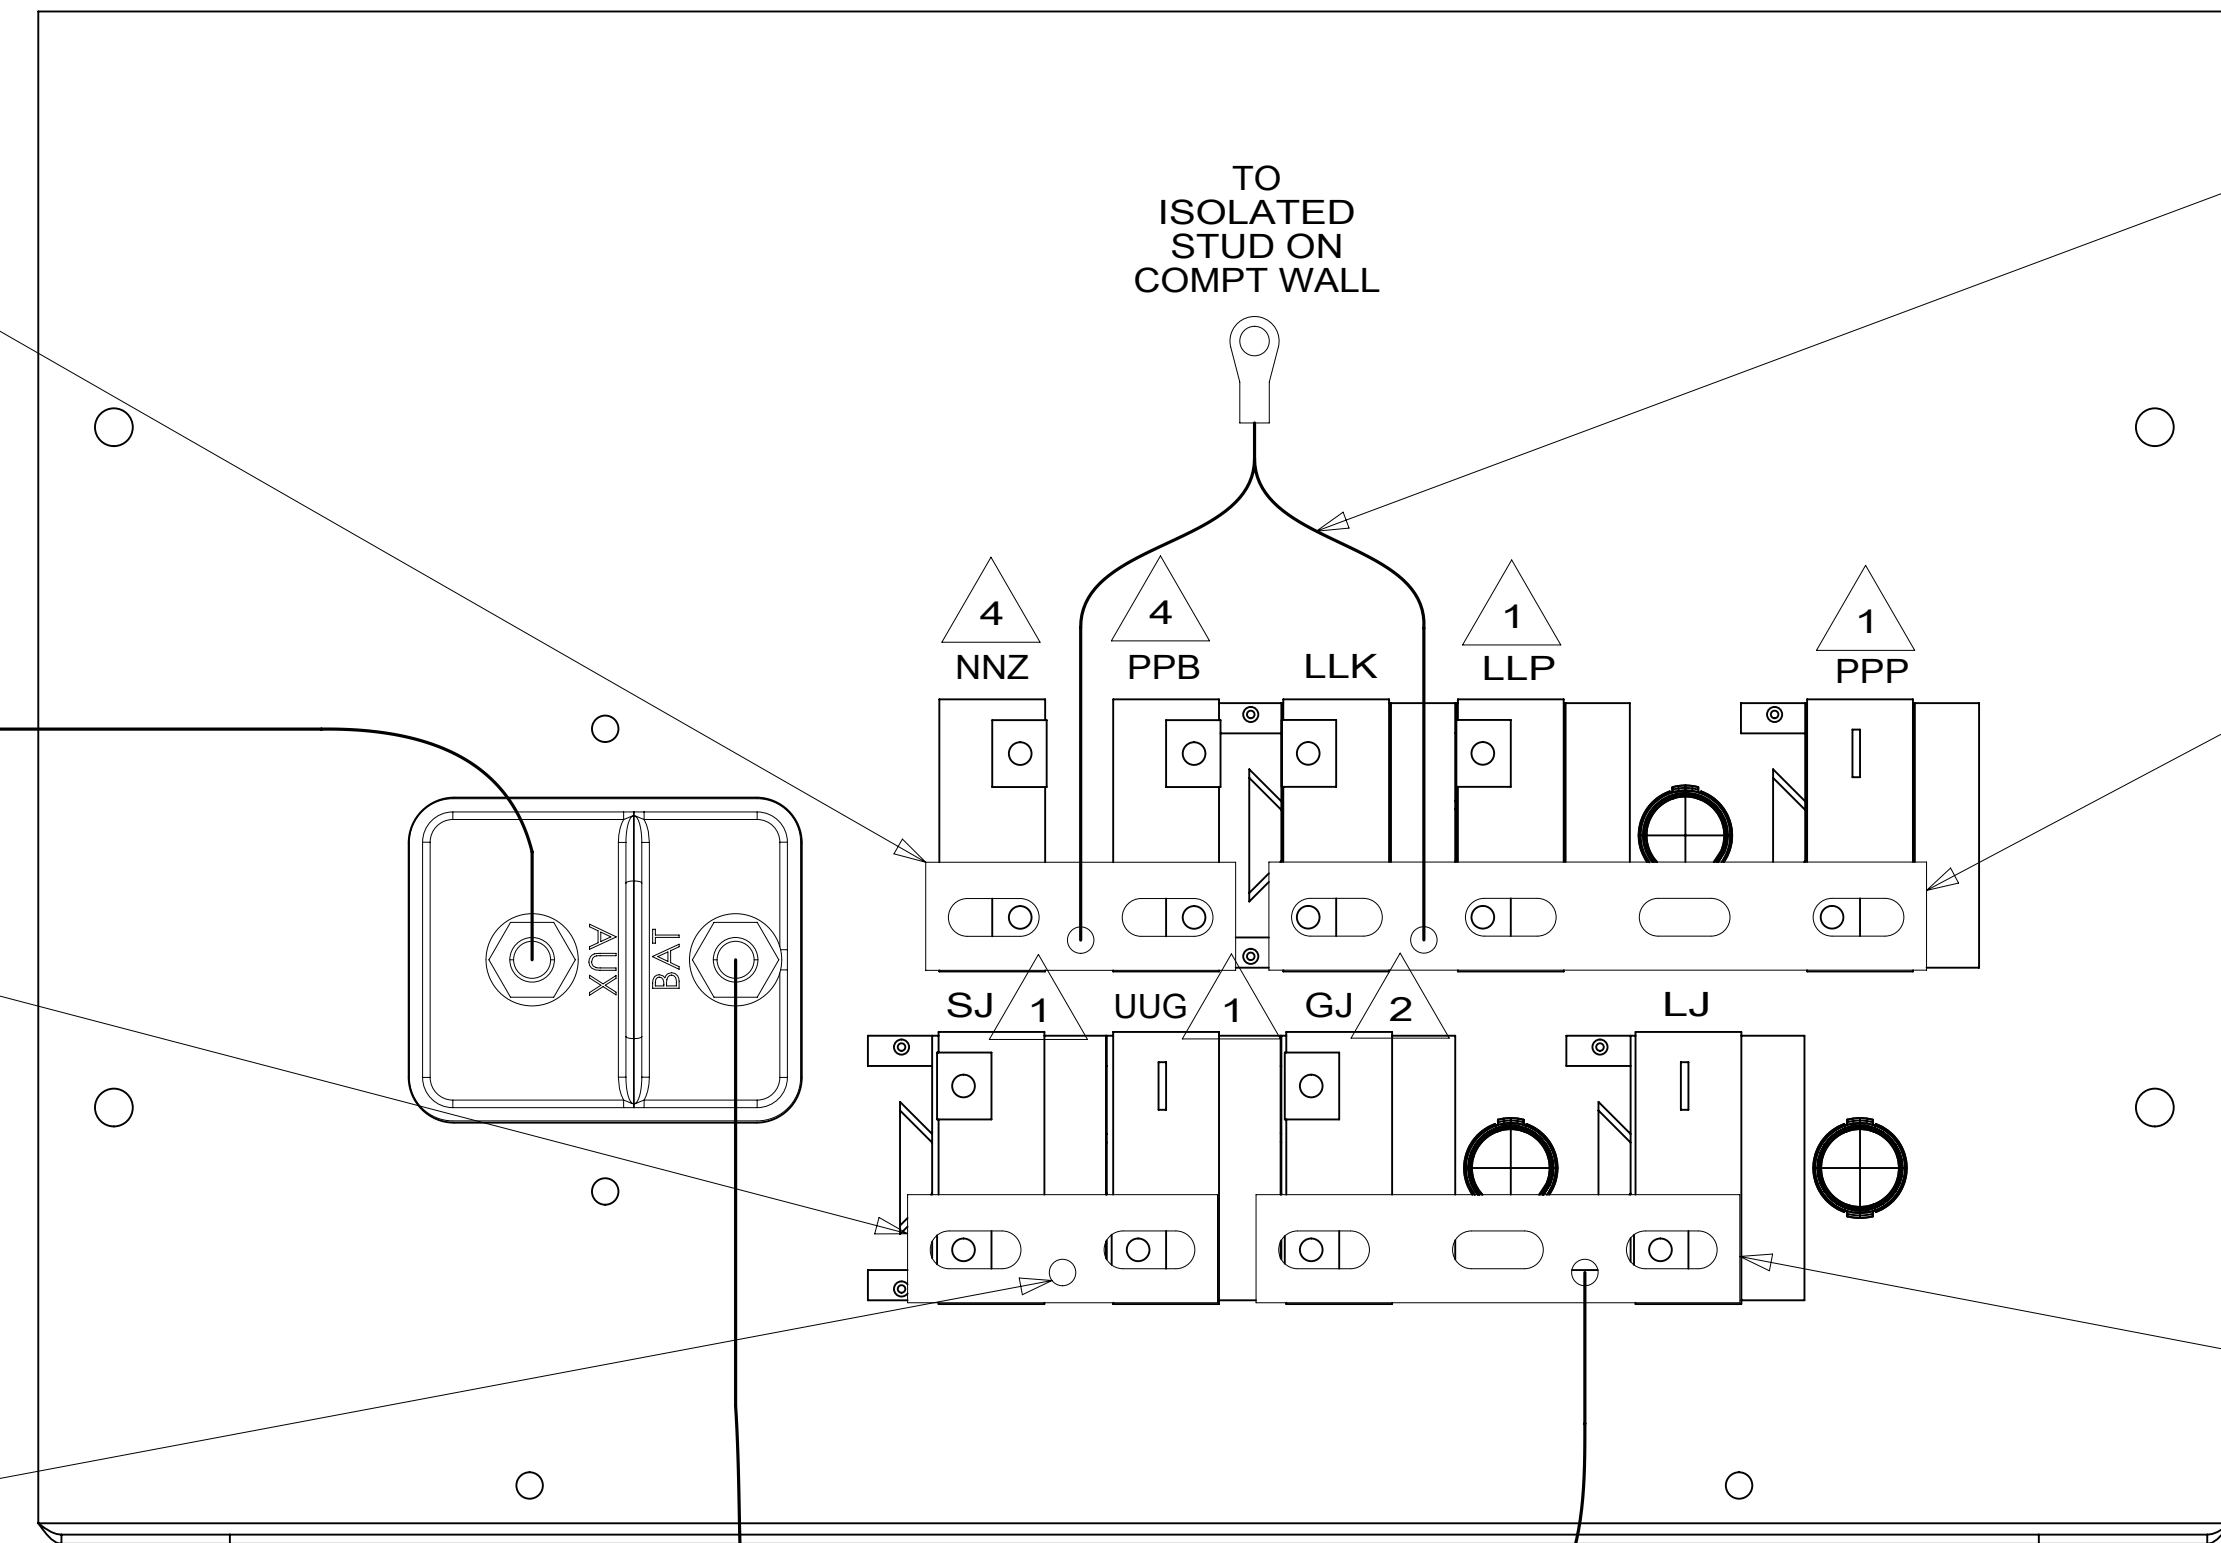

DETAIL CA  
(BACK VIEW-COMPONENTS)

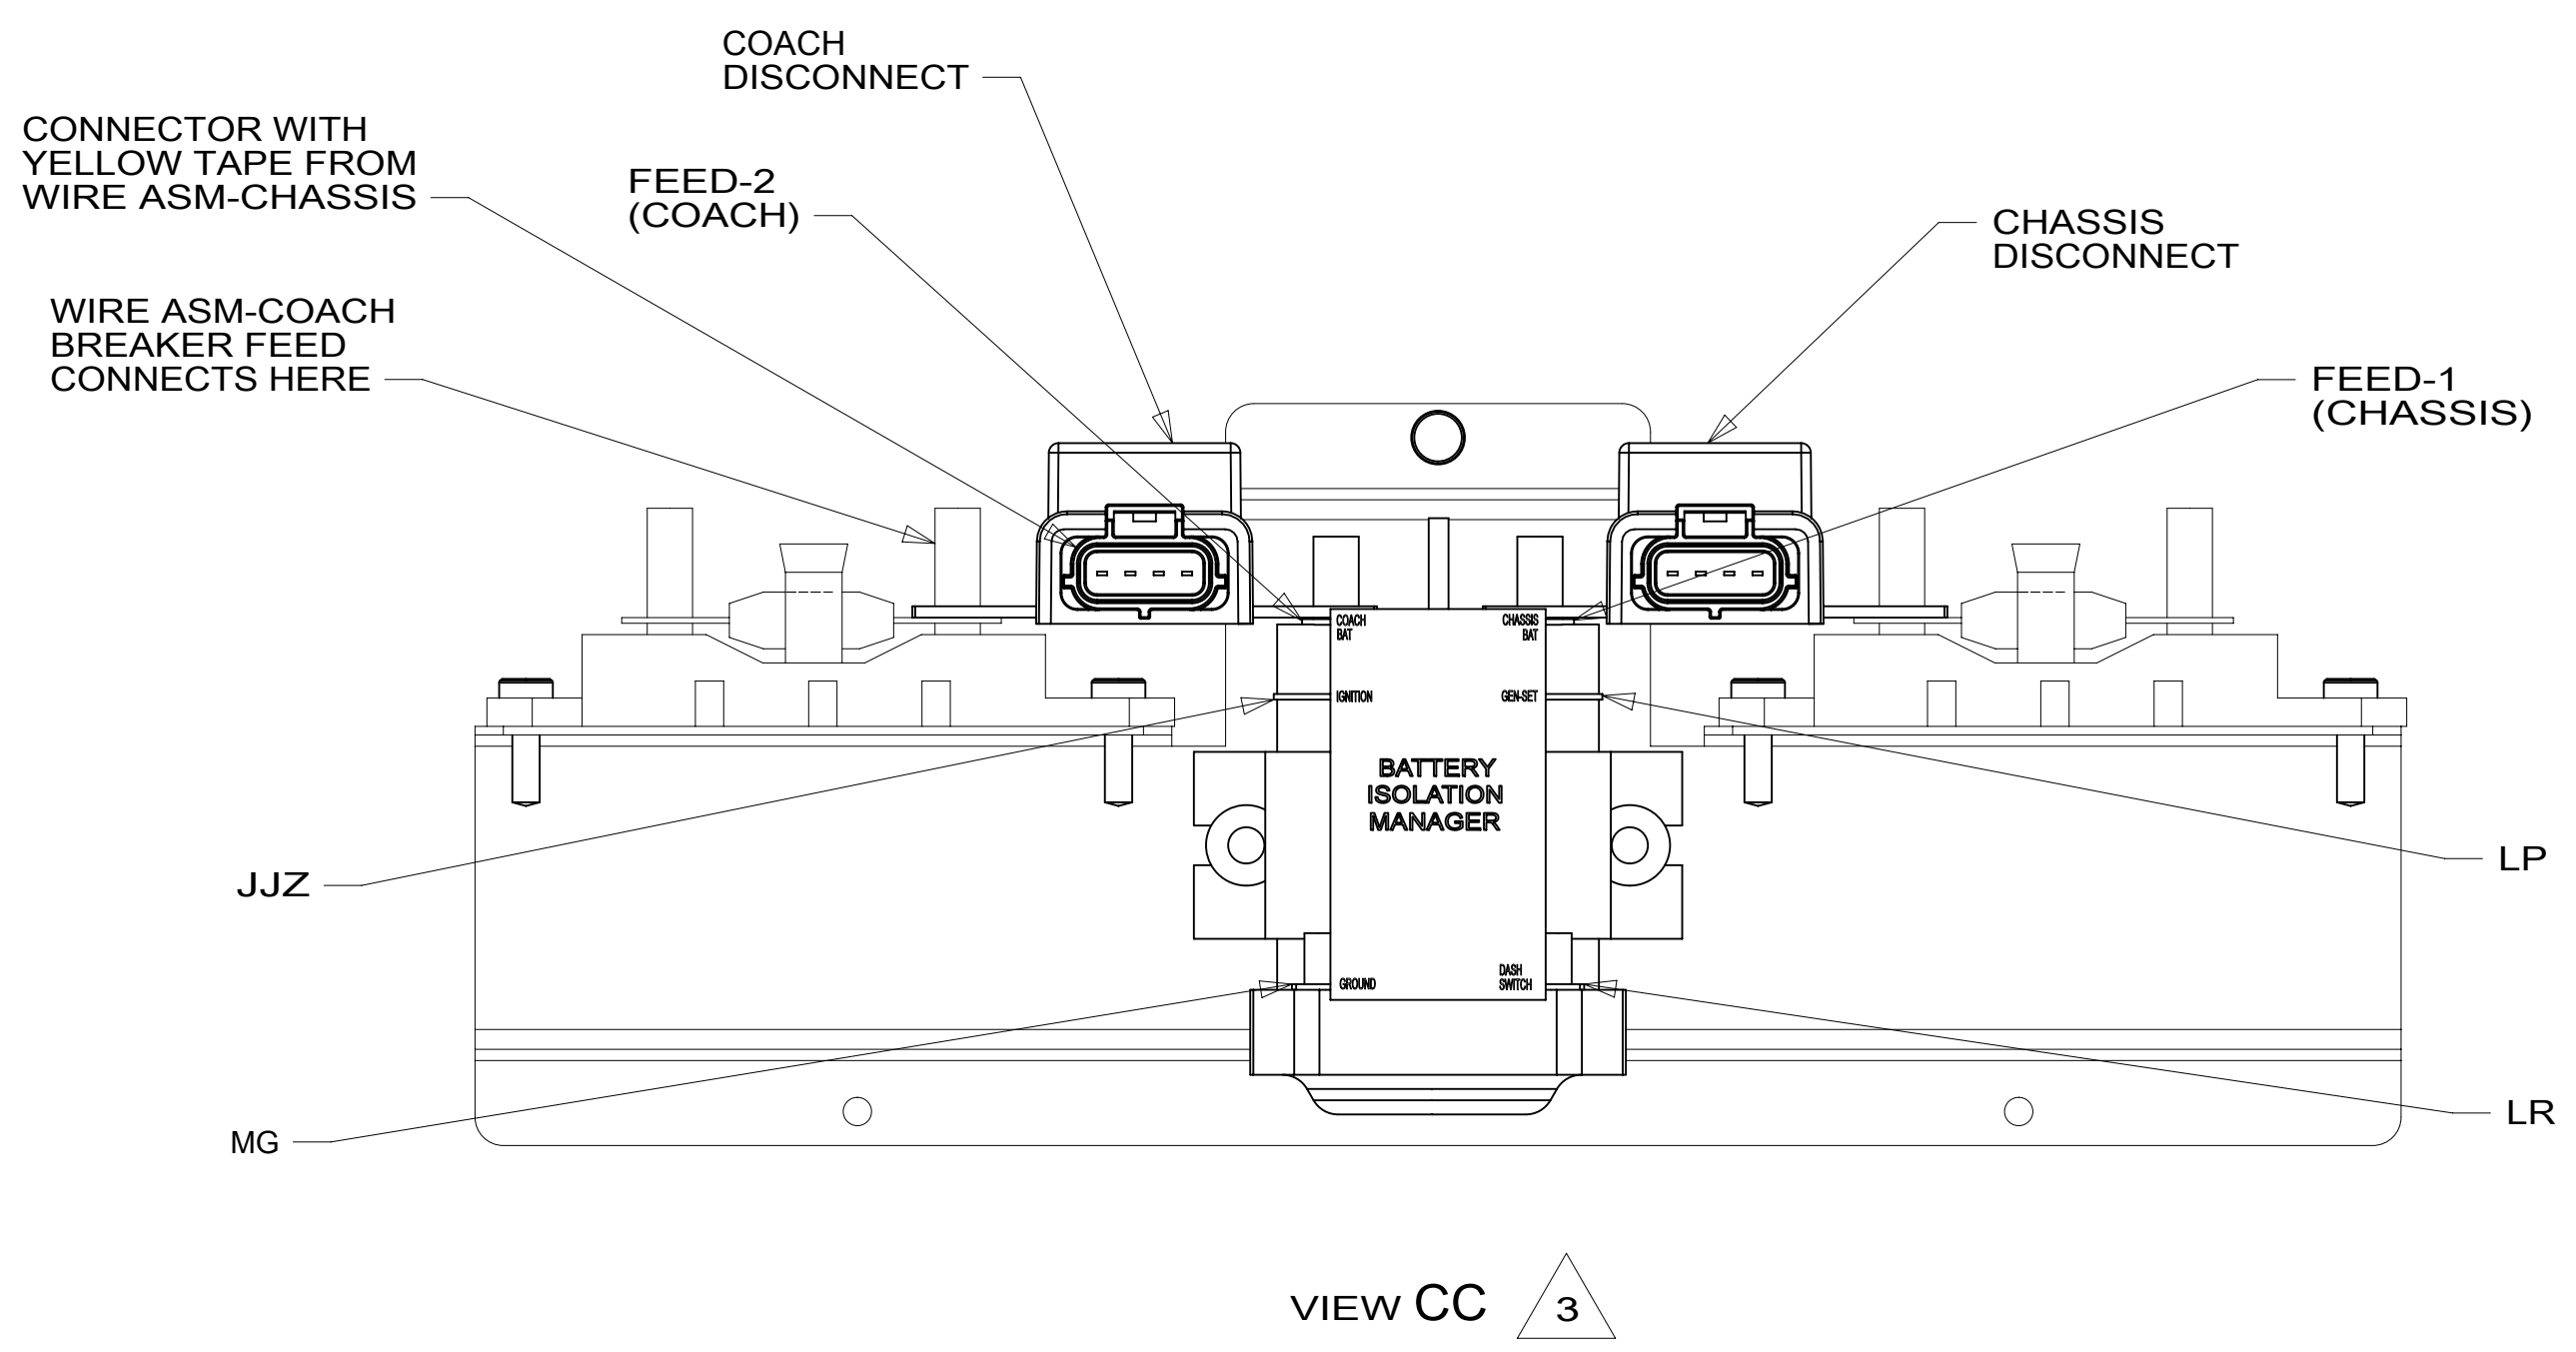

VIEW CC 3

5 CIRCUIT BREAKER-30 AMP  
93655-02-000 (3)  
SCREW  
G52-06-05U (3)  
SPACER-CIRCUIT BREAKER  
141789-01-000 (3)

5 CIRCUIT BREAKER-15 AMP  
93654-02-000 (3)  
SCREW  
G52-06-05U (3)  
SPACER-CIRCUIT BREAKER  
141789-01-000 (3)

29W PLUG-PLASTIC  
81211-06-000 (4)  
282 81211-06-000 (3)

BUSS BAR  
141744-01-000

TO MULTIPLEX PANEL

BUSS BAR  
141744-01-000

1 FEED

CABLE ASM-1GA  
141415-57-006

BUSS BAR  
141744-01-000 29W  
141744-02-000 282

5 REPLACE EXISTING SCREW TO PROPERLY ATTACH BREAKER TO BUSS BAR.

4 FROM WIRE ASM-SLIDEOUT POWER.

3 SEE BATTERY INSTL FOR ADDITIONAL INFORMATION.

2 FROM WIRE ASM-CHASSIS. TIE BACK TO HARNESS WITH 29W

1 CIRCUITS BRANCH FROM WIRE ASM-CHASSIS.


NOTES:

- 29W SOLAR PANEL/BATTERY CHRNG W/O
- 282 SOLAR PANEL - 100 WATT
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

DESCRIPTION:	1B1 265	
<b>WIRING INSTL-CHASSIS</b>		
SHEET:	ITEM/PART NO:	REV
3 OF 5	000211659 / 30207501000	

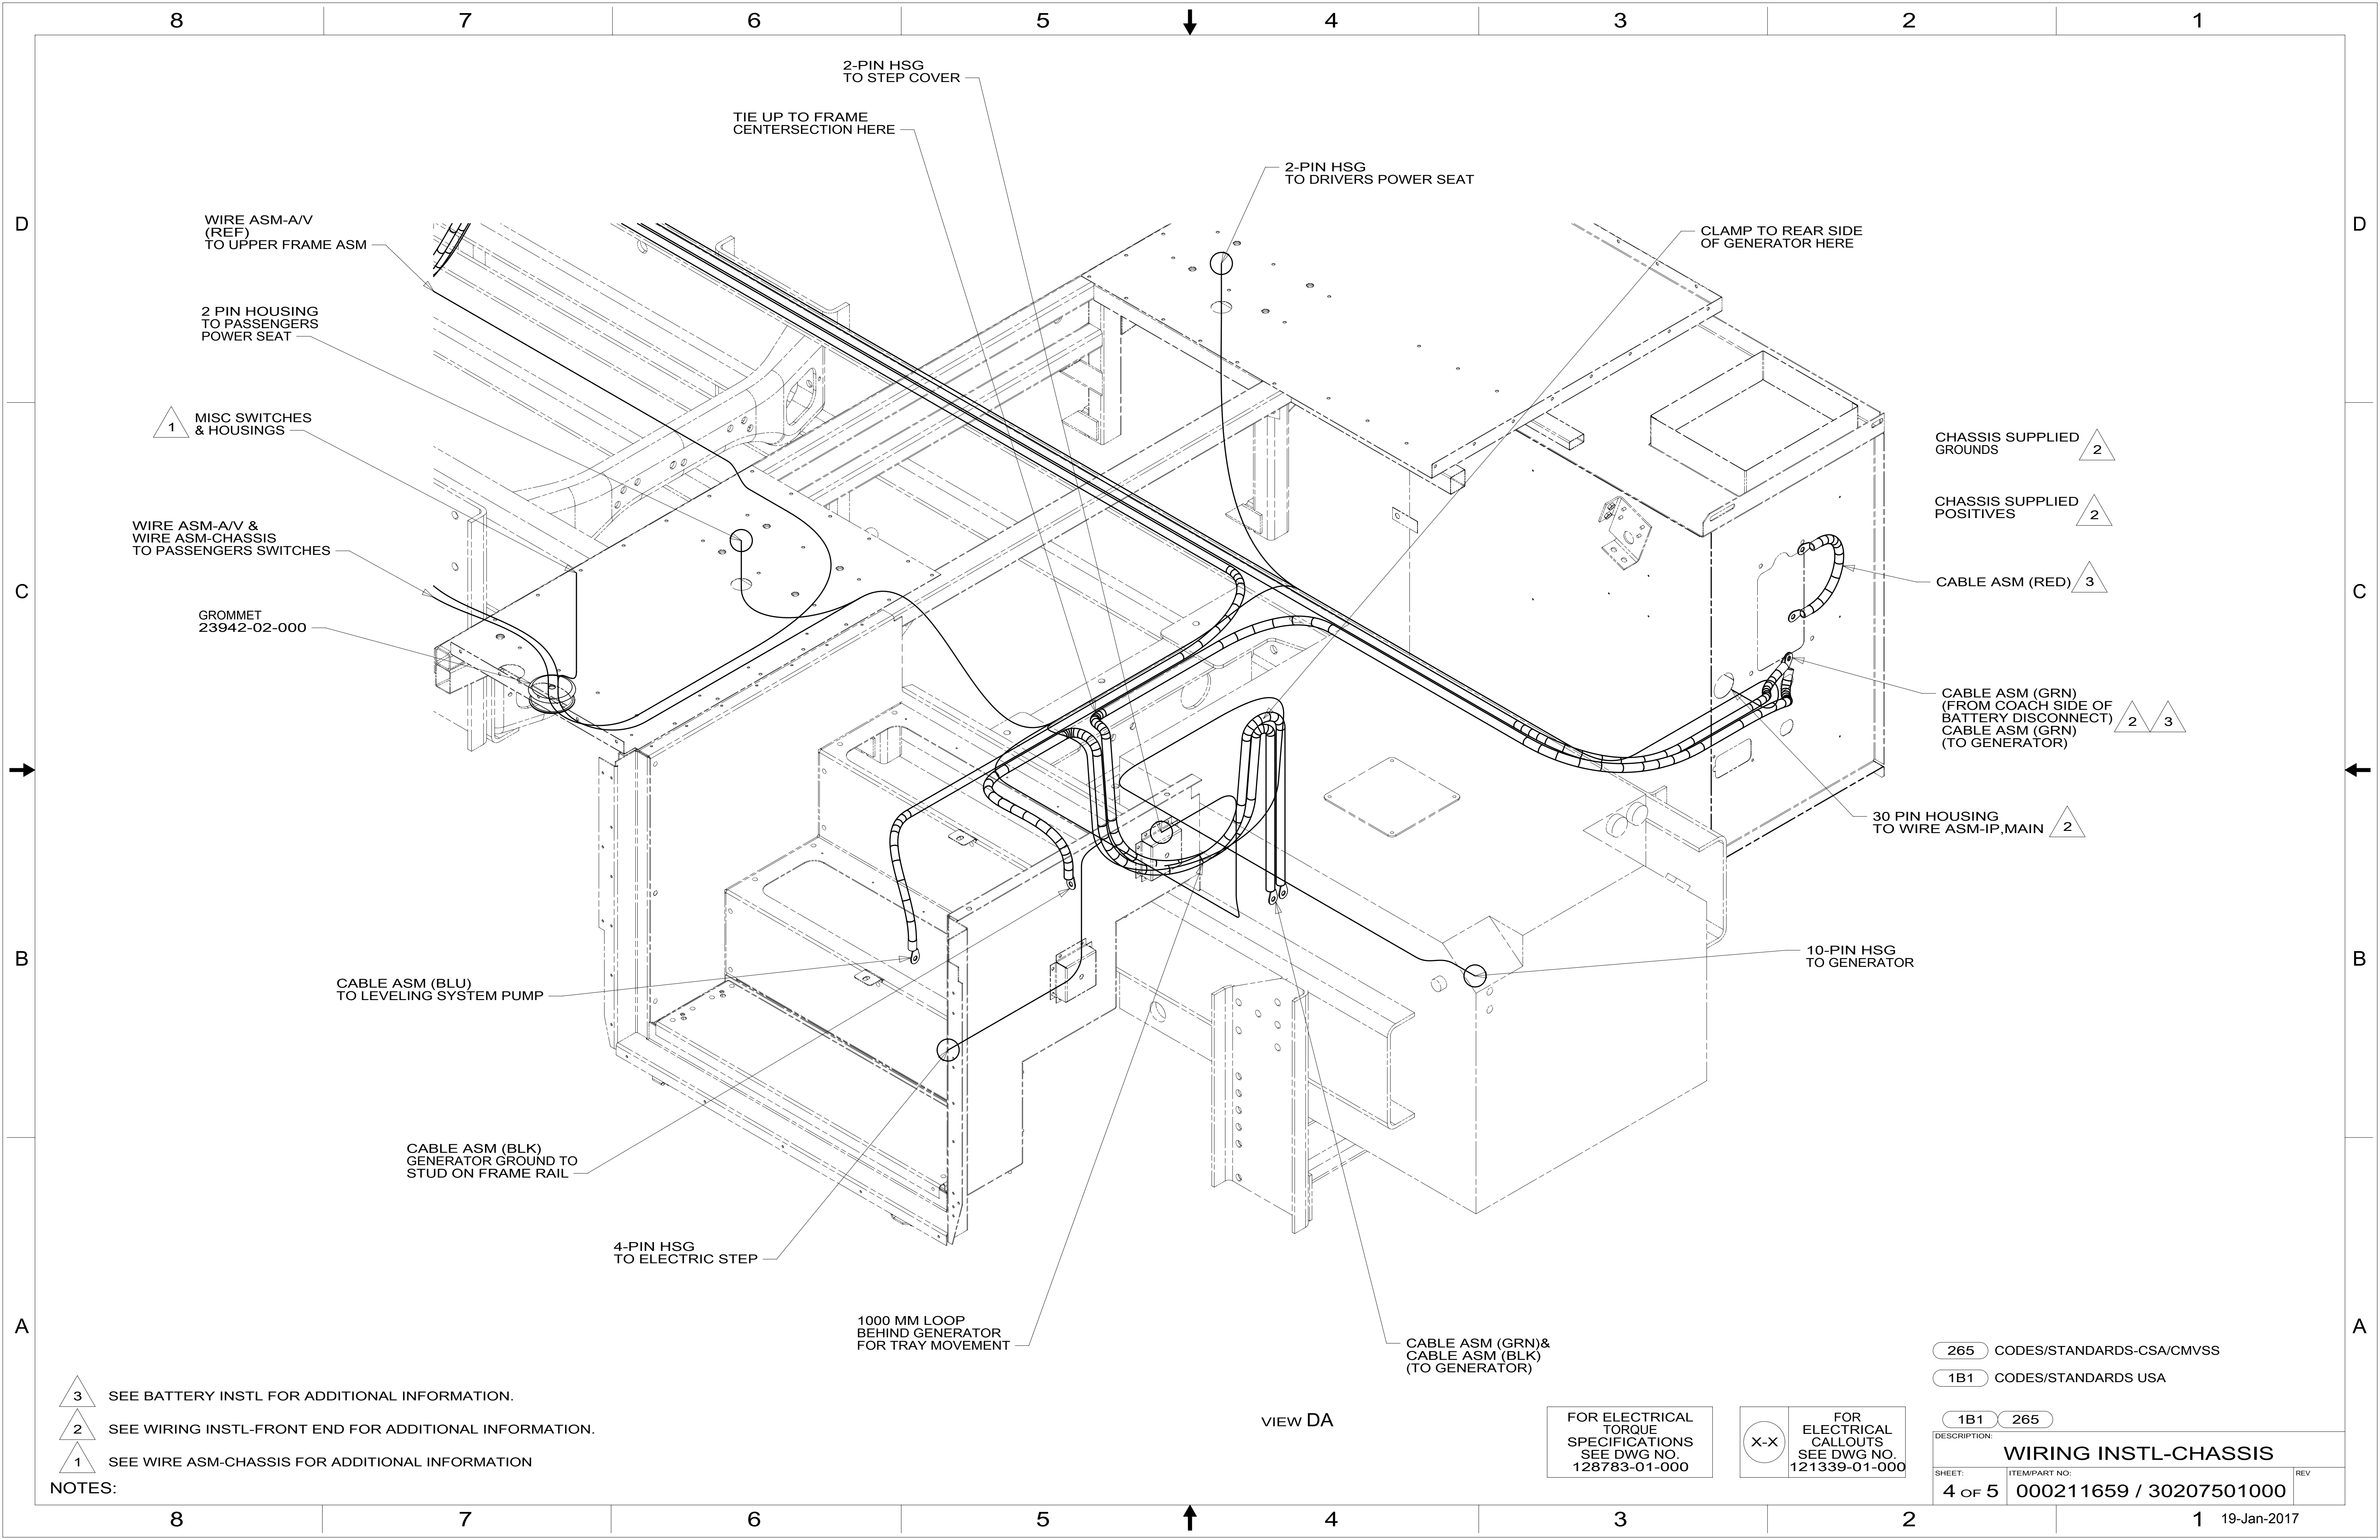

- 3 SEE BATTERY INSTL FOR ADDITIONAL INFORMATION.
- 2 SEE WIRING INSTL-FRONT END FOR ADDITIONAL INFORMATION.
- 1 SEE WIRE ASM-CHASSIS FOR ADDITIONAL INFORMATION

NOTES:

VIEW DA




FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

DESCRIPTION:		1B1 265	
<b>WIRING INSTL-CHASSIS</b>			
SHEET:	ITEM/PART NO.:	REV	
4 OF 5	000211659 / 30207501000		

8 7 6 5 4 3 2 1

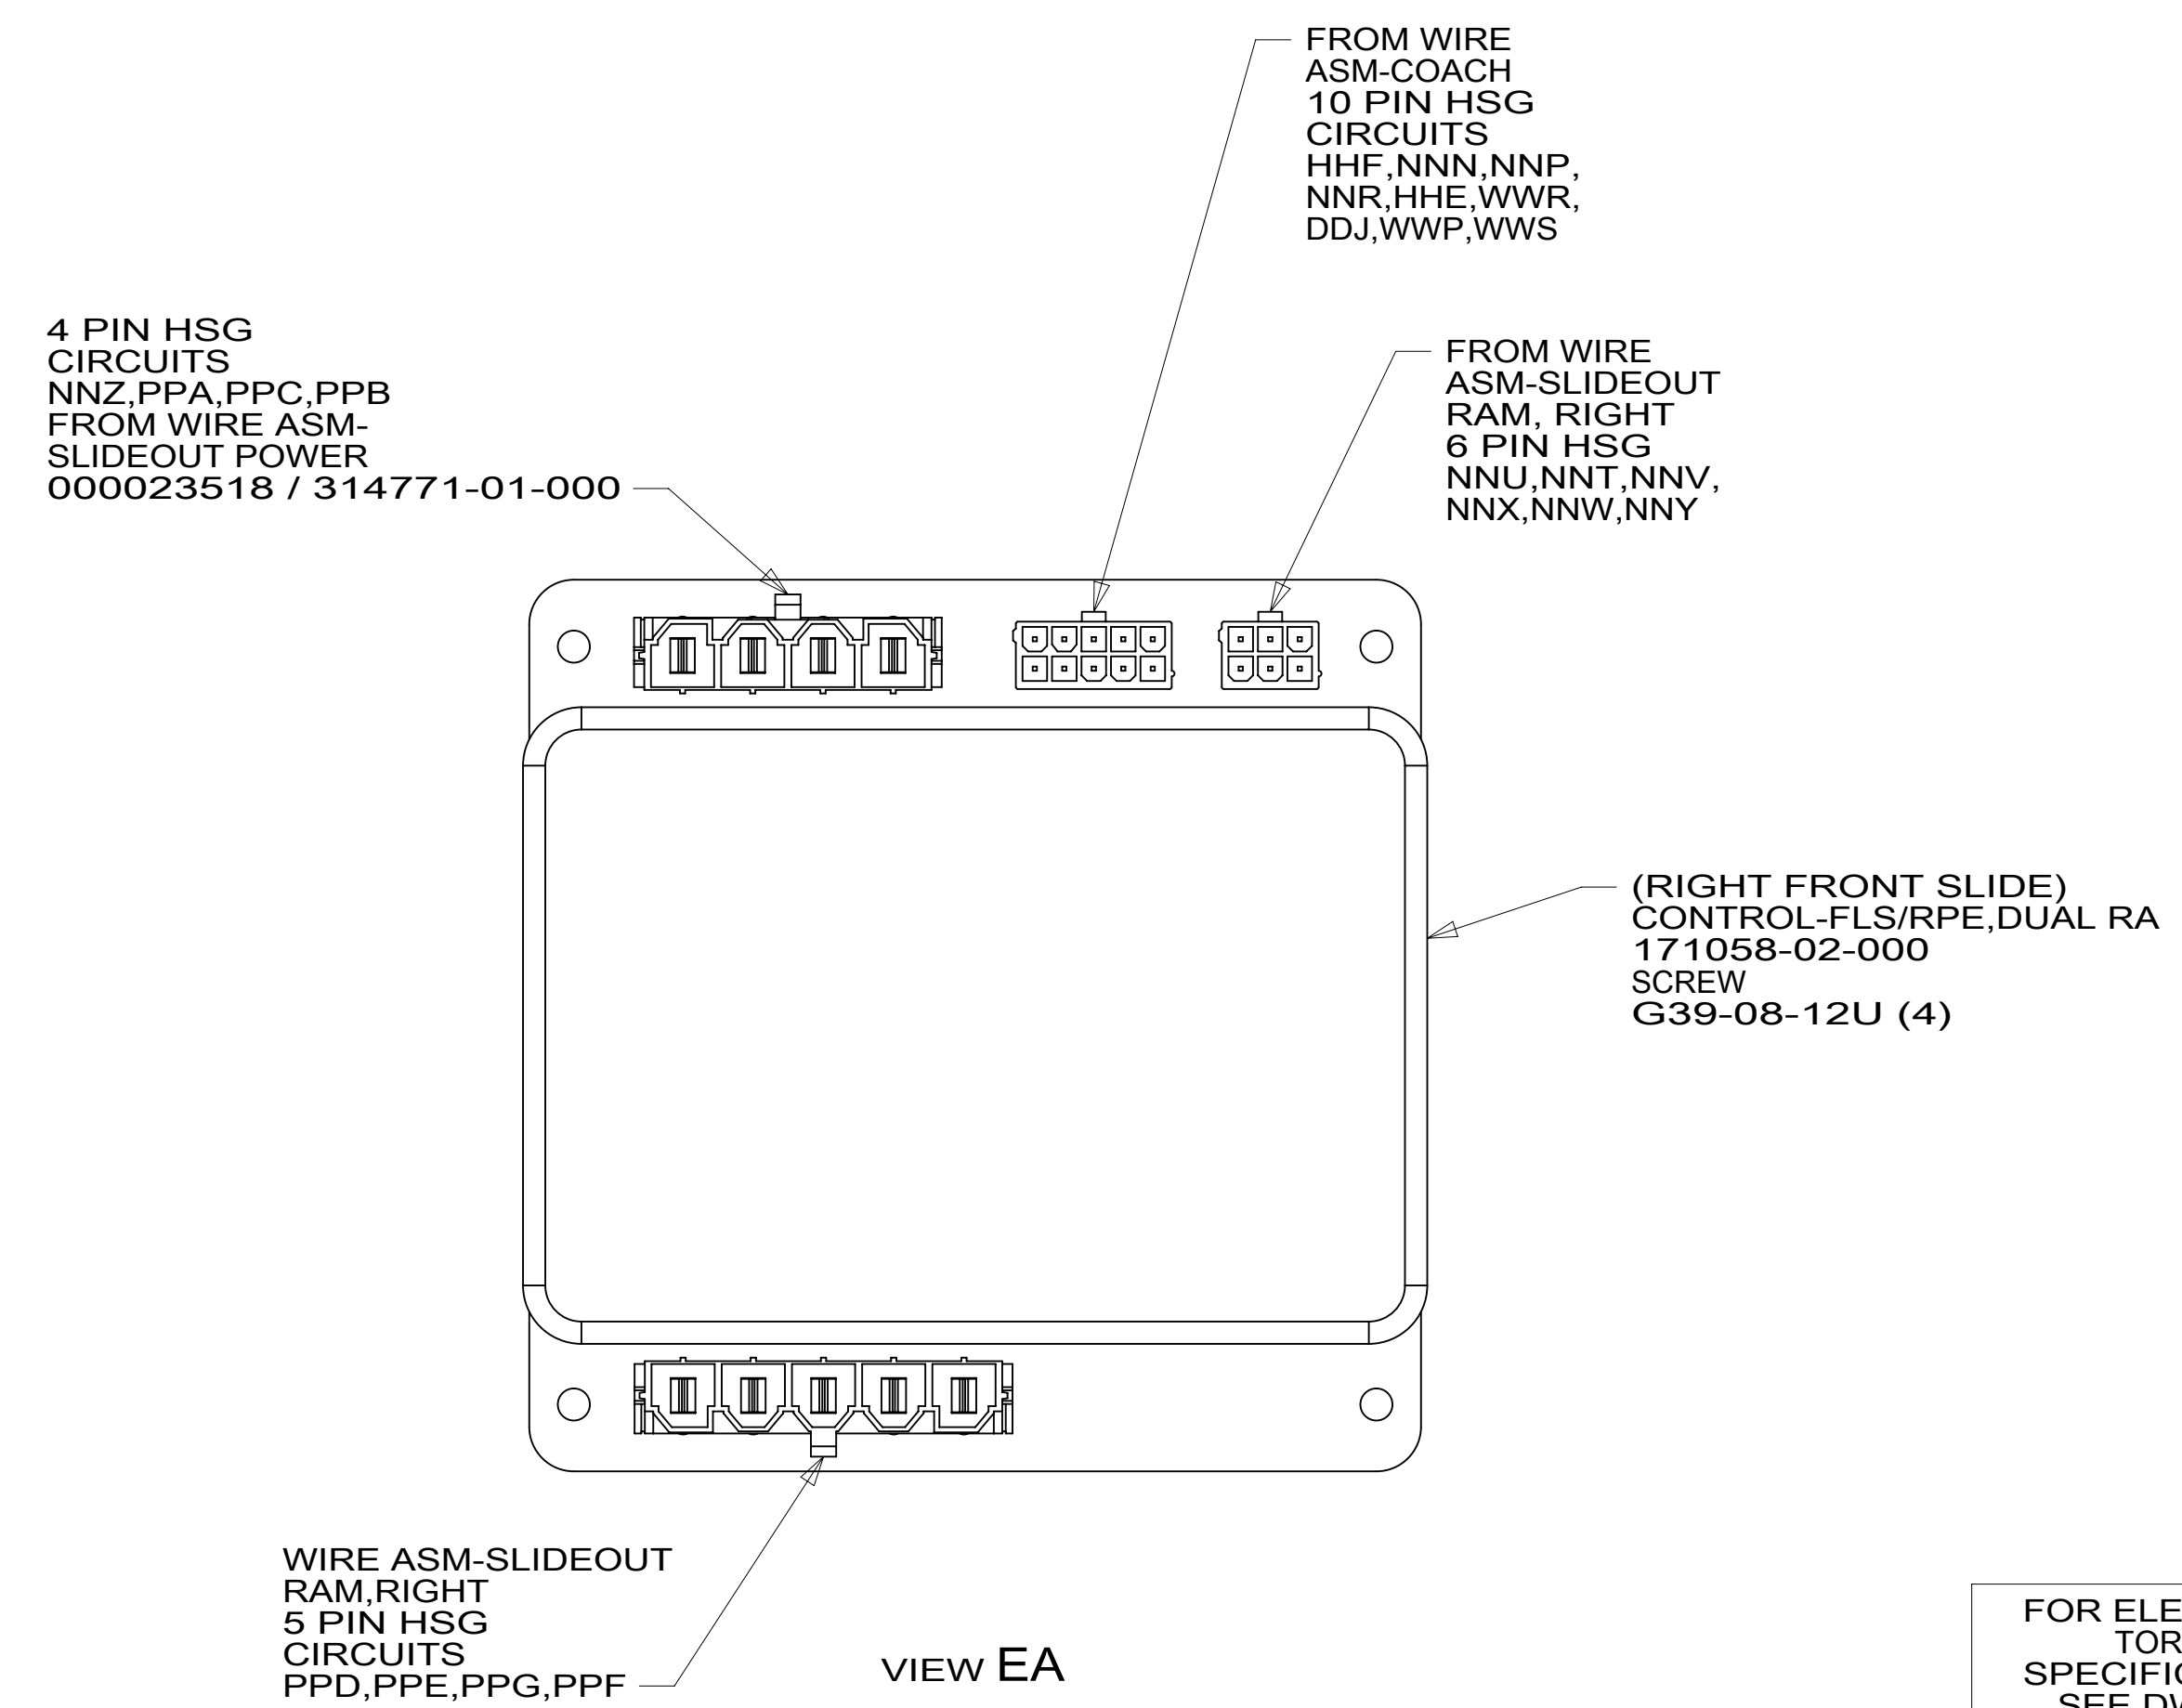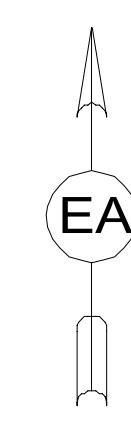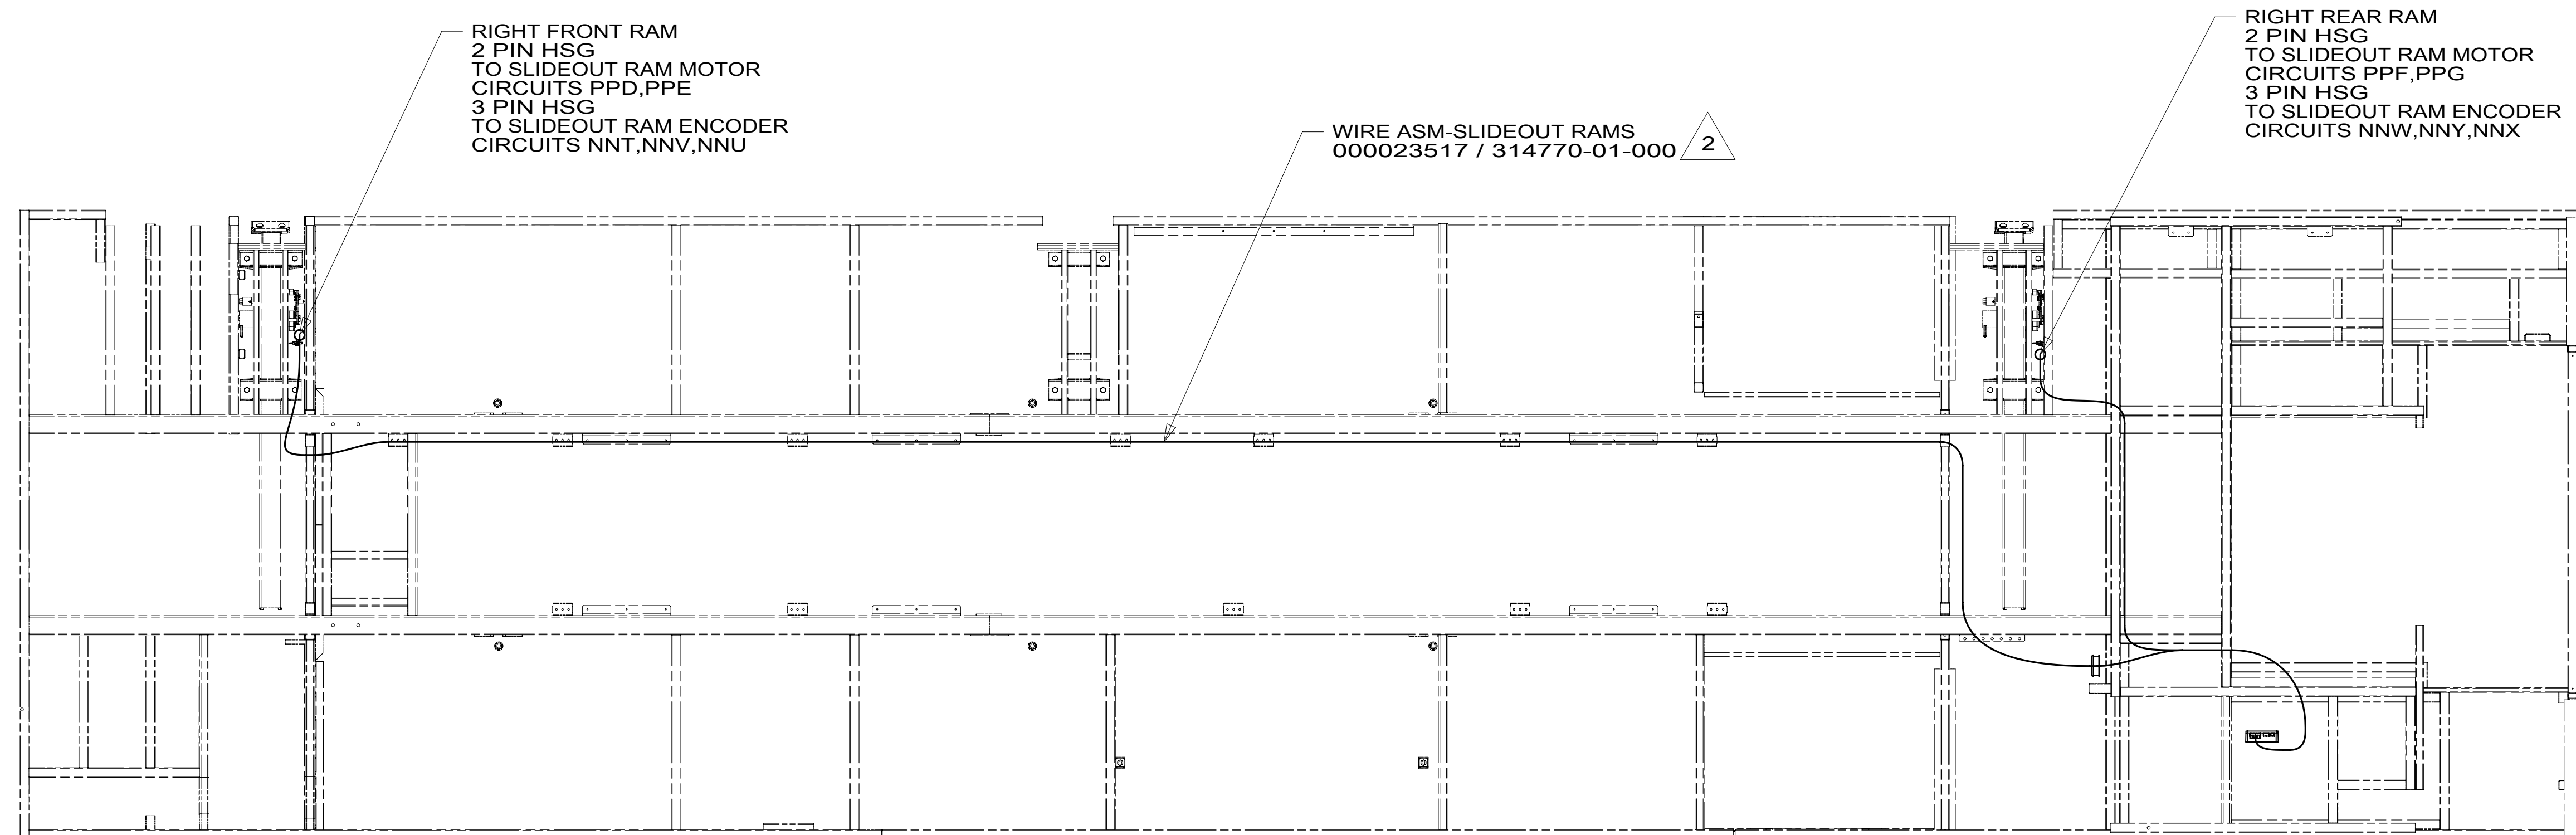

2 WIRES ROUTED ALONG FRAME RAIL.

1. AT MINIMUM ALL WIRES TO BE SUPPORTED AND SECURED PER CODE REQUIREMENTS. USE CLAMP 10495 OR 10497 OR WIRE TIE 8343 OR 108046 AND SCREW G67-XX-XXX OR G56-XX-XXX AS APPROPRIATE FOR INSTALLATION.

NOTES:

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

265 CODES/STANDARDS-CSA/CMVSS  
1B1 CODES/STANDARDS USA

1B1 265		DESCRIPTION: <b>WIRING INSTL-CHASSIS</b>	
SHEET: 5 OF 5	ITEM/PART NO: 000211659 / 30207501000	REV	

8 7 6 5 4 3 2 1 19-Jan-2017