
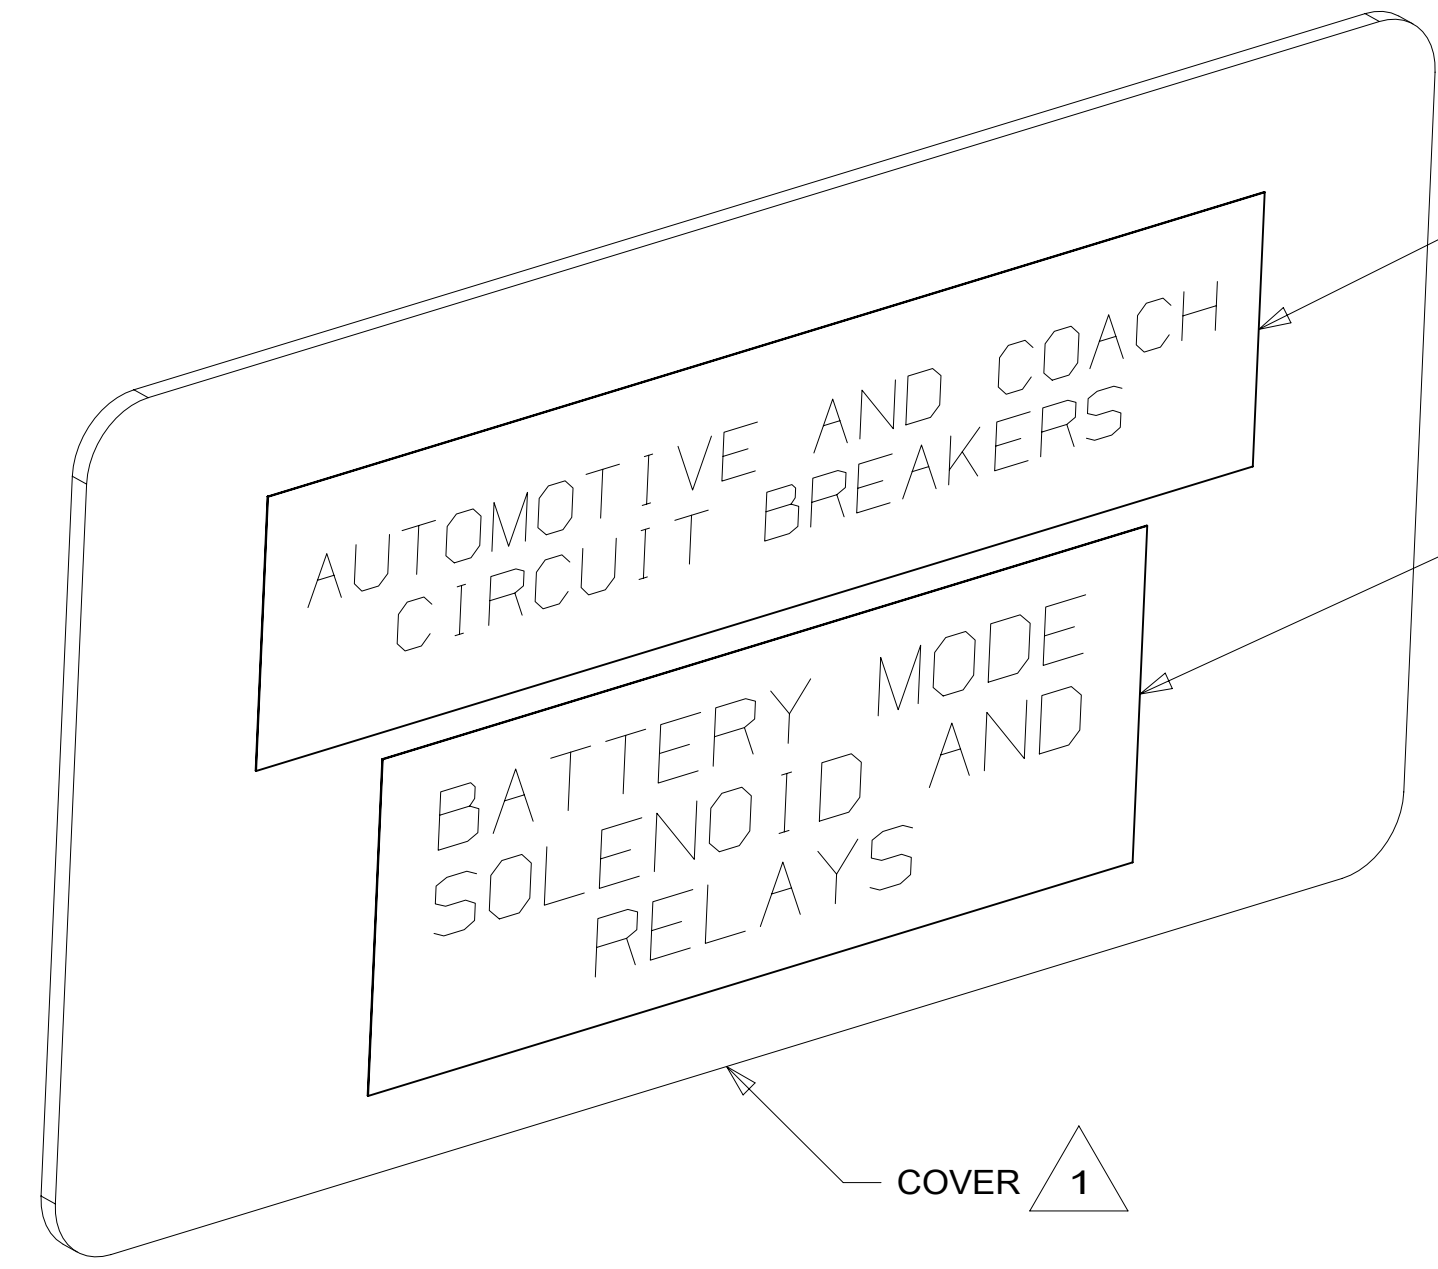


LABEL
93236-72-000

PLATE-CIRCUIT BREAKERS
165712-02-CHT
SCREW
G39-08-08U (6)

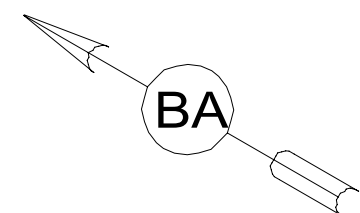

LABEL
98379-01-000

LABEL
98379-04-000

COVER 1

1 SUPPLIED WITH CHASSIS.
NOTES:


		COPYRIGHT 2014 WINNEBAGO INDUSTRIES, INC.
DFT-ORIG	ORIG. DATE	
CHKR	ALL DIMENSIONS ARE IN MILLIMETERS	
P.E.		
M.E.	FIRST USED	
DSNR	16 100-SER	
UNSPECIFIED TOLERANCES ARE:		MATERIAL:
WHOLE DIM (X)	: 3	
ONE-PLACE (X.X)	: 1.5	
TWO-PLACE (X.XX)	: 0.50	
ANGLE	: 1°	
THIRD ANGLE PROJECTION		
DO NOT SCALE DRAWING	REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	
TITLE: CHASSIS ELECTRICAL BOX ASM		
SHEET 1 OF 2	PART NO	192359
REV		
REF:	1	10-Jul-2015

*192359 *A

CIRCUIT BREAKER-6 AMP
93654-01-000
SCREW
000G52-06-05U
SPACER-CIRCUIT BREAKER
141789-01-000


CIRCUIT BREAKER-40 AMP
093655-03-000
SCREW
000G19-10-08U (2)

CIRCUIT BREAKER-15 AMP
93654-02-000
SCREW
000G52-06-05U
SPACER-CIRCUIT BREAKER
141789-01-000

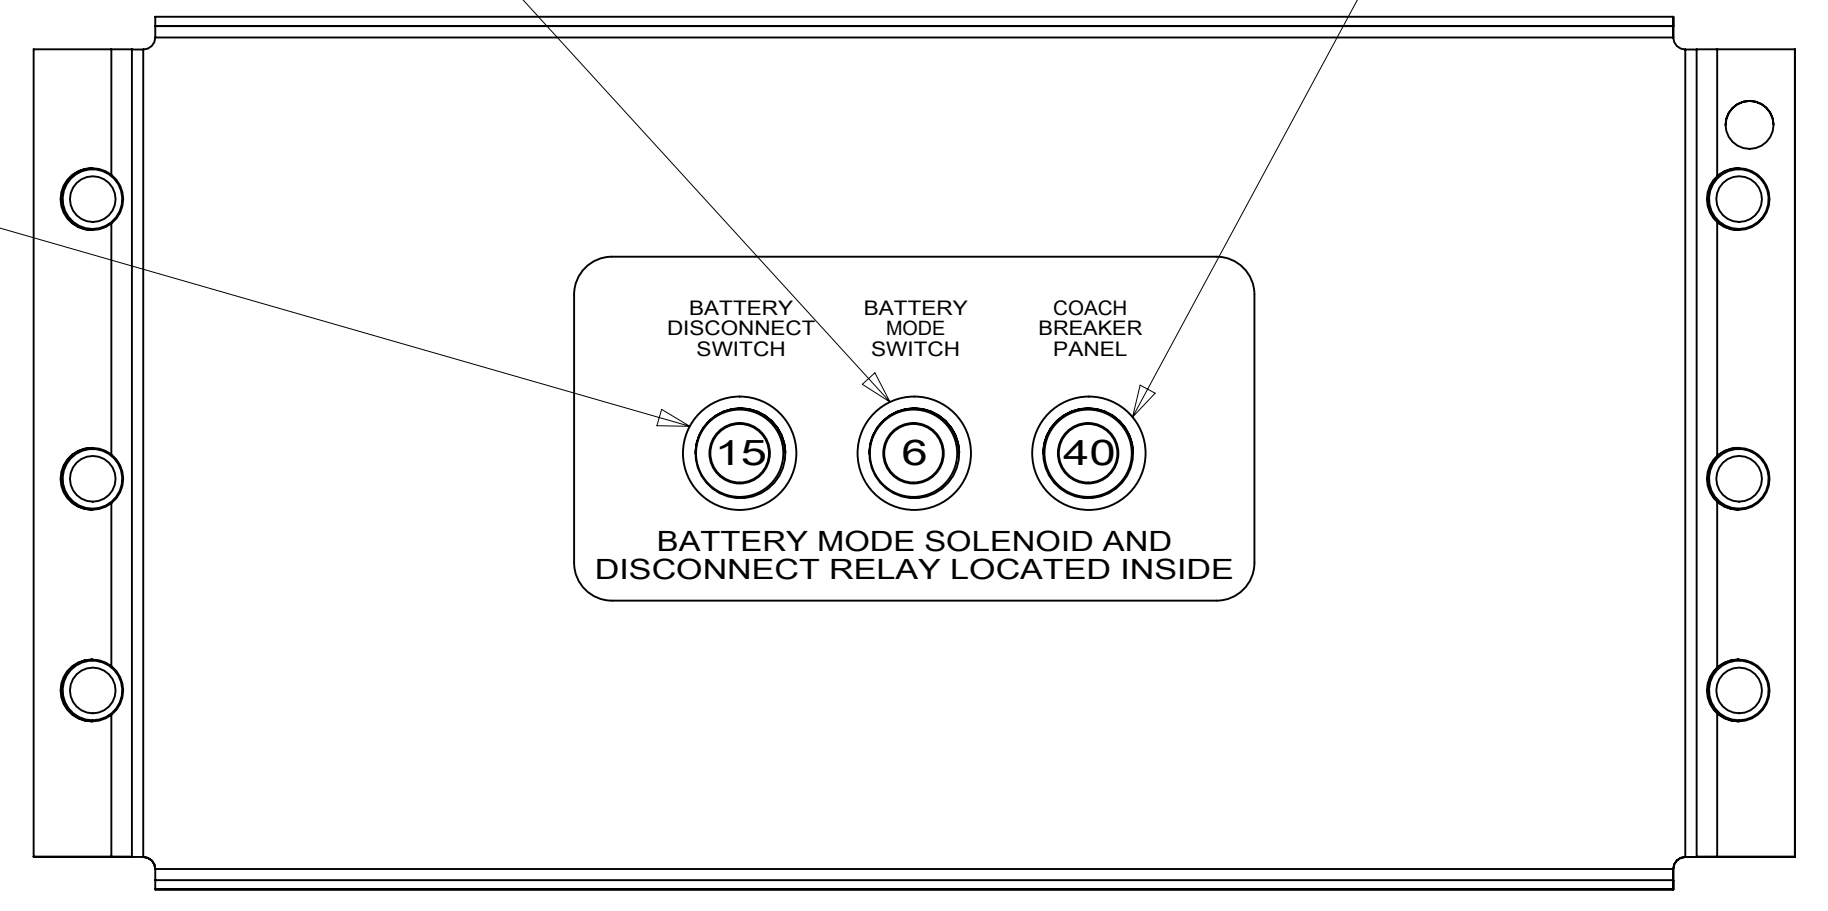


VIEW BA

BUSS BAR
141744-01-000

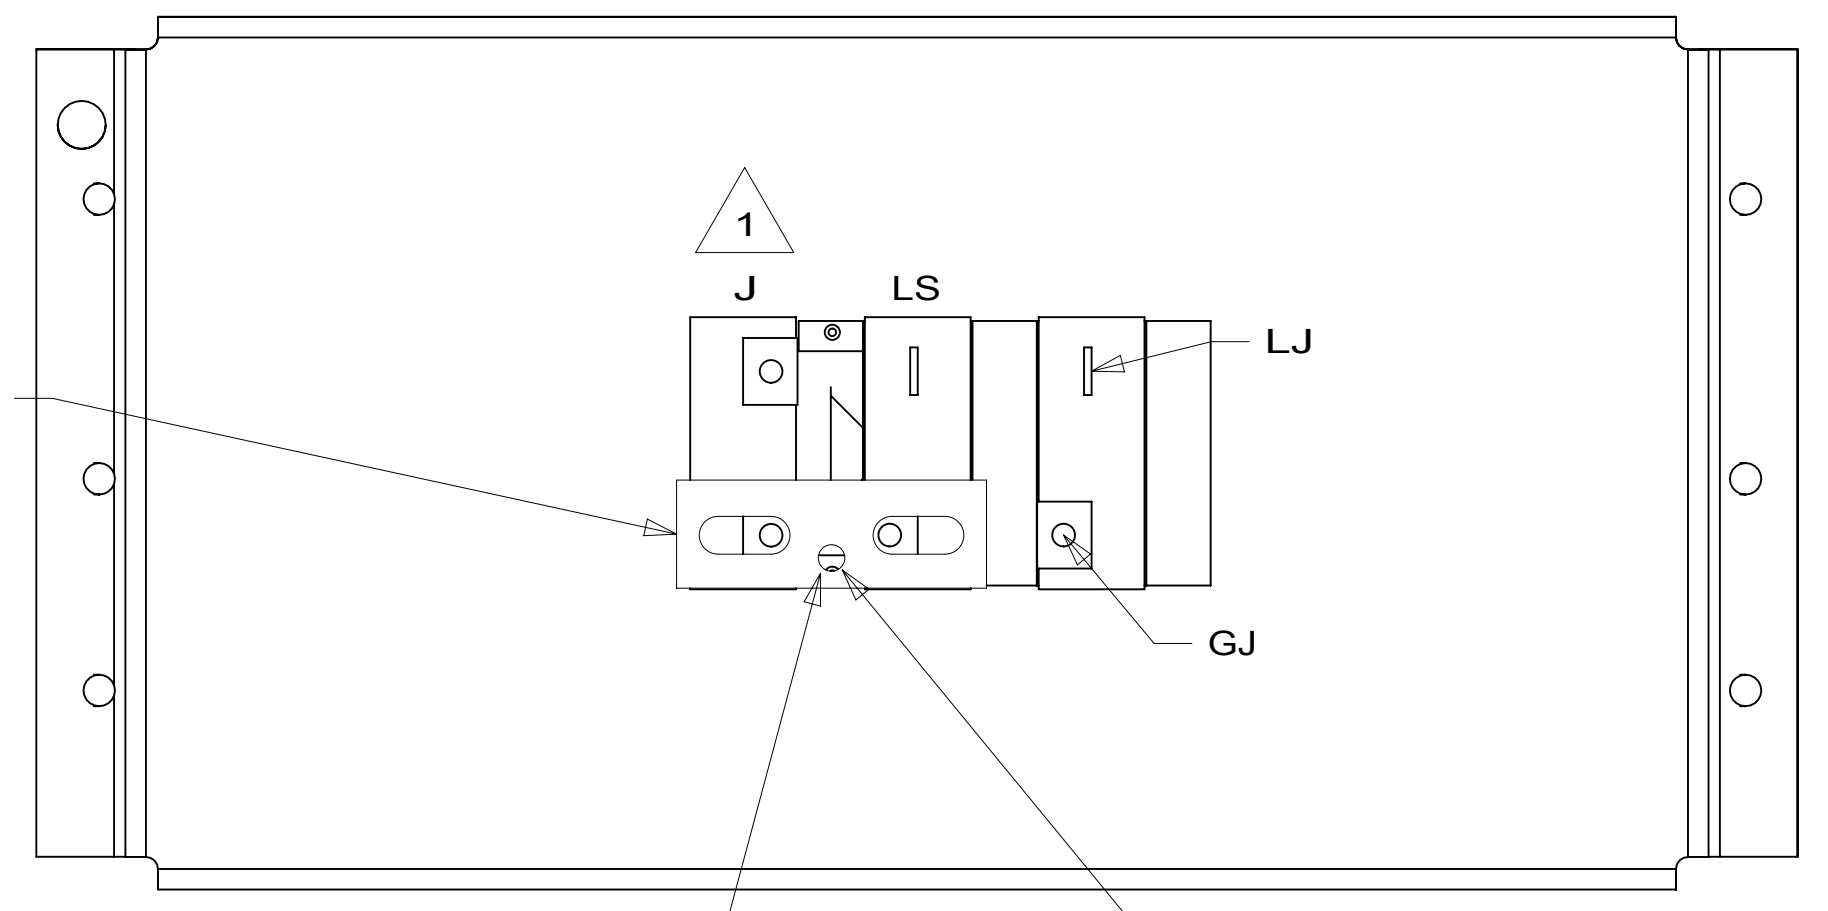


VIEW BB

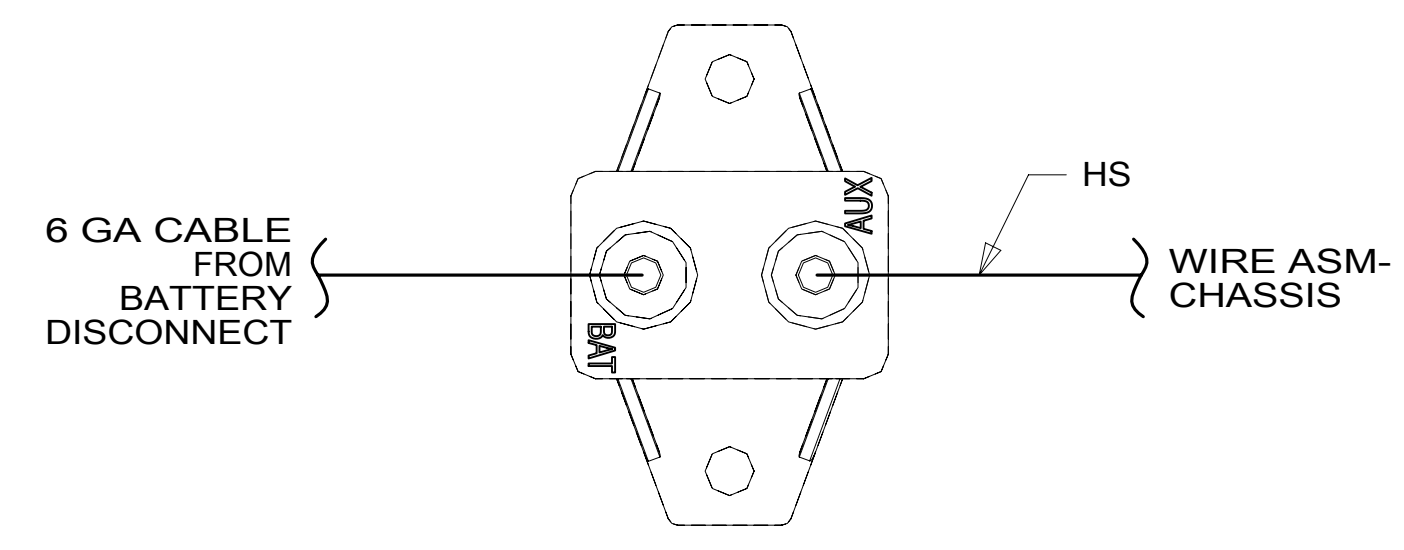

DETAIL BC 282

CIRCUIT BREAKER-30AMP
183624-03-000
SCREW
G39-10-12U (2)
NUT
D24-10-00U (2)
WASHER
E13-10-00U (2)
DETAIL BC

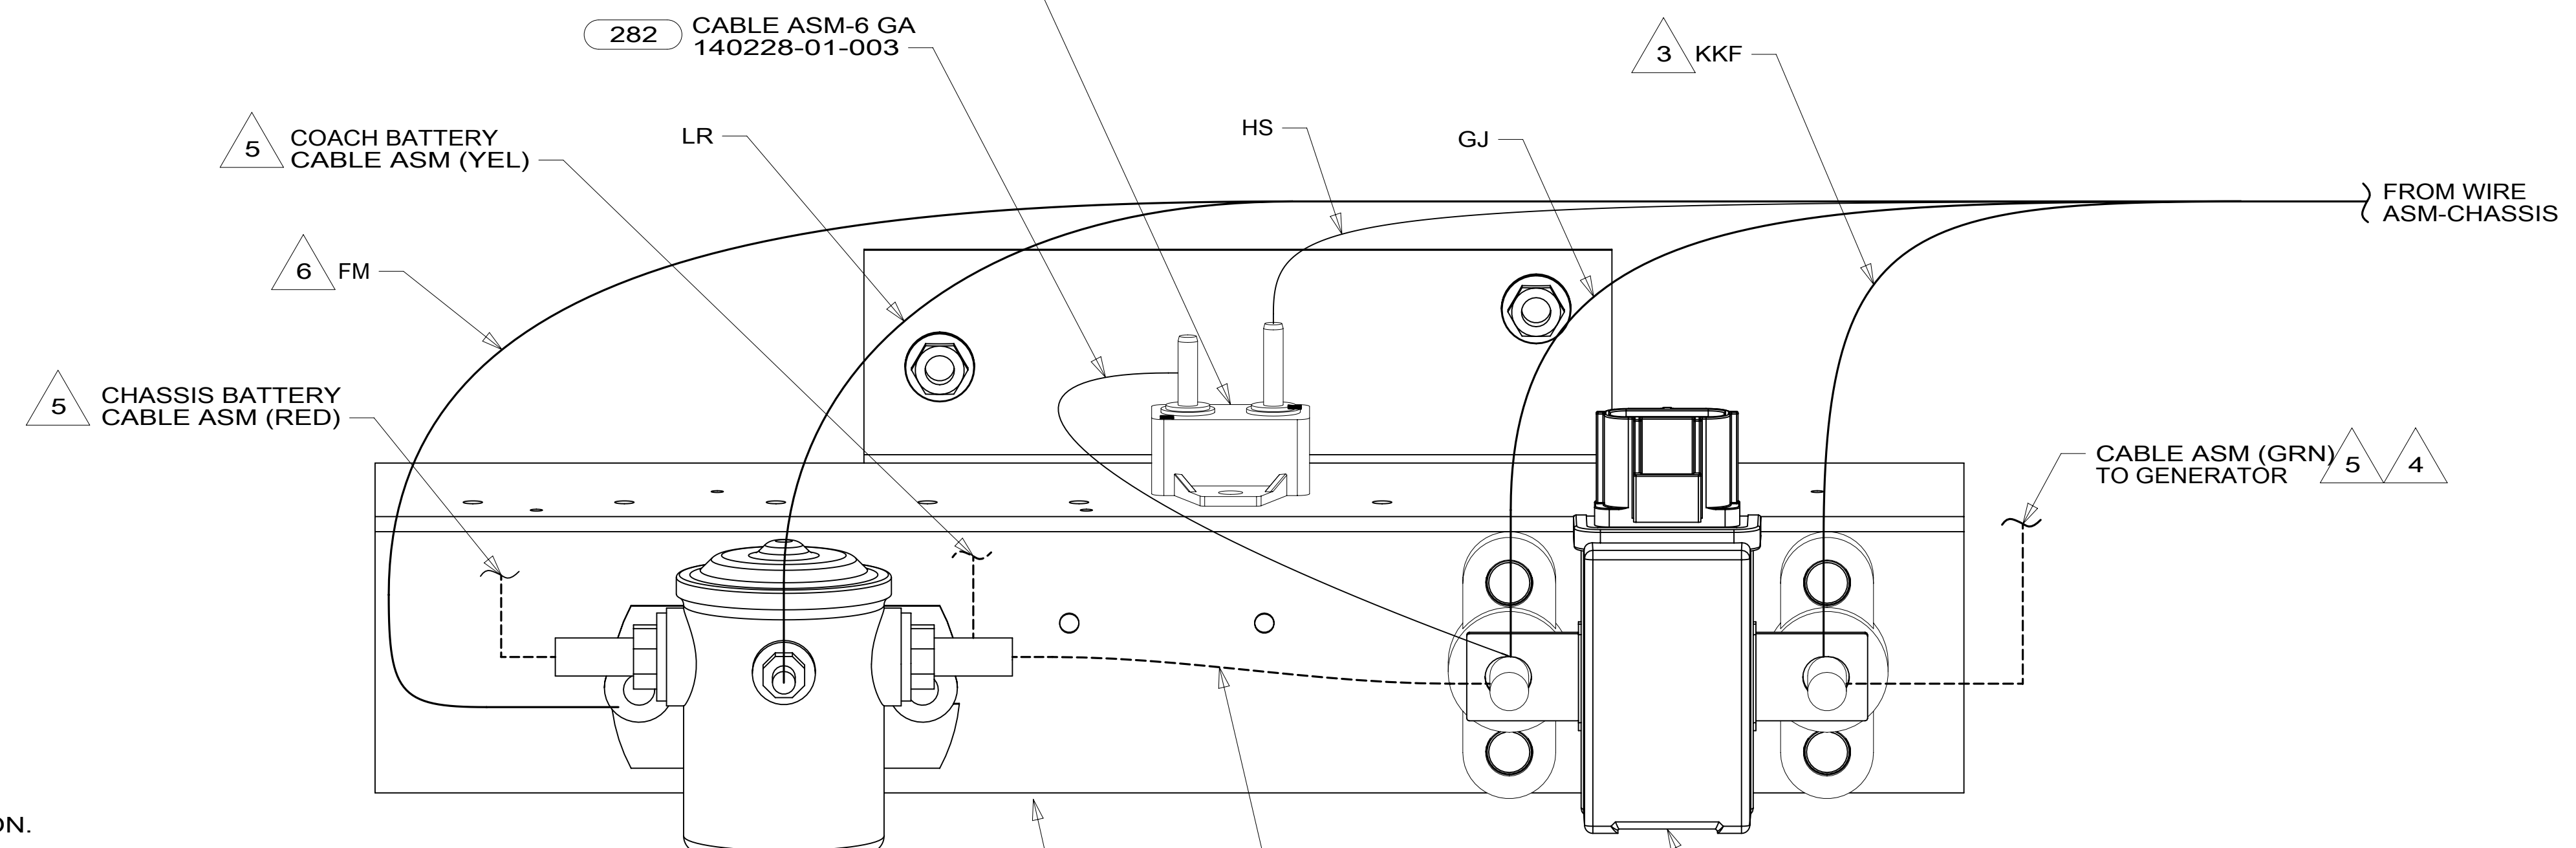

- NOTES:
- 6 SECURE WITH SOLENOID MOUNTING SCREW.
 - 5 WIRING INSTL-CHASSIS FOR ADDITIONAL INFORMATION.
 - 4 WITHOUT 384 DO NOT CONNECT CABLE ASM-GENERATOR (GRN) TO SOLENOID TAPE END WITH TAPE 8363-01-000 AND LEAVE CABLE END LOOSE IN ELECTRICAL BOX.
 - 3 WIRE IS MARKED WITH YELLOW TAPE.
 - 2 REPLACE EXISTING SCREW TO PROPERLY ATTACH BREAKER TO BUSS BAR.
 - 1 CIRCUIT IS FROM WIRE ASM-CHASSIS.

- 282 SOLAR PANEL - 100 WATT
- 384 GEN 2.5KW ONAN-MICROLITE
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

FIRST USED	
16 100-SER	
DO NOT SCALE DRAWING	
TITLE: CHASSIS ELECTRICAL BOX ASM	
SHEET 2	PART NO 192359 REV
10-Jul-2015	

192359