

DETAIL AA

- 1B2 WTR HTR-10GAL/ELEC/LP/MTR/ID
- 1BT WATER HEATER, TANKLESS
- 154 FIREPLACE - BEDROOM
- 151 FIREPLACE-BEDROOM WITHOUT
- 14C FIREPLACE-ELECTRIC
- 14A FIREPLACE-ELECTRIC WITHOUT
- 32W GENERATOR-START,AUTO SYSTEM
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

WINNEBAGO COPYRIGHT 2016 WINNEBAGO INDUSTRIES, INC.	
DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS
DFFR:	
UNSPECIFIED TOLERANCES:	MATERIAL:
WHOLE DIM (X) :	3
ONE-PLACE (X.X) :	1.5
TWO-PLACE (X.XX) :	0.50
ANGLE :	1°
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	WEIGHT: (LBS) FIRST USED:
DESCRIPTION: LOAD CENTER/ATS ASM	
SHEET: 1 OF 2	ITEM/PART NO: 000012399 / 31147101000
REF: 1 19-Dec-2016	


- 6 BLACKEN OUT WTR HTR WITH OPTION 1BT
- 5 BLACKEN OUT FIREPLACE WITH OPTION 151
- 4 BLACKEN OUT FIREPLACE WITH OPTION 14A
- 3 TRANSFORMER NEUTRAL TO MAIN NEUTRAL BAR, GROUND TO GROUND BAR, & HOT (BLK) TO L1 SCREW ON EMS BOARD.

2. REMOVE 400MM FROM OUTER JACKET ON ALL WIRES ENTERING LOAD CENTER AND TRIM INDIVIDUAL CONDUCTORS AS REQUIRED TO MAKE INTERNAL CONNECTIONS
1. ALL GROUND WIRES TO BE COVERED WITH TUBING 8041-02-000.

NOTES:





FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

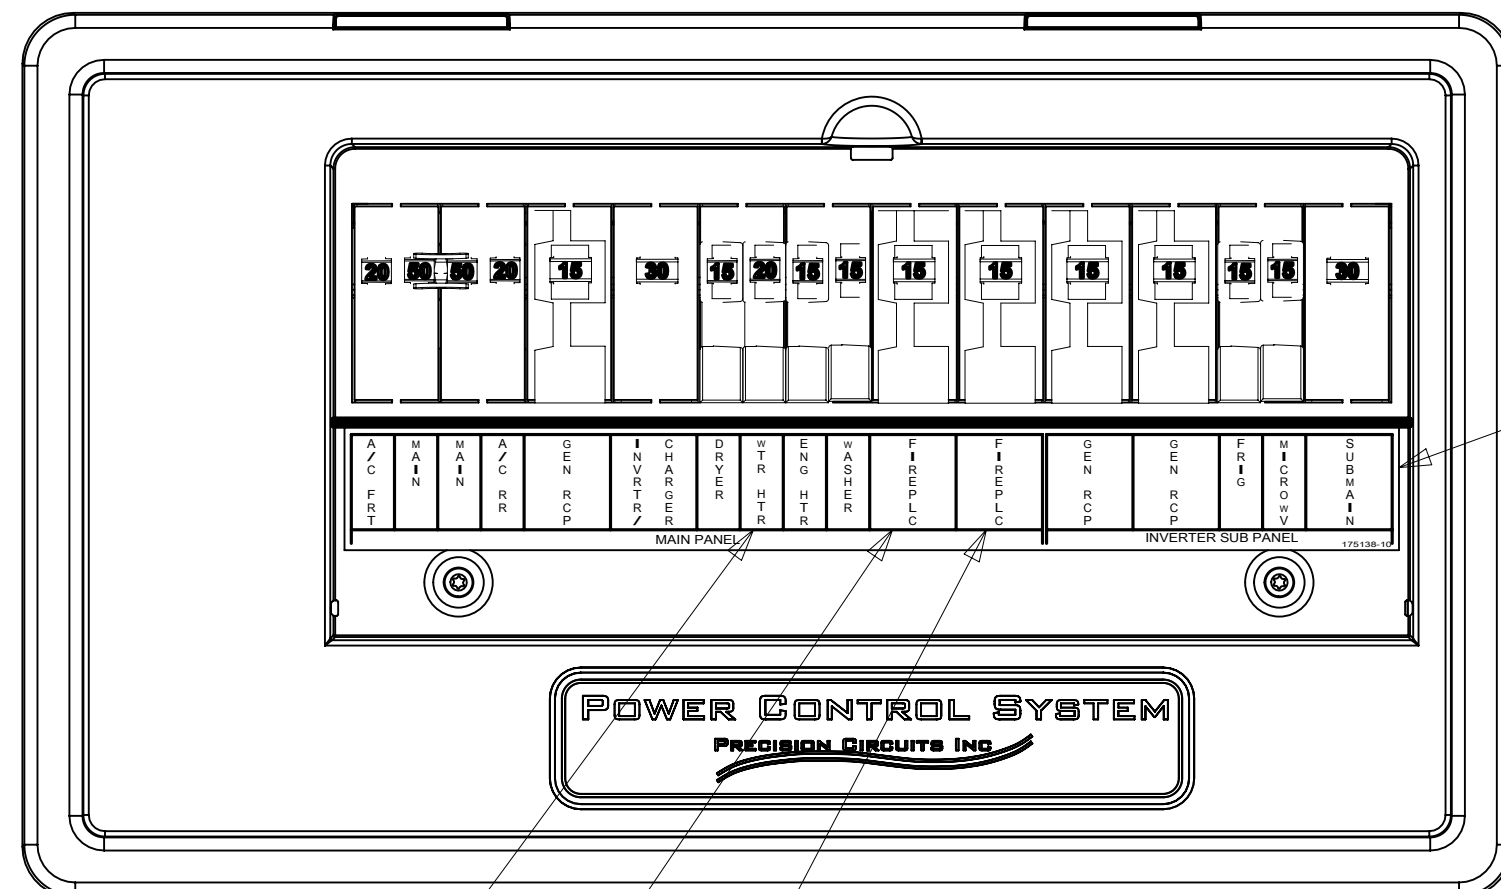

LABEL 175138-10-CHT
COVER (SUPPLIED WITH LOAD CENTER)

8 7 6 5 4 3 2 1

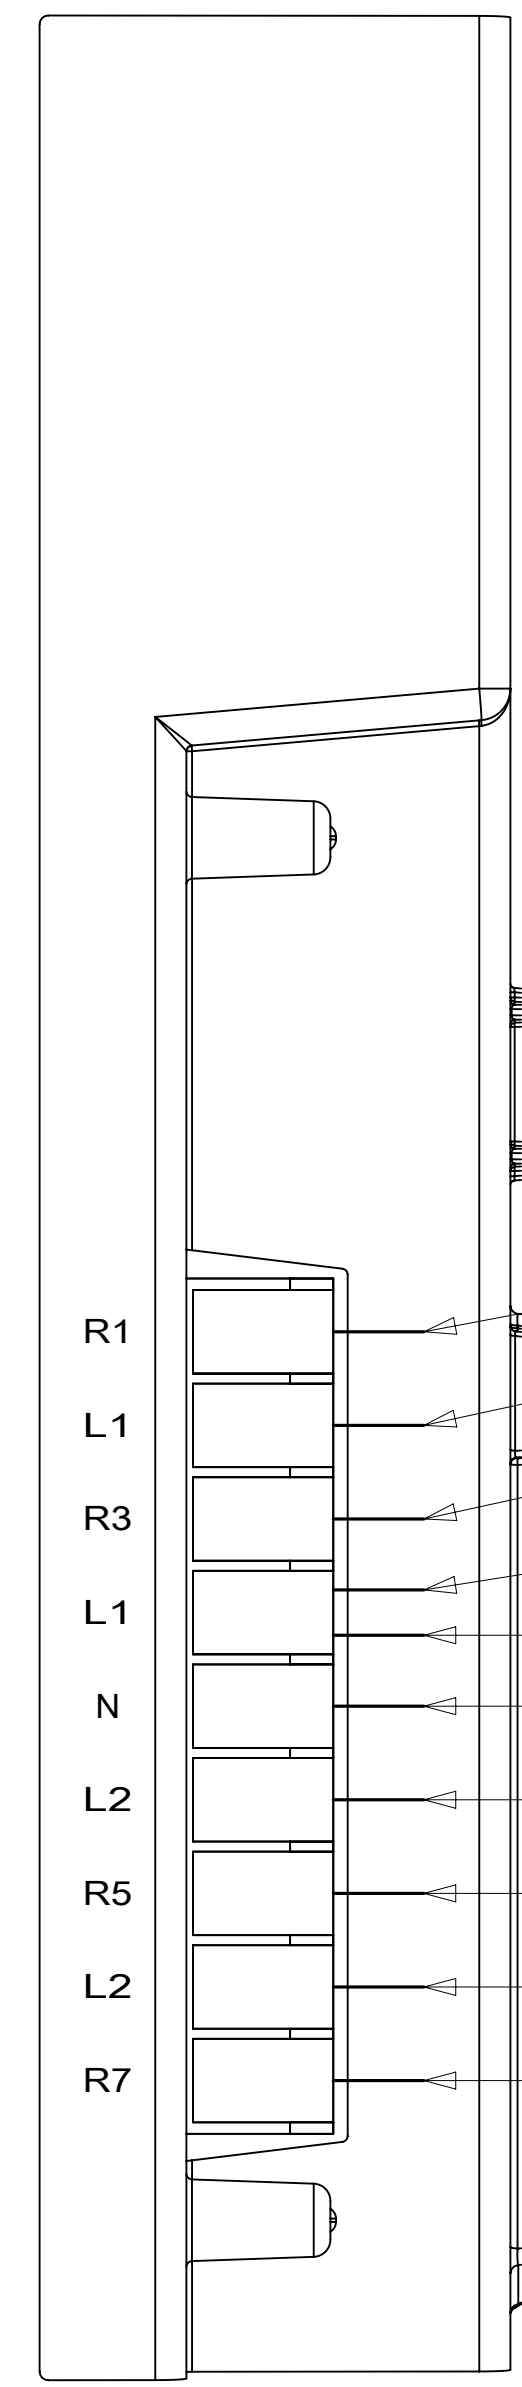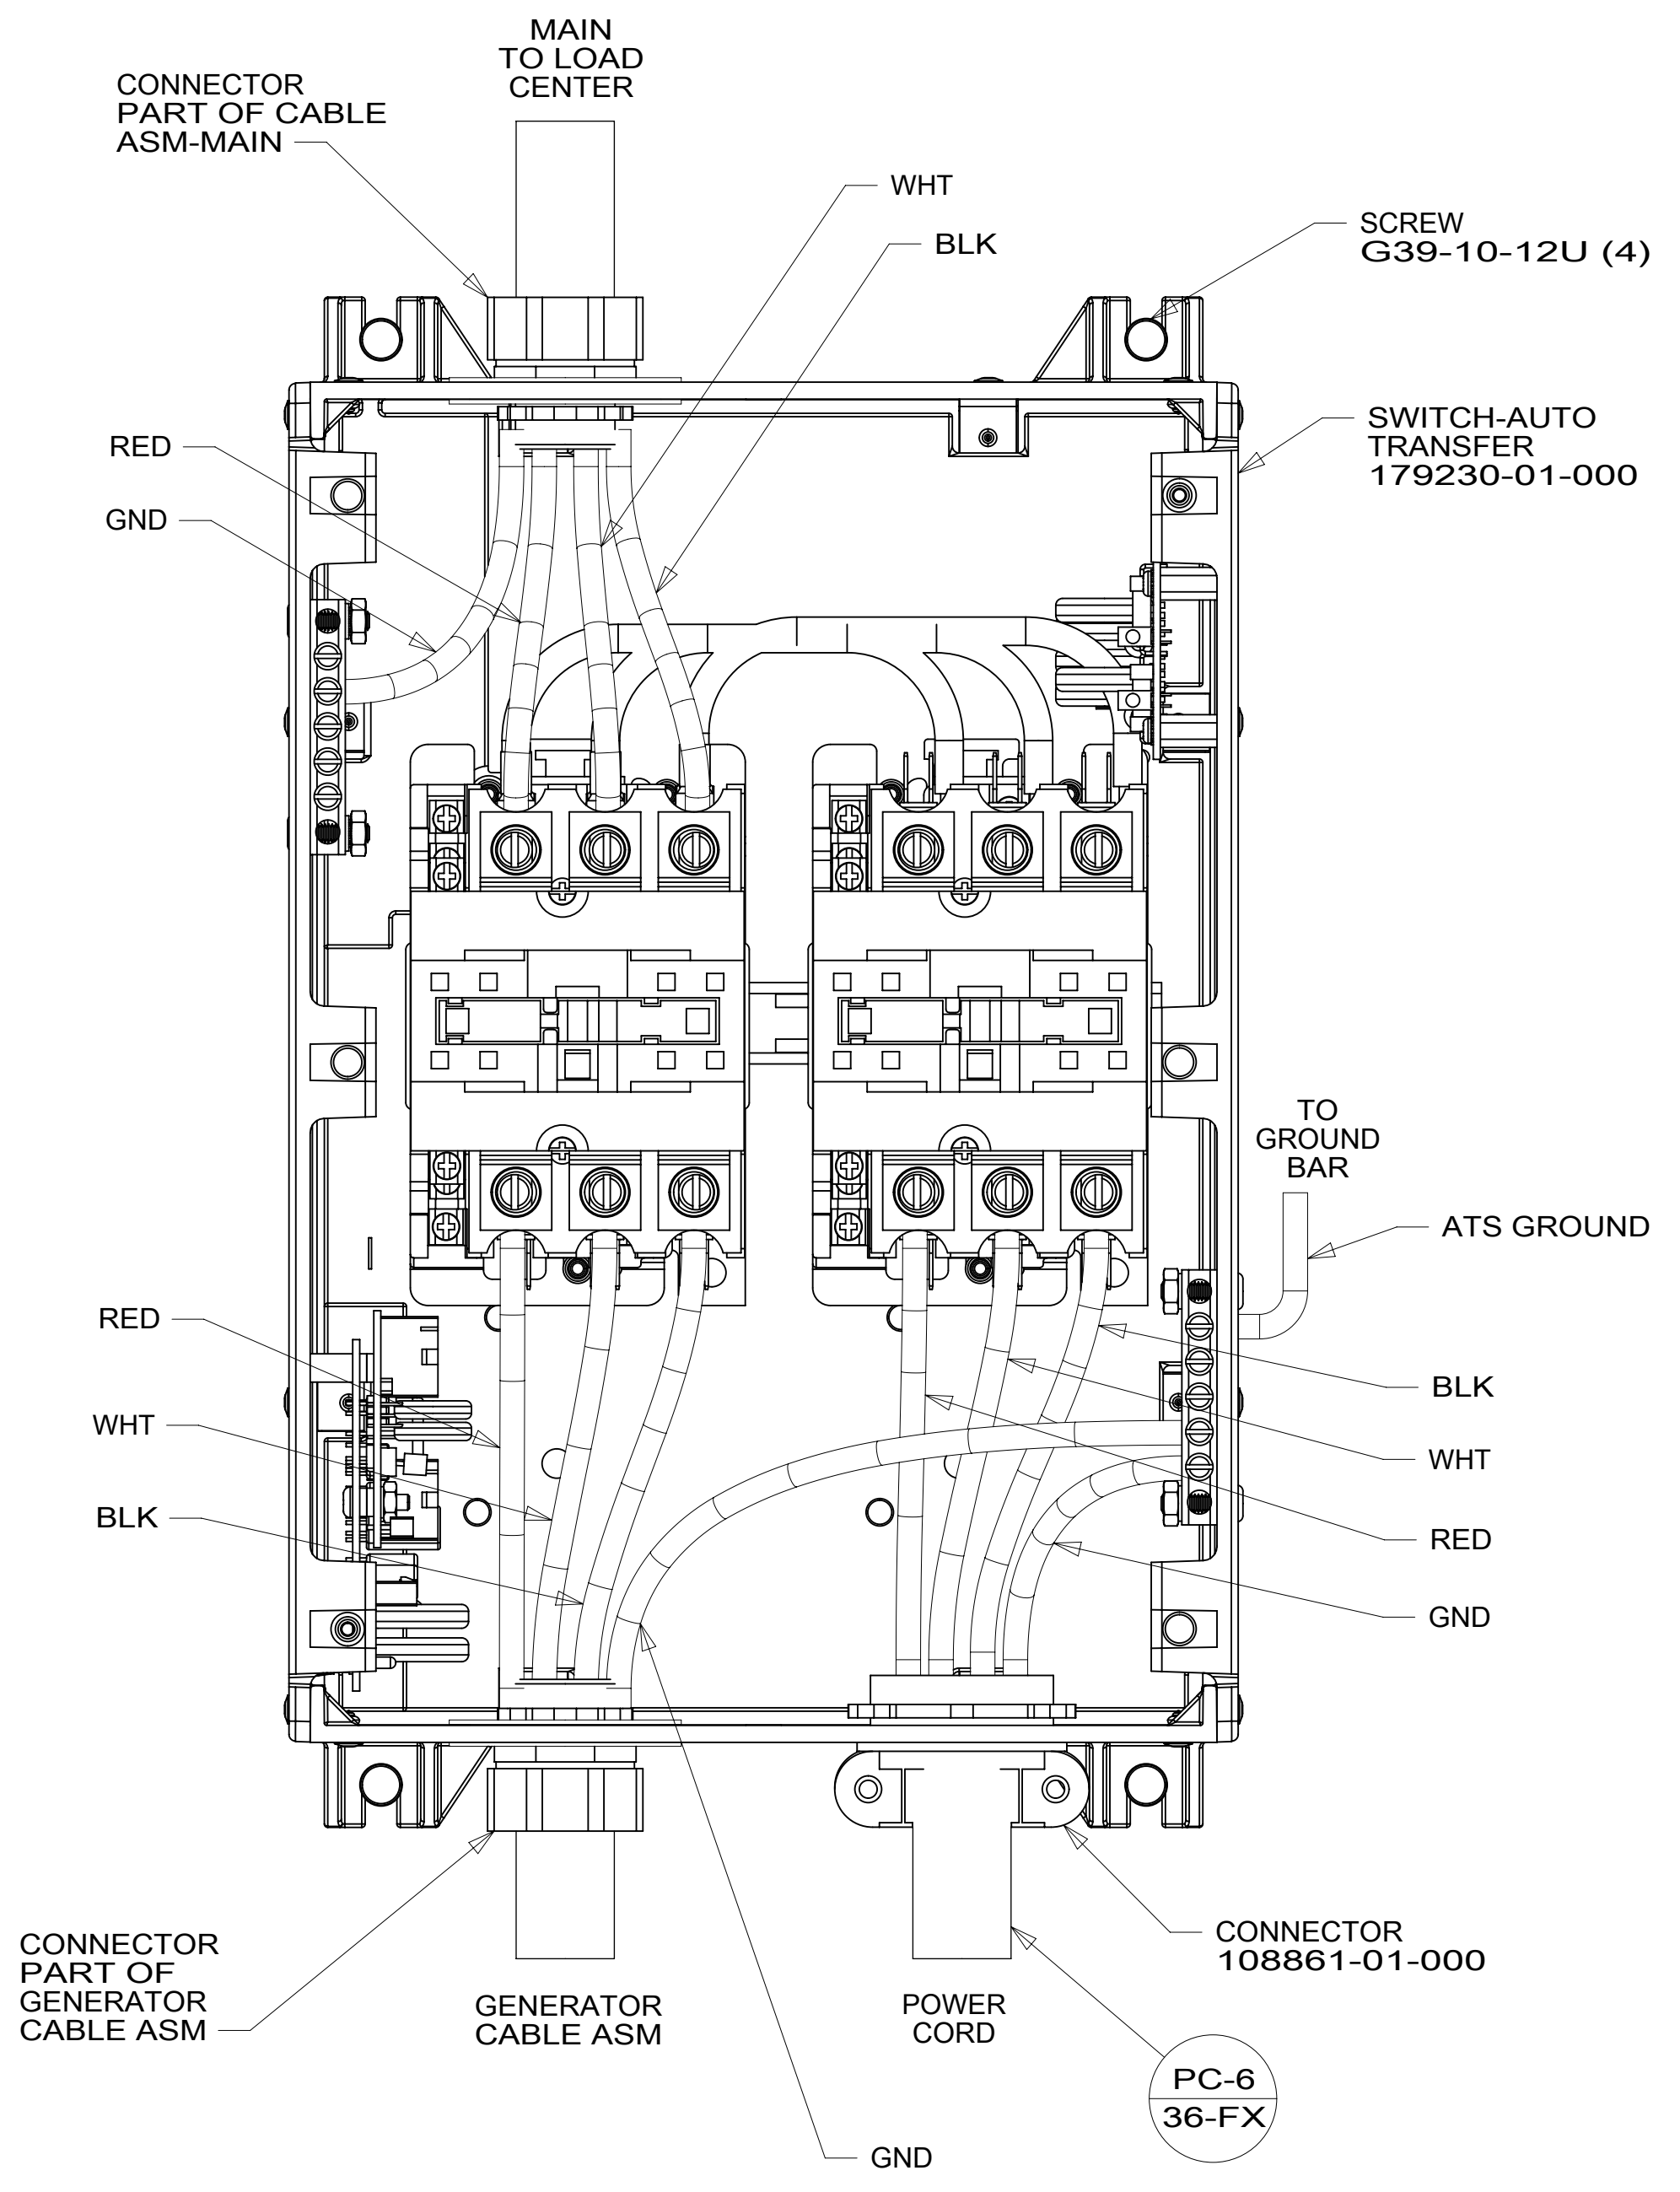

- WHT WIRE TO WATER HTR 1B2
- FROM WHT BREAKER 1B2
- GLD2 WIRE TO DRYER
- TO TRANSFORMER 32W
- FROM GLD2 BREAKER
- TO NEUTRAL BAR
- FROM GLD BREAKER
- GLD WIRE TO WASHER
- FROM ORG BREAKER
- ORG WIRE TO ENGINE HEATER SWITCH

DETAIL BA

- 1B2 WTR HTR-10GAL/ELEC/LP/MTRAIID
- 32W GENERATOR-START,AUTO SYSTEM
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

DESCRIPTION:		1B1 265	
LOAD CENTER/ATS ASM			
SHEET:	ITEM/PART NO.:	REV:	
2 OF 2	000012399 / 31147101000		

8 7 6 5 4 3 2 1 19-Dec-2016