

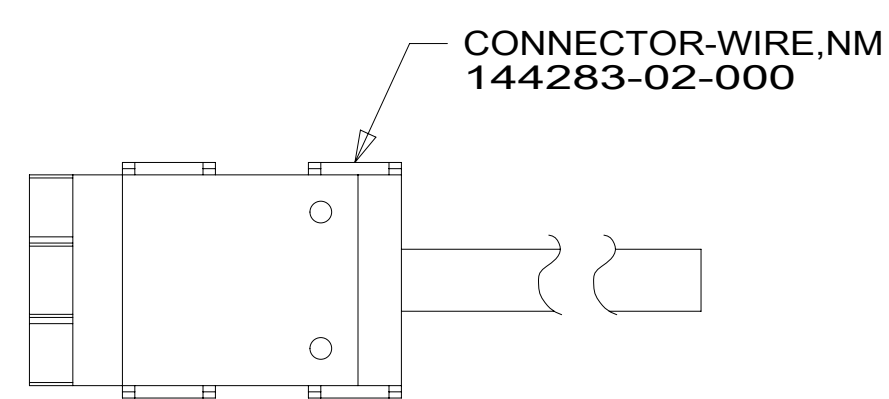


RED	1B1	136135-07-040	
	265	136136-07-040	
YEL	1B1	136131-05-018	2
	265	136134-05-018	2
BLK	1B1	136131-06-018	2
	265	136134-06-018	2
BRN	1B1	136131-03-045	
	265	136134-03-045	
BLU	1B1	136131-02-160	
	265	136134-02-160	
THROW IN WIRE #1	1B1	136131-05-015	2
	265	136134-05-015	2
MAIN	1B1	136137-01-063	
	265	136138-01-063	
GROUND MAIN		136145-06-035	

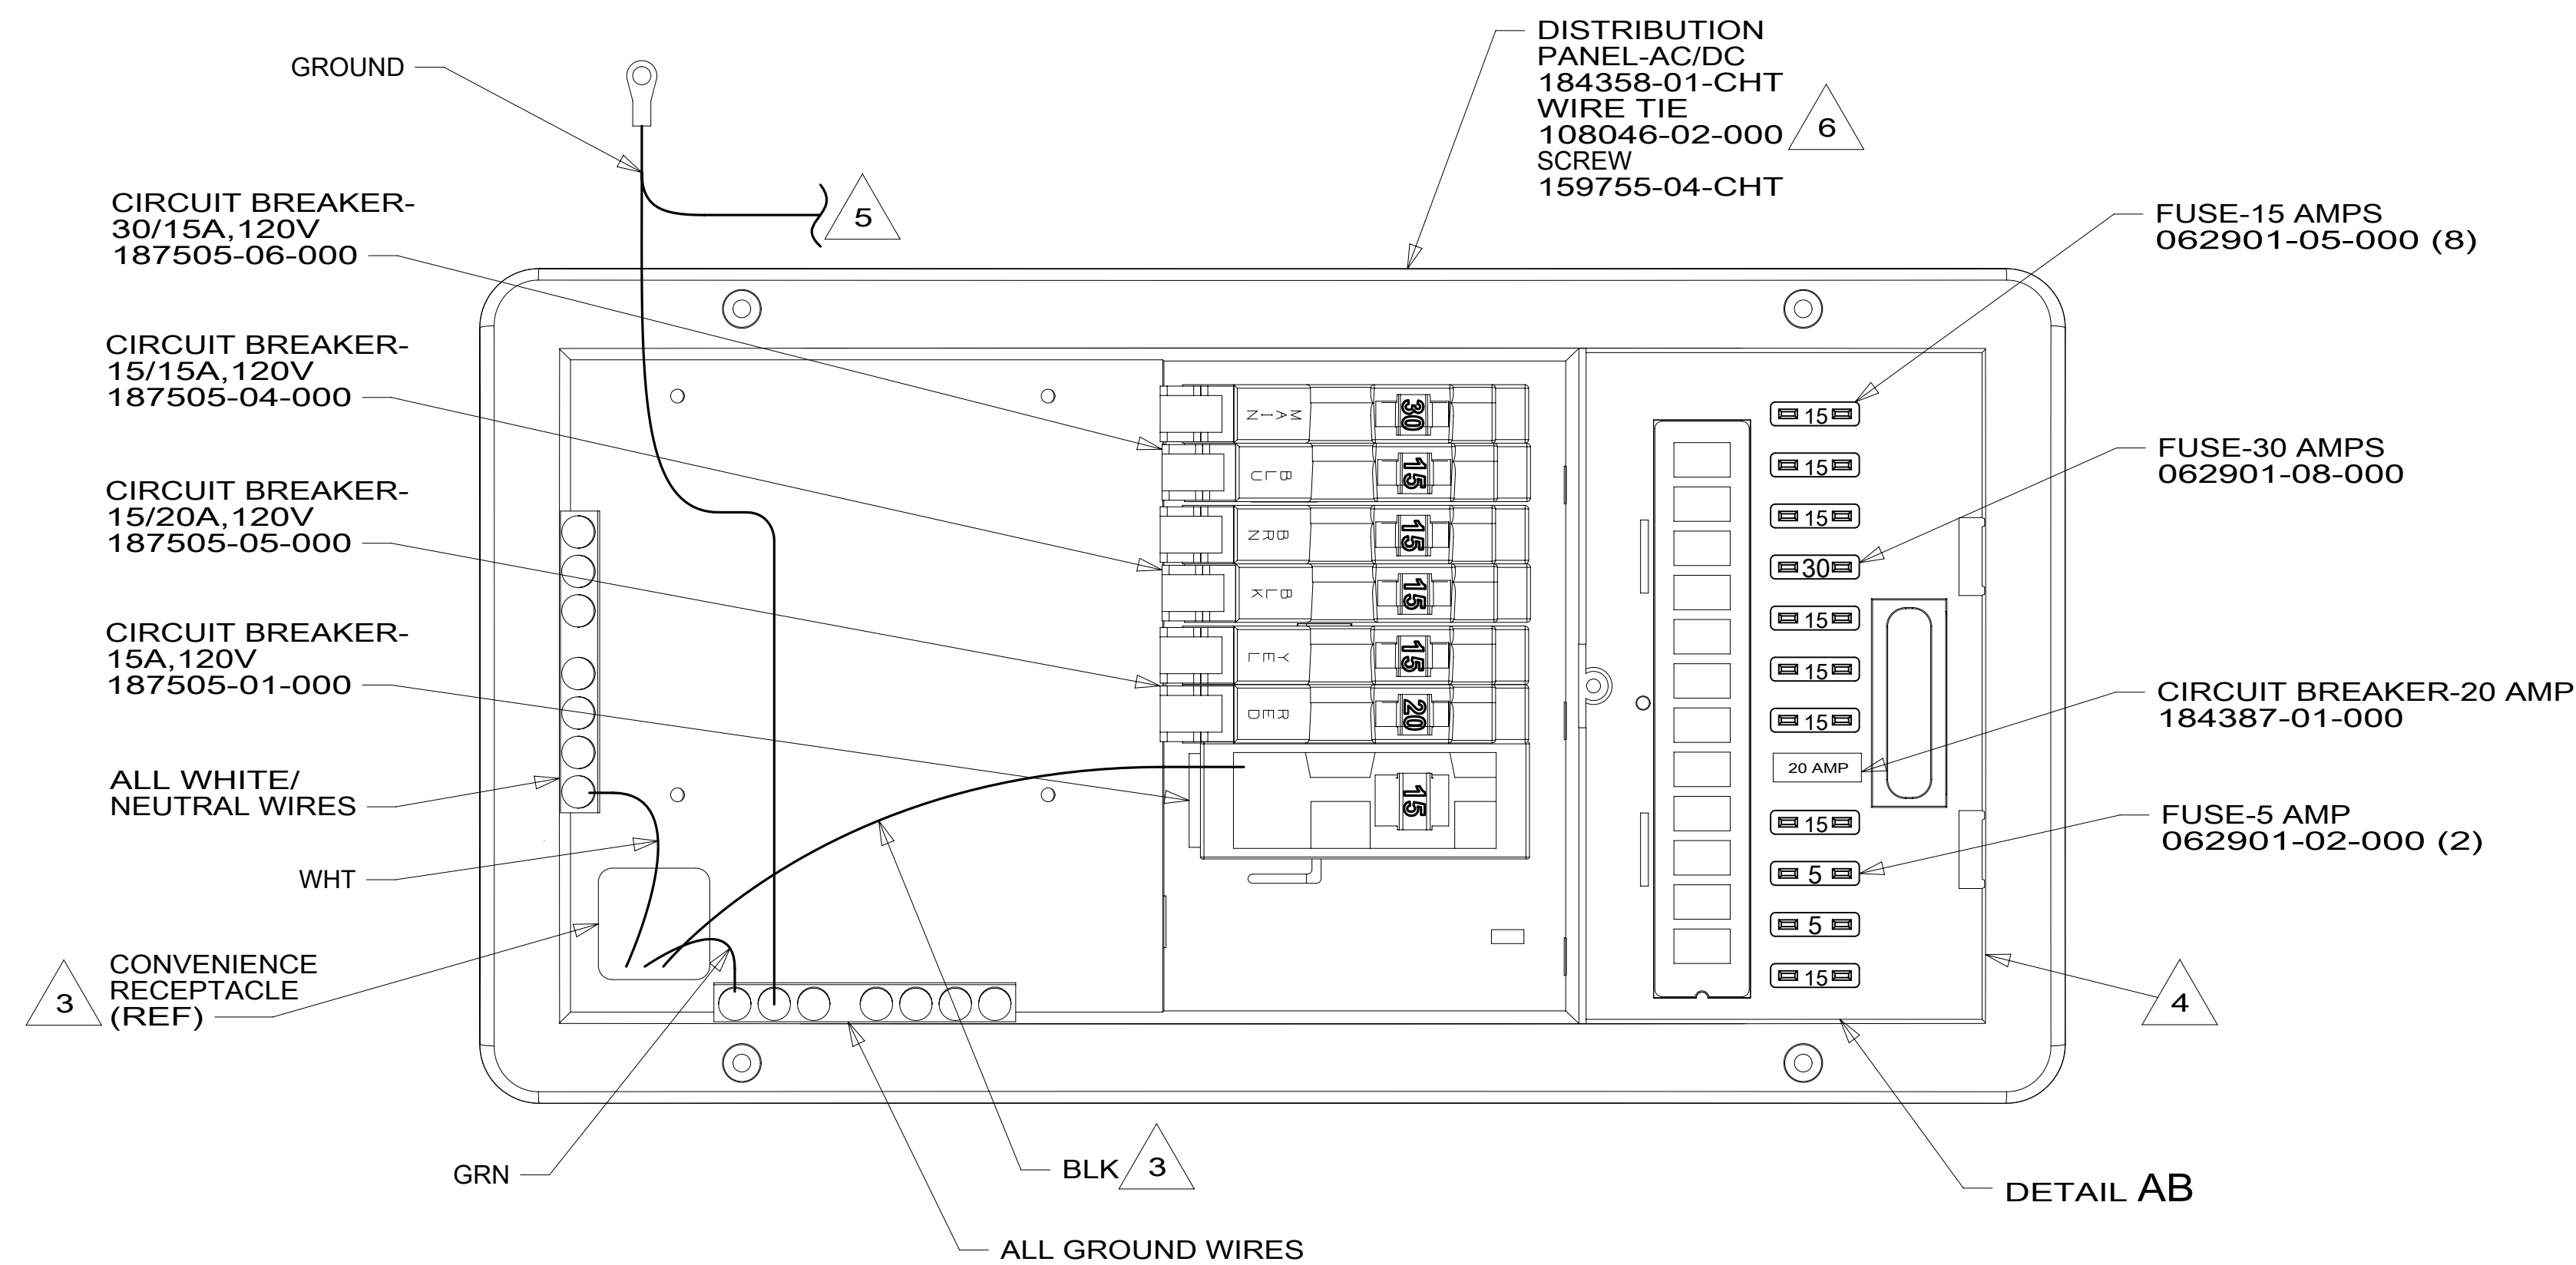

DETAIL AA

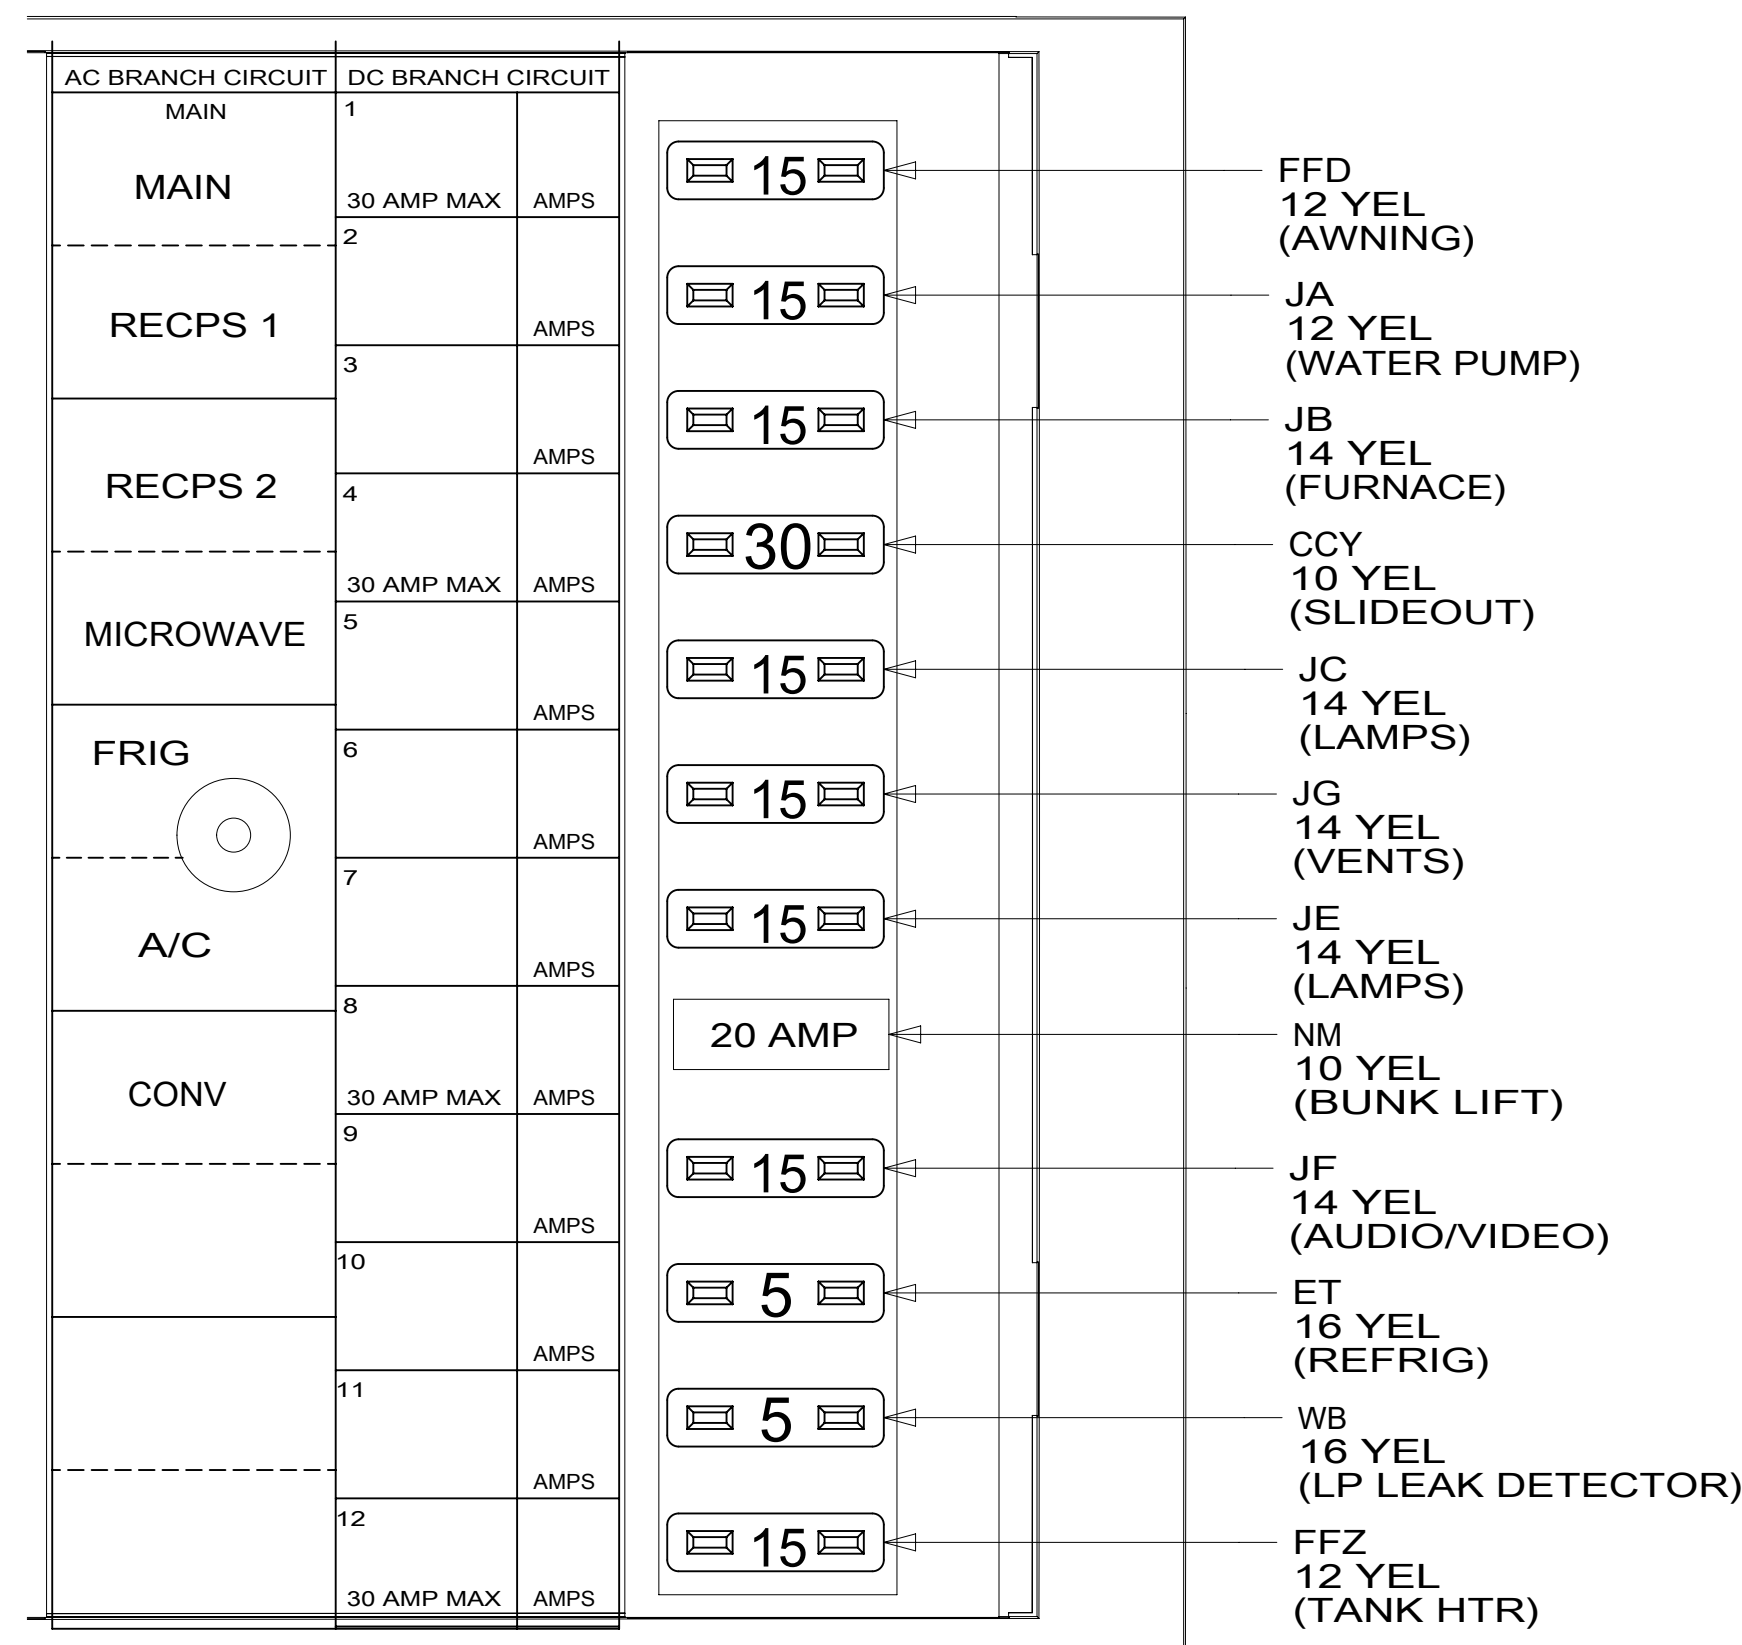

DETAIL AB

- 6 ATTACH TO UNUSED SCREW HOLE ON BACK SIDE OF PANEL TO SECURE WIRES.
- 5 CONNECT ONE GROUND WIRE TO GROUND BAR INSIDE DISTRIBUTION PANEL, CONNECT ONE GROUND WIRE TO DC GROUND BAR ON BACK SIDE OF DISTRIBUTION PANEL.
- 4 SEE WIRING INSTL-BODY, 12V FOR ADDITIONAL INFORMATION.
- 3 CONNECT BLACK WIRE FROM CONVENIENCE RECEPTACLE TO DEDICATED CIRCUIT BREAKER.
- 2 FOR CONNECTOR INSTALLATION SEE DETAIL AA.

NOTES:  
1. ALL GROUND WIRES TO BE COVERED WITH TUBING 8041-02-000.

- 33F GEN-3.5 KW ONAN DIESEL
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

1B1 265



DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS
DFFR:	
UNSPECIFIED TOLERANCES:	MATERIAL:
WHOLE DIM (X) : 3	
ONE-PLACE (X.X) : 1.5	
TWO-PLACE (X.XX) : 0.50	
ANGLE : 1°	

REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES

WEIGHT: (LBS) FIRST USED: 17 623D

DESCRIPTION: LOAD CENTER ASM

SHEET: 1 OF 1 ITEM/PART NO: 000031209 / 31691601000 REV

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000