


VIEW AA

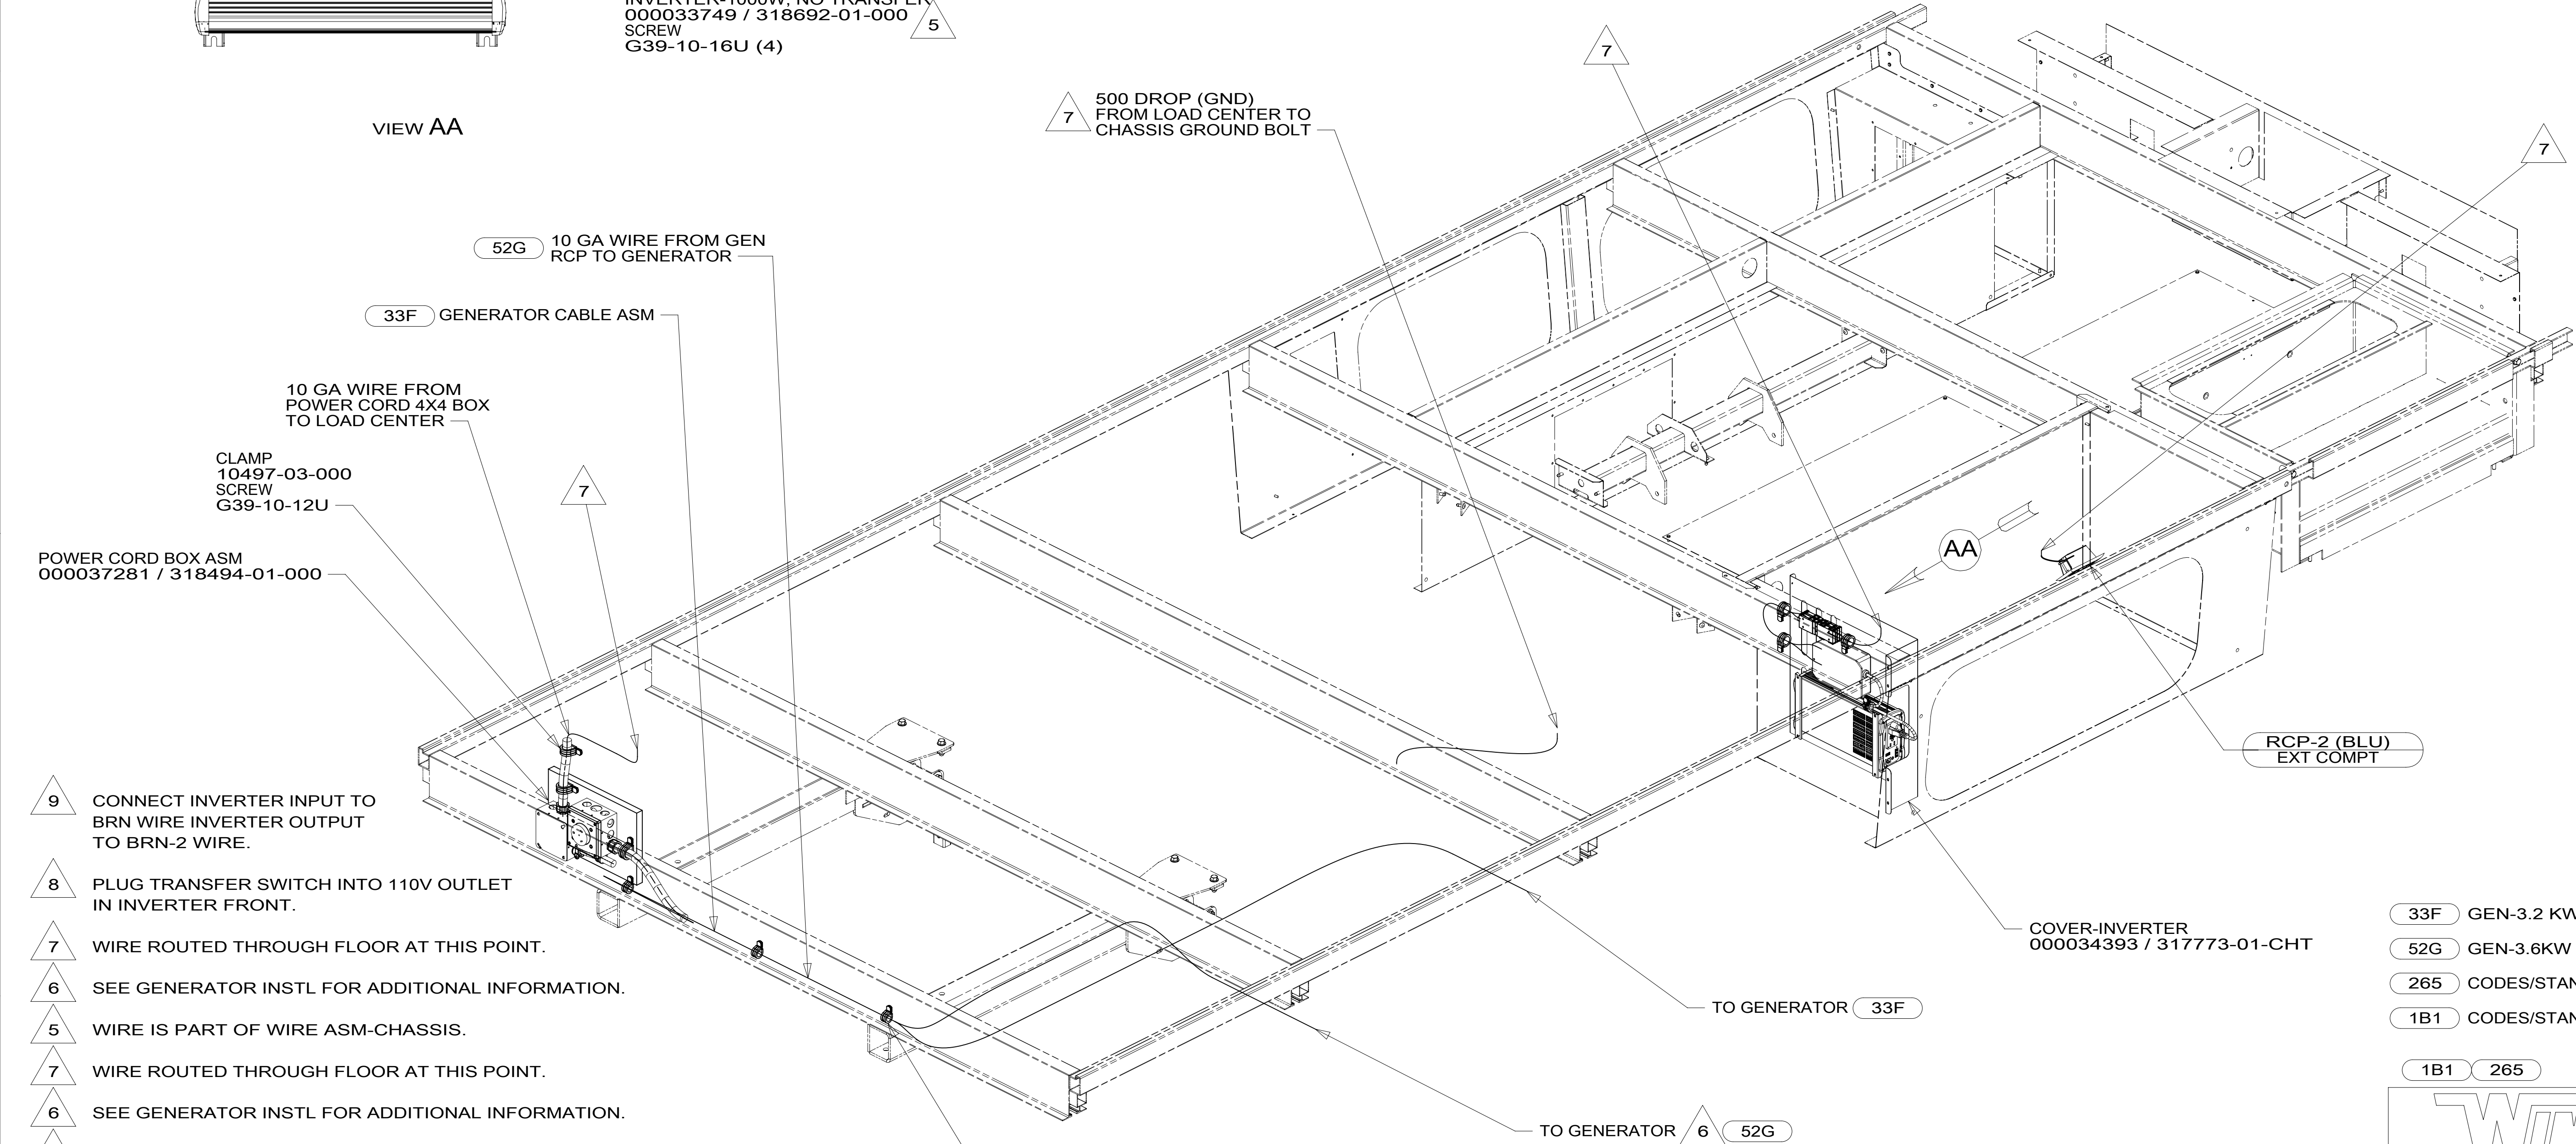

- 9 CONNECT INVERTER INPUT TO BRN WIRE INVERTER OUTPUT TO BRN-2 WIRE.
- 8 PLUG TRANSFER SWITCH INTO 110V OUTLET IN INVERTER FRONT.
- 7 WIRE ROUTED THROUGH FLOOR AT THIS POINT.
- 6 SEE GENERATOR INSTL FOR ADDITIONAL INFORMATION.
- 5 WIRE IS PART OF WIRE ASM-CHASSIS.
- 7 WIRE ROUTED THROUGH FLOOR AT THIS POINT.
- 6 SEE GENERATOR INSTL FOR ADDITIONAL INFORMATION.
- 5 CONNECT ORG CABLE TO RED(+) TERMINAL, BLK CABLE TO WHITE(-) TERMINAL, GROUND TO GROUND LUG.
- 4. SEE WIRING DIAGRAM-BODY, 110V FOR ADDITIONAL INFORMATION.
- 3. ALL GROUND WIRE TO BE COVERED WITH TUBING 8041-02-000.
- 2. ALL 110V WIRE TO BE CLAMPED WITH CLAMP 10497-05-000 WITHIN 200MM OF OUTLET BOXES, USE SCREW G67-10-12U.
- 1. AT MINIMUM ALL WIRES TO BE SUPPORTED AND SECURED PER CODE REQUIREMENTS. USE CLAMP 10495 OR 10497 OR WIRE TIE 8343 OR 108046 AND SCREW G67-XX-XXX OR G56-XX-XXX AS APPROPRIATE FOR INSTALLATION.

CLAMP 10497-10-000 (3) SCREW G39-08-12U (3) } 33F OR 52G

NOTES:

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

- 33F GEN-3.2 KW ONAN DIESEL
- 52G GEN-3.6KW ONAN LP MICROQUIET
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

WINNEBAGO
COPYRIGHT 2016 WINNEBAGO INDUSTRIES, INC.

DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS
DFFR:	MATERIAL:
UNSPECIFIED TOLERANCES:	WEIGHT: (LBS)
WHOLE DIM (X) : 3	FIRST USED: 18 524D
ONE-PLACE (X.X) : 1.5	DESCRIPTION: WIRING INSTL-BODY, 110V
TWO-PLACE (X.XX) : 0.50	SHEET: 1 OF 5
ANGLE : 1°	ITEM/PART NO: 000033161 / 31758901000
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	REF: 1 31-May-2017

CLAMP
10495-01-000 (4)
SCREW
G67-10-12U (4)

SLIDEOUT
WIRE #1
(REF)

THROW IN WIRE #1
(REF)

RCP-B (BRN-2)
SLIDEOUT

BRACKET-110V
CONNECTOR.MOUNT
155223-08-CHT
SCREW
G67-10-08U (2)

BRACKET-110V
CONNECTOR.MOUNT
155223-08-CHT
SCREW
G67-10-08U (2)

RCP-2 (BRN-2)
DINETTE

DETAIL BA

110V CONNECTIONS
DETAIL BA

RCP-B (BRN-2)
SLIDEOUT

THROW IN WIRE #1

THROW IN WIRE #2

SLIDEOUT WIRE #1

RECEPTACLE (BED.FRONT)
000025877/315435-01-CHT
BOX
133070-01-000
SCREW
G13-07-12U (4)
CONNECTOR
8313-01-000
TUBING-VINYL
8041-02-000 (300MM) 6
WIRE-BONDING
133678-01-000

RECEPTACLE (BED.REAR)
000025877/315435-01-CHT
BOX
133070-01-000
SCREW
G13-07-12U (4)
CONNECTOR
8313-01-000
TUBING-VINYL
8041-02-000 (300MM) 6
WIRE-BONDING
133678-01-000

110V CONNECTIONS
DETAIL BA

TO RIGHT SIDE


- NOTES:
- 6 APPLY TO BARE GROUND WIRES.
 - 5 WIRE ROUTED THROUGH FLOOR AT THIS POINT.
 - 4 WIRE IN SIDEWALL.
 - 3. ALL GROUND WIRE TO BE COVERED WITH TUBING 8041-02-000.
 - 2. ALL 110V WIRE TO BE CLAMPED WITH CLAMP 10495-05-000 WITHIN 200MM OF OUTLET BOXES, USE SCREW G67-10-12U.
 - 1. AT MINIMUM ALL WIRES TO BE SUPPORTED AND SECURED PER CODE REQUIREMENTS. USE CLAMP 10495 OR 10497 OR WIRE TIE 8343 OR 108046 AND SCREW G67-XX-XXX OR G56-XX-XXX AS APPROPRIATE FOR INSTALLATION.

265 CODES/STANDARDS-CSA/CMVSS
1B1 CODES/STANDARDS USA

FOR ELECTRICAL
TORQUE
SPECIFICATIONS
SEE DWG NO.
128783-01-000

FOR ELECTRICAL
CALLOUTS
SEE DWG NO.
121339-01-000

DESCRIPTION:	
WIRING INSTL-BODY, 110V	
SHEET:	ITEM/PART NO. REV
2 OF 5	000033161 / 31758901000

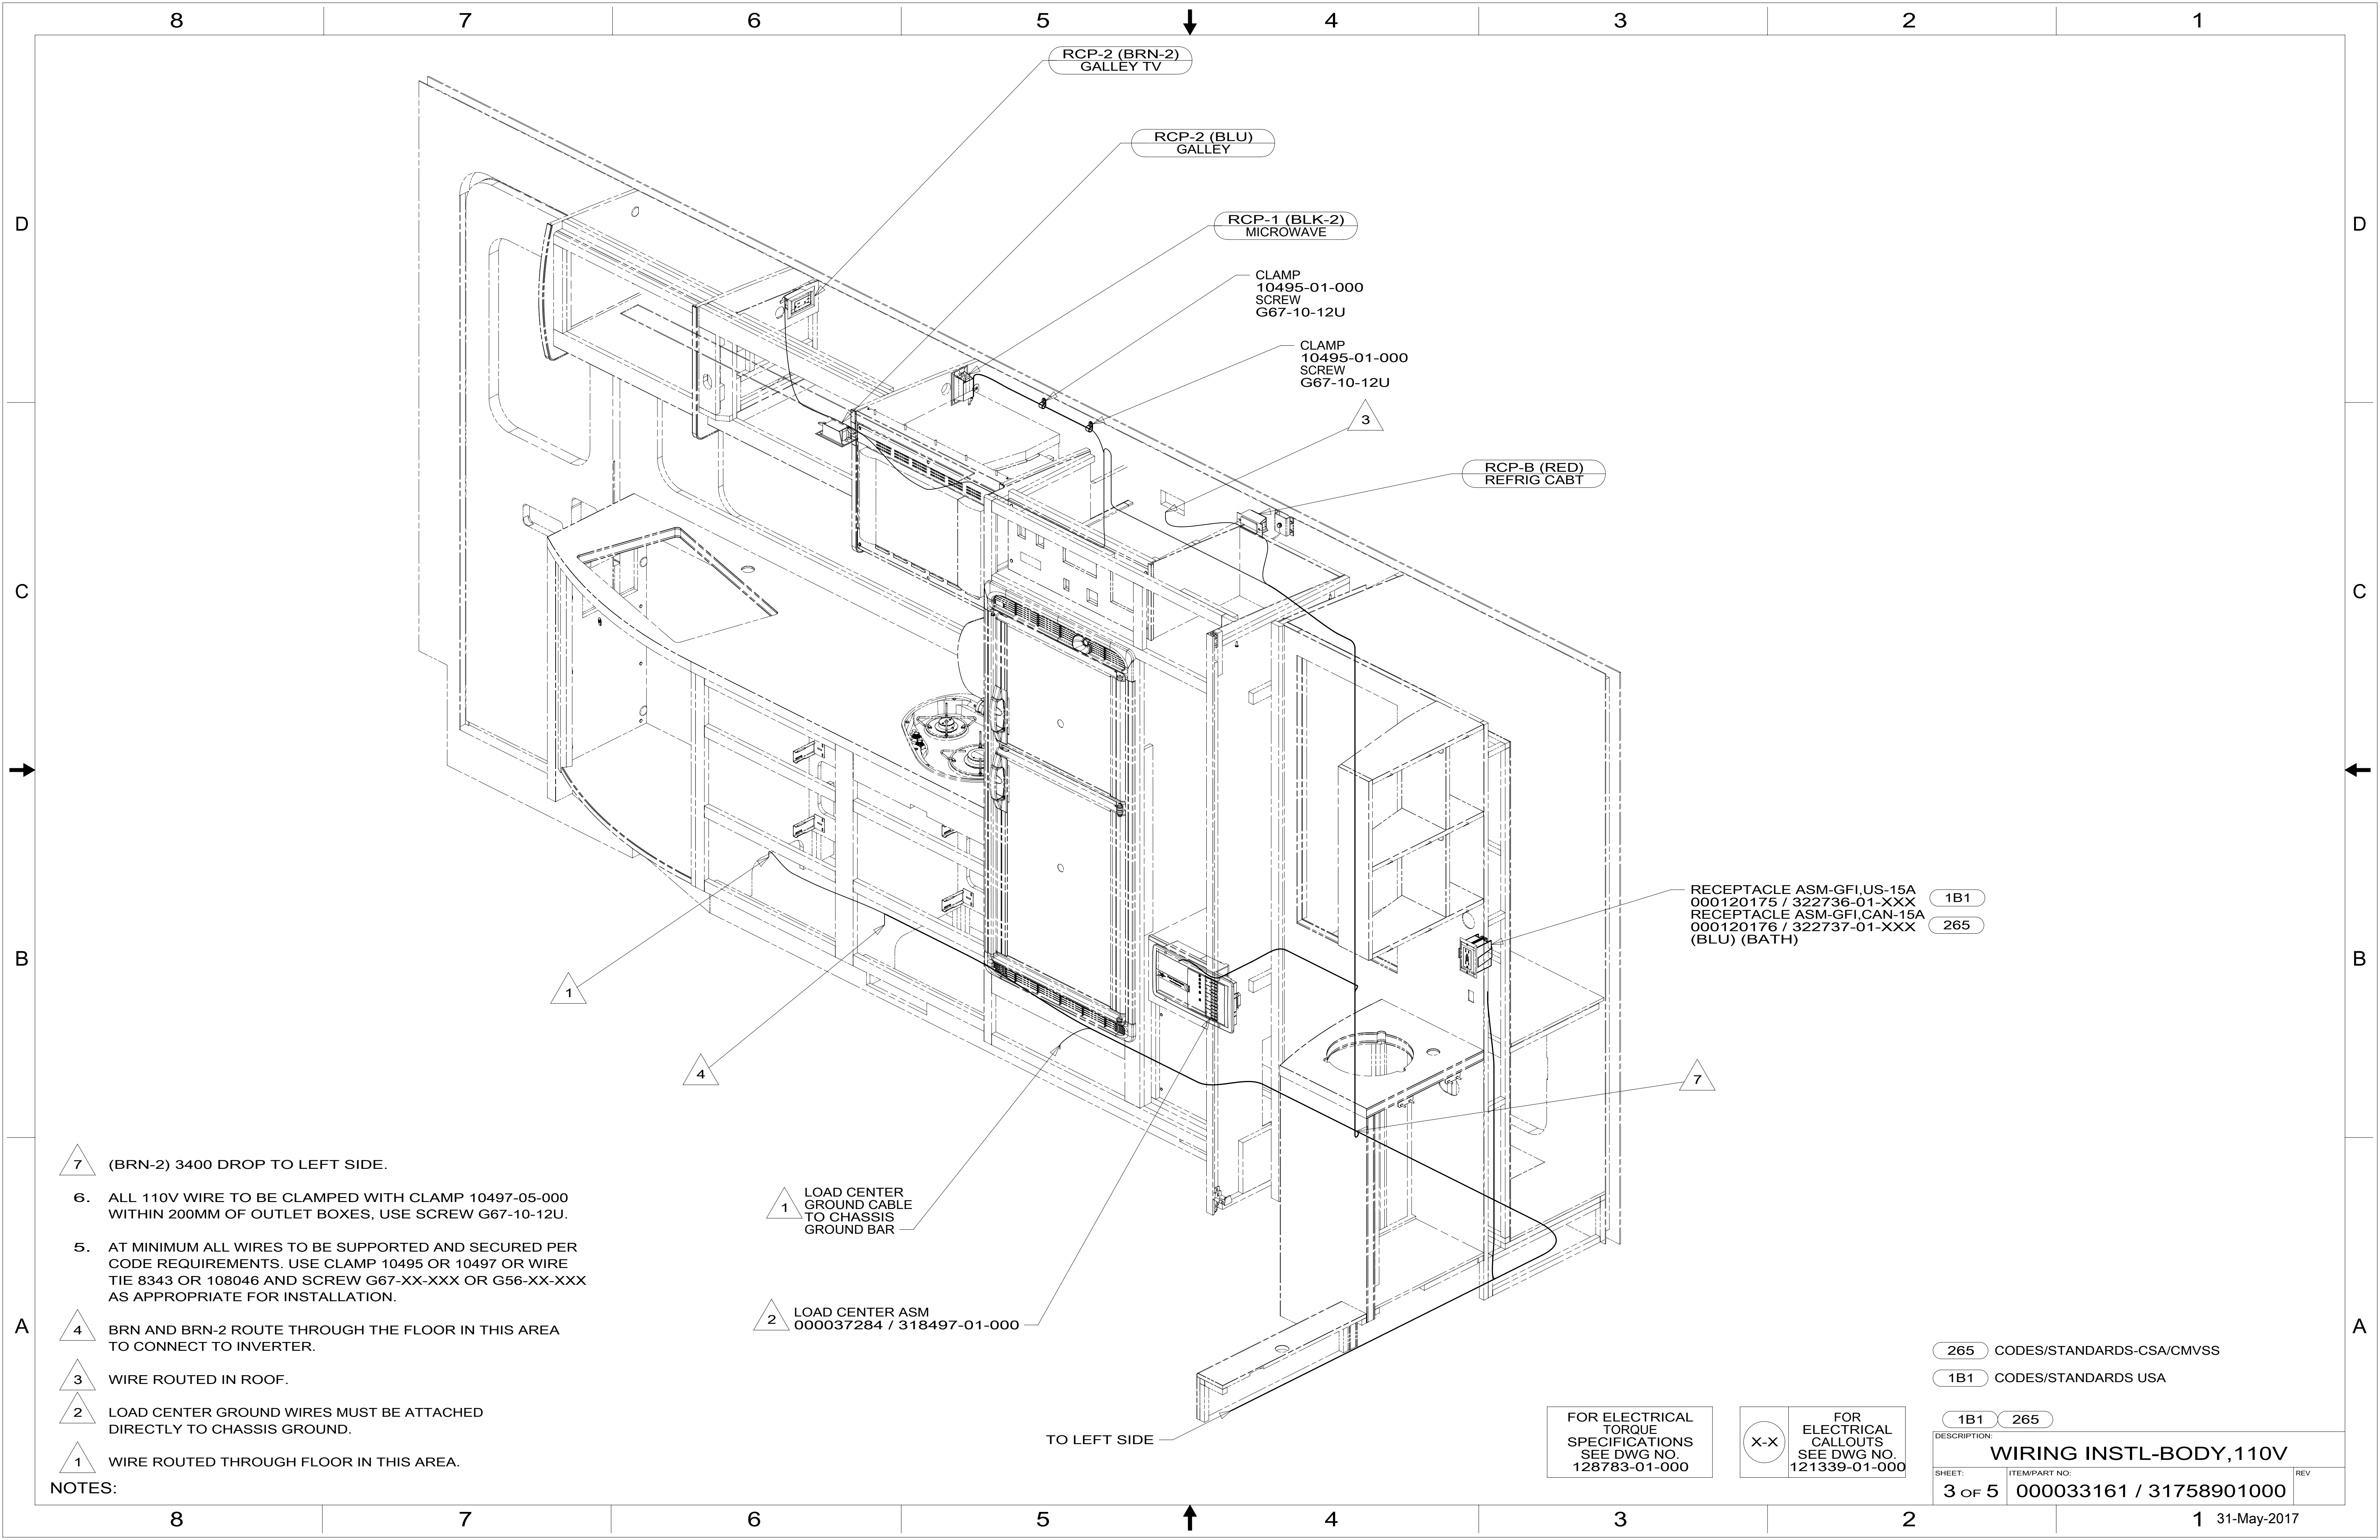

RCP-2 (BRN-2)
GALLEY TV

RCP-2 (BLU)
GALLEY

RCP-1 (BLK-2)
MICROWAVE

CLAMP
10495-01-000
SCREW
G67-10-12U

CLAMP
10495-01-000
SCREW
G67-10-12U

RCP-B (RED)
REFRIG CABT

RECEPTACLE ASM-GFI,US-15A
000120175 / 322736-01-XXX 1B1
RECEPTACLE ASM-GFI,CAN-15A
000120176 / 322737-01-XXX 265
(BLU) (BATH)

- NOTES:
- 7 (BRN-2) 3400 DROP TO LEFT SIDE.
 - 6. ALL 110V WIRE TO BE CLAMPED WITH CLAMP 10497-05-000 WITHIN 200MM OF OUTLET BOXES, USE SCREW G67-10-12U.
 - 5. AT MINIMUM ALL WIRES TO BE SUPPORTED AND SECURED PER CODE REQUIREMENTS. USE CLAMP 10495 OR 10497 OR WIRE TIE 8343 OR 108046 AND SCREW G67-XX-XXX OR G56-XX-XXX AS APPROPRIATE FOR INSTALLATION.
 - 4 BRN AND BRN-2 ROUTE THROUGH THE FLOOR IN THIS AREA TO CONNECT TO INVERTER.
 - 3 WIRE ROUTED IN ROOF.
 - 2 LOAD CENTER GROUND WIRES MUST BE ATTACHED DIRECTLY TO CHASSIS GROUND.
 - 1 WIRE ROUTED THROUGH FLOOR IN THIS AREA.

1 LOAD CENTER
GROUND CABLE
TO CHASSIS
GROUND BAR

2 LOAD CENTER ASM
000037284 / 318497-01-000


FOR ELECTRICAL
TORQUE
SPECIFICATIONS
SEE DWG NO.
128783-01-000

FOR
ELECTRICAL
CALLOUTS
SEE DWG NO.
121339-01-000


265 CODES/STANDARDS-CSA/CMVSS
1B1 CODES/STANDARDS USA

DESCRIPTION:	
WIRING INSTL-BODY, 110V	
SHEET:	ITEM/PART NO:
3 OF 5	000033161 / 31758901000
REV	


RED	1B1	136135-07-032	
	265	136136-07-032	
BLK	1B1	136131-06-044	
	265	136134-06-044	
BRN	1B1	136131-03-040	2
	265	136134-03-040	2
BRN-2	1B1	136131-19-164	3
	265	136134-19-164	3
BLU	1B1	136131-02-165	
	265	136134-02-165	
MAIN	1B1	136137-01-055	
	265	136138-01-055	
SLIDEOUT WIRE #1		136151-19-040	4 5
GENERATOR CABLE ASM	1B1	164957-02-044	33F
	265	164957-04-044	33F
GROUND		136145-02-036	
THROW IN WIRE #1	1B1	136131-19-006	2
	265	136134-19-006	2
THROW IN WIRE #2	1B1	136131-19-052	
	265	136134-19-052	

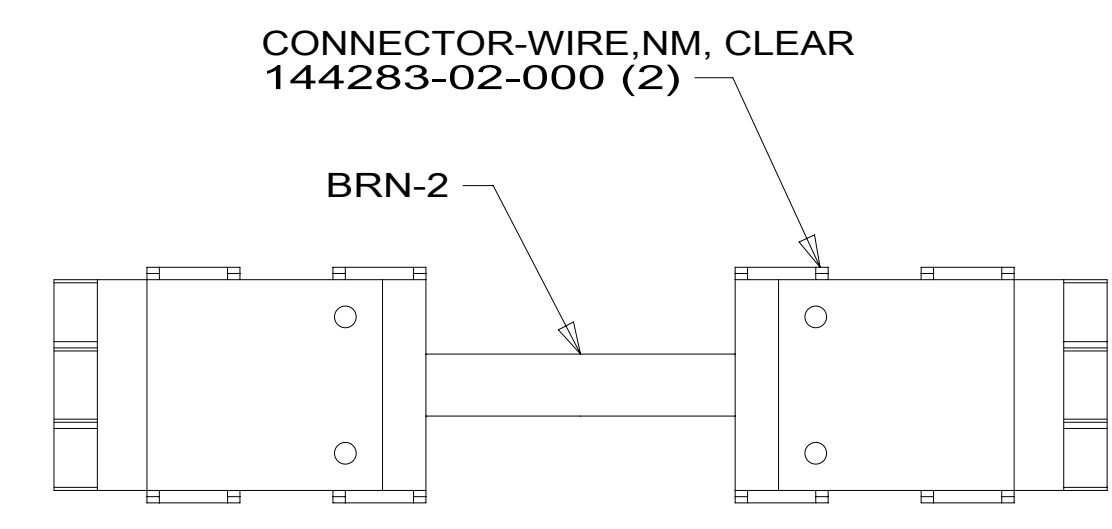

DETAIL DC

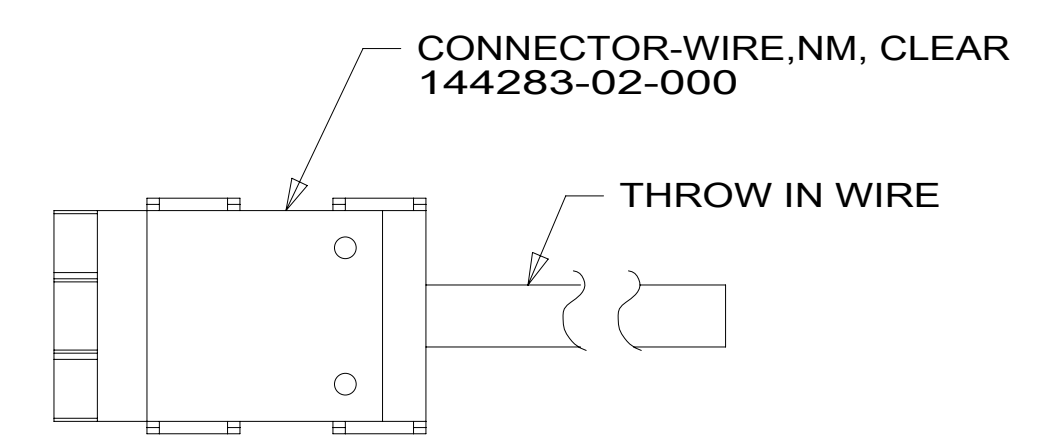

DETAIL DD

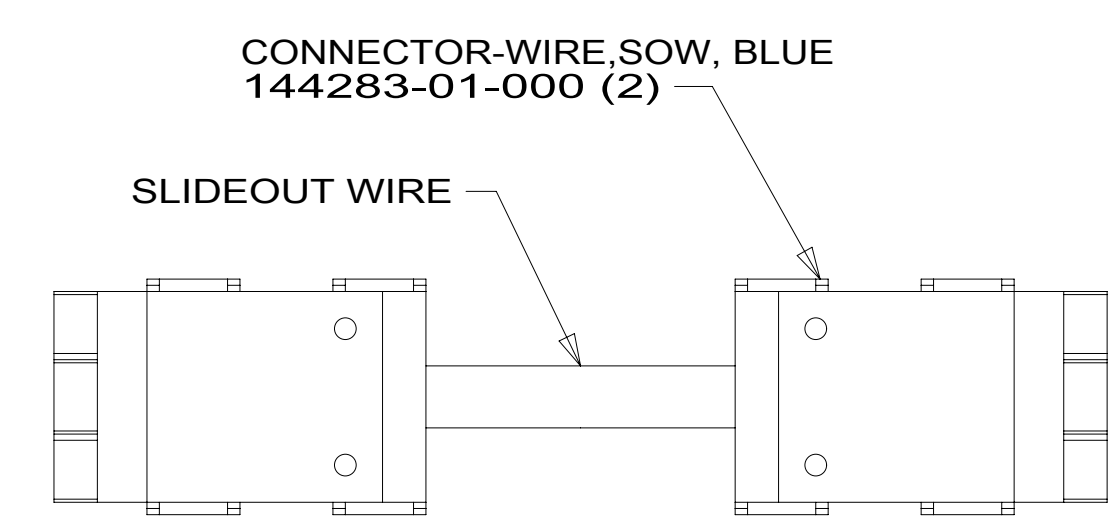

DETAIL DE

- 5 APPLY CONDUIT-CONVOLUTE 41953-05-000 OVER WIRE AND SECURE BOTH ENDS OF TUBING TO WIRE WITH TAPE 8363-01-000.
- 4 FOR CONNECTOR INSTALLATION SEE DETAIL DE.
- 3 FOR CONNECTOR INSTALLATION SEE DETAIL DC.
- 2 FOR CONNECTOR INSTALLATION SEE DETAIL DD.

1. ALL GROUND WIRES TO BE COVERED WITH TUBING 8041-02-000.


NOTES:

- 33F GEN-3.2 KW ONAN DIESEL
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

1B1	265	
DESCRIPTION: WIRING INSTL-BODY, 110V		
SHEET: 4 OF 5	ITEM/PART NO: 000033161 / 31758901000	REV

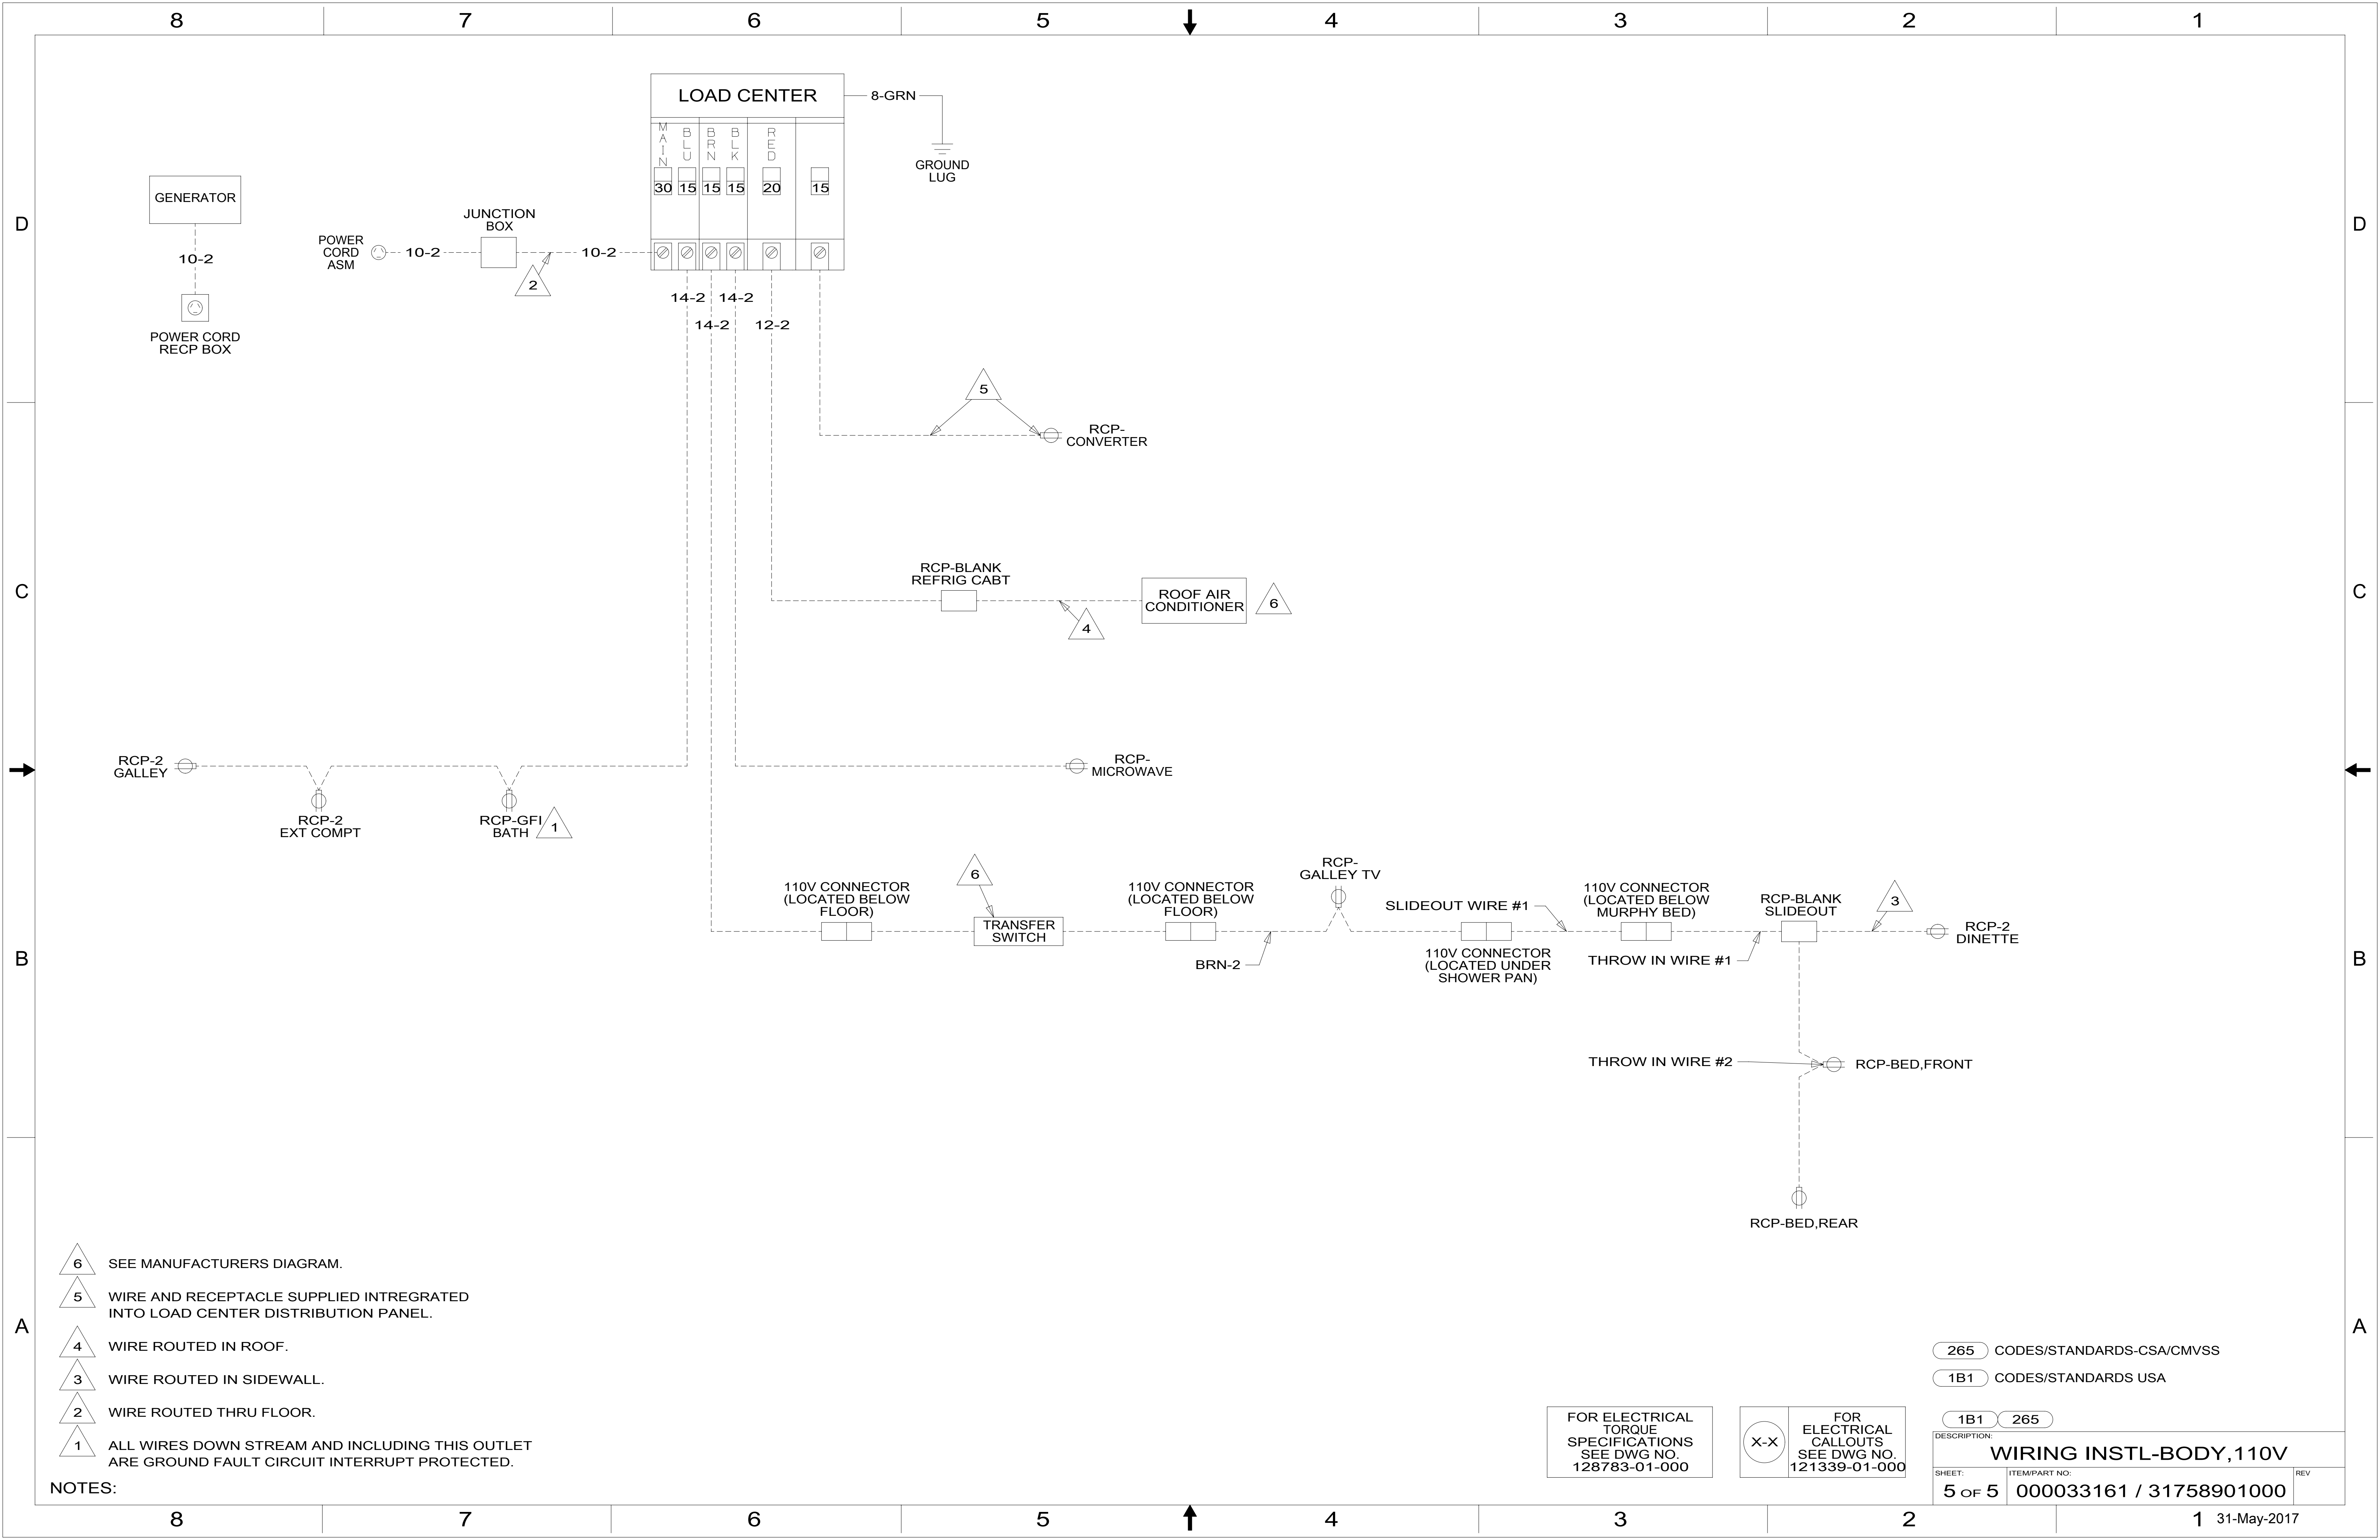

- NOTES:
- 6 SEE MANUFACTURERS DIAGRAM.
 - 5 WIRE AND RECEPTACLE SUPPLIED INTREGATED INTO LOAD CENTER DISTRIBUTION PANEL.
 - 4 WIRE ROUTED IN ROOF.
 - 3 WIRE ROUTED IN SIDEWALL.
 - 2 WIRE ROUTED THRU FLOOR.
 - 1 ALL WIRES DOWN STREAM AND INCLUDING THIS OUTLET ARE GROUND FAULT CIRCUIT INTERRUPT PROTECTED.

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

265 CODES/STANDARDS-CSA/CMVSS
 1B1 CODES/STANDARDS USA

DESCRIPTION:		1B1 265	
WIRING INSTL-BODY, 110V			
SHEET:	ITEM/PART NO.:	REV	
5 OF 5	000033161 / 31758901000		