


8 7 6 5 4 3 2 1

D
C
B
A

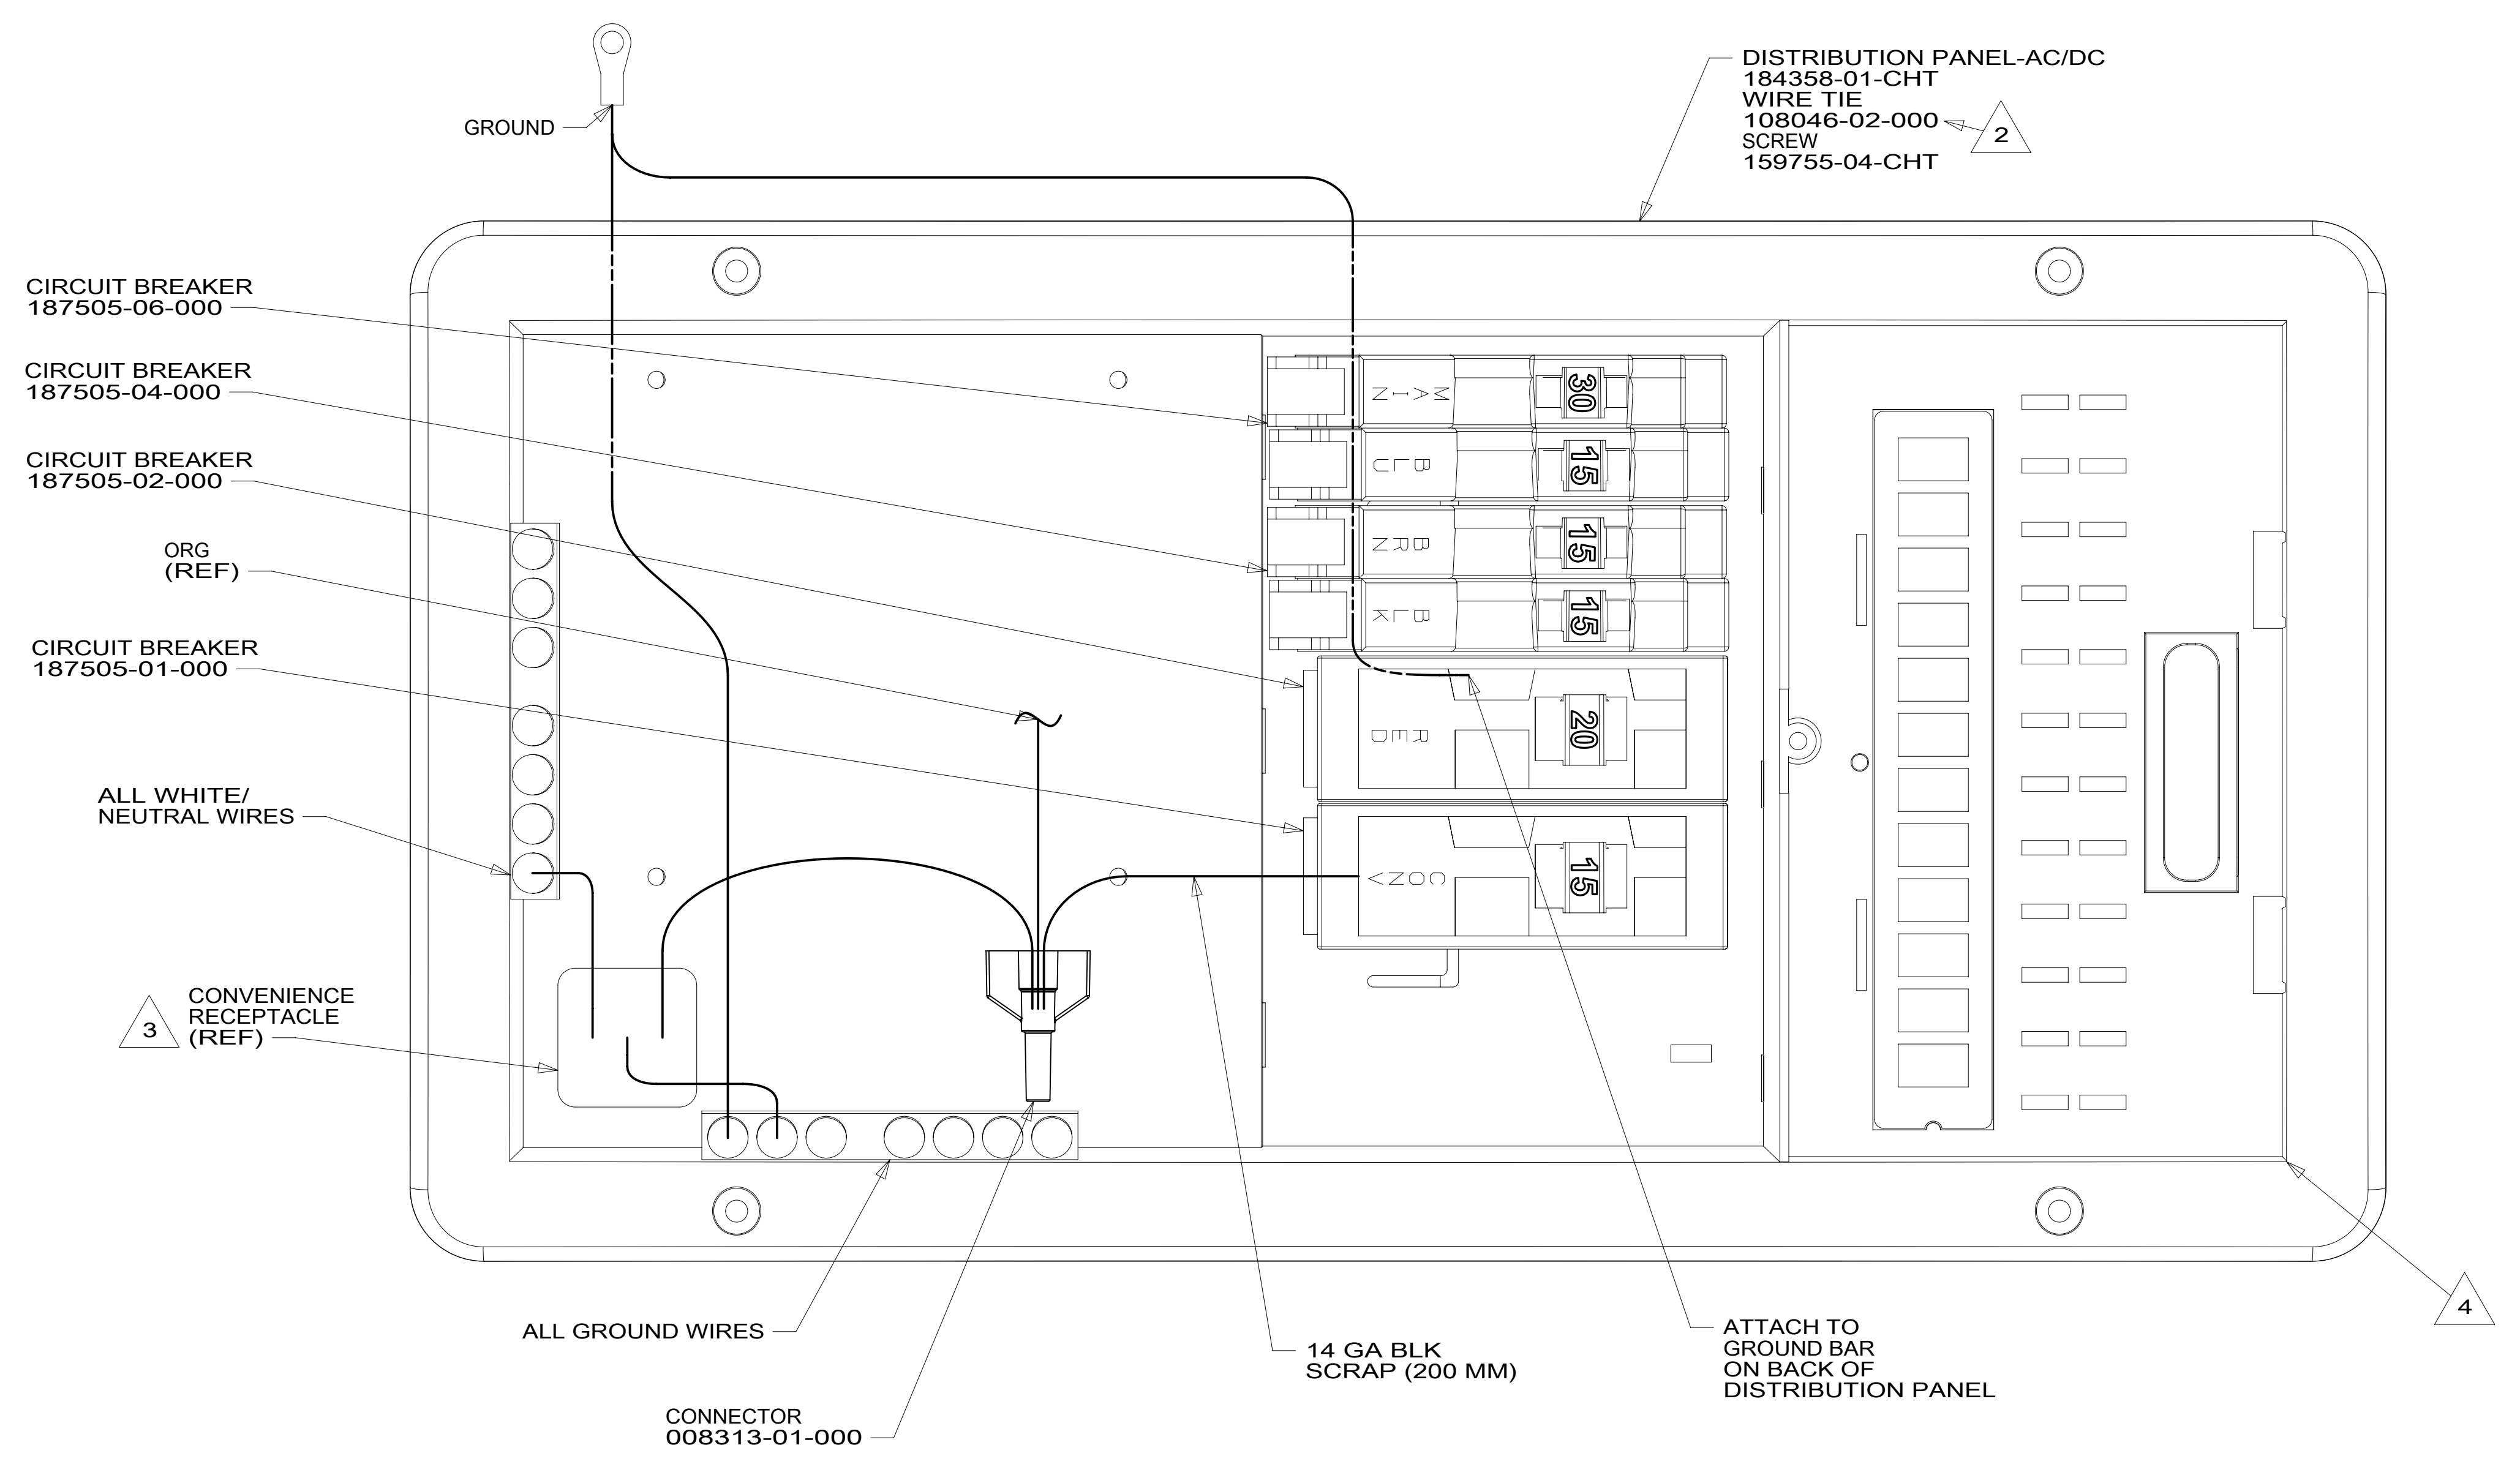

- 4 SEE WIRING INSTL-BODY, 12V FOR ADDITIONAL INFORMATION.
- 3 CONNECT BLACK WIRE FROM CONVENIENCE RECEPTACLE TO DEDICATED CIRCUIT BREAKER.
- 2 ATTACH TO UNUSED SCREW HOLE ON BACK SIDE OF PANEL TO SECURE WIRES.
1. ALL GROUND WIRES TO BE COVERED WITH TUBING 8041-02-000.

NOTES:

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA
- 1B1 265



| | | |
|----------------------------------------------------|-----------------------------------|---------------------|
| DSNR: | ALL DIMENSIONS ARE IN MILLIMETERS | |
| DIFFR: | | |
| UNSPECIFIED TOLERANCES: | MATERIAL: | |
| WHOLE DIM (X) : 3 | | |
| ONE-PLACE (X.X) : 1.5 | | |
| TWO-PLACE (X.XX) : 0.50 | | |
| ANGLE : 1° | | |
| REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES | WEIGHT: (LBS) | FIRST USED: 18 524G |

| | | |
|------------------------|---------------------------------------|-------------|
| LOAD CENTER ASM | | |
| SHEET: 1 OF 1 | ITEM/PART NO: 000046013 / 32112401000 | REV: |
| REF: 1 | | 13-Dec-2017 |

8 7 6 5 4 3 2 1