
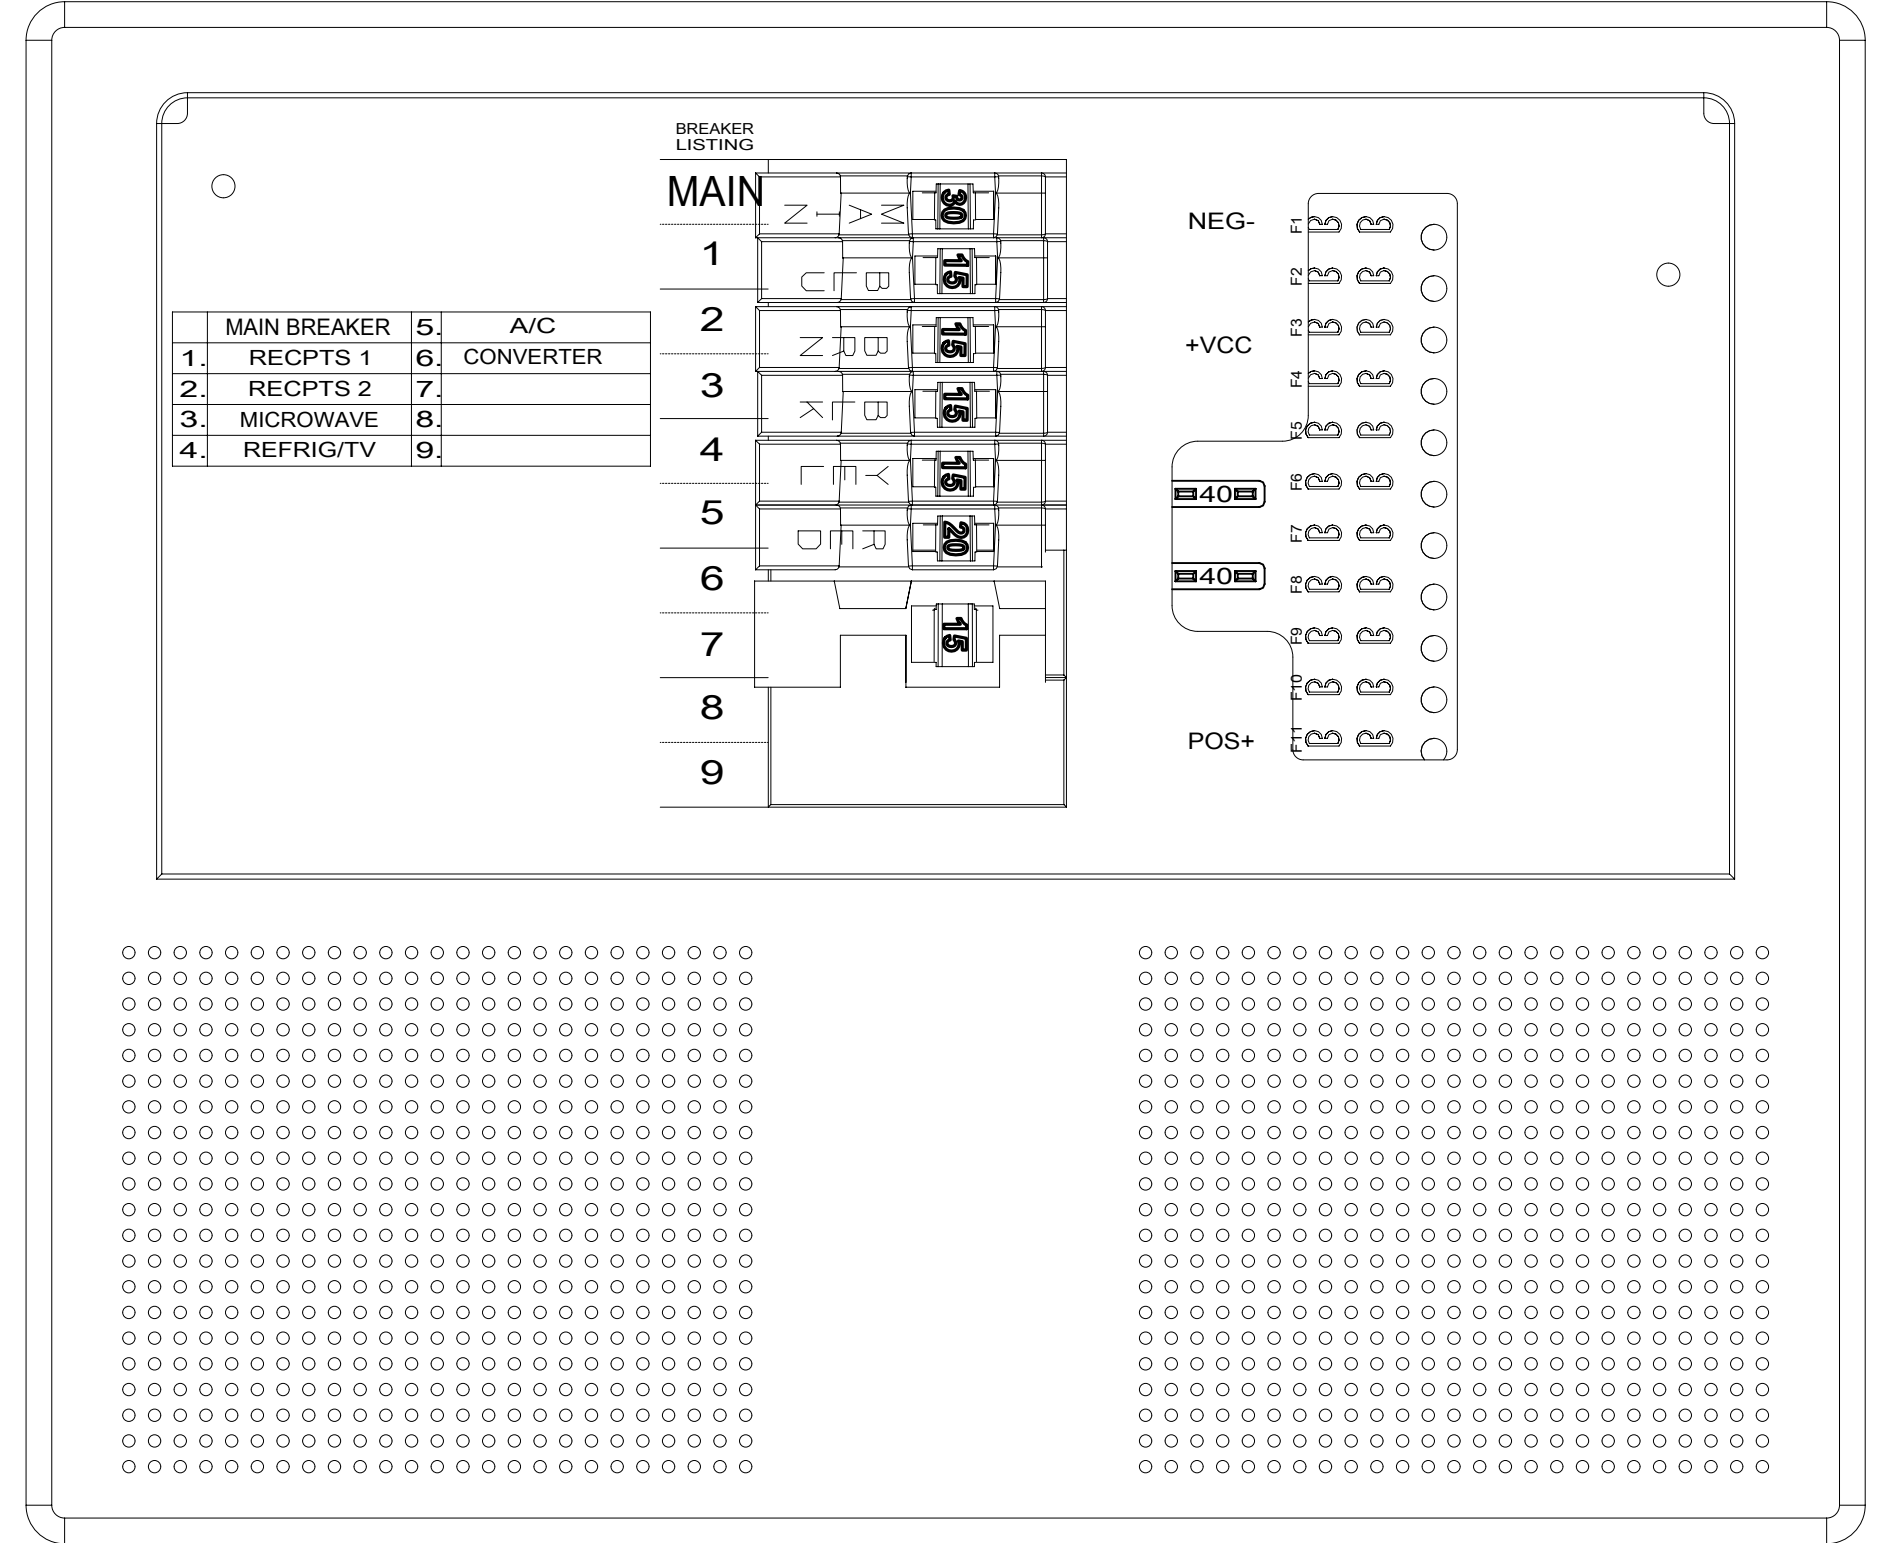
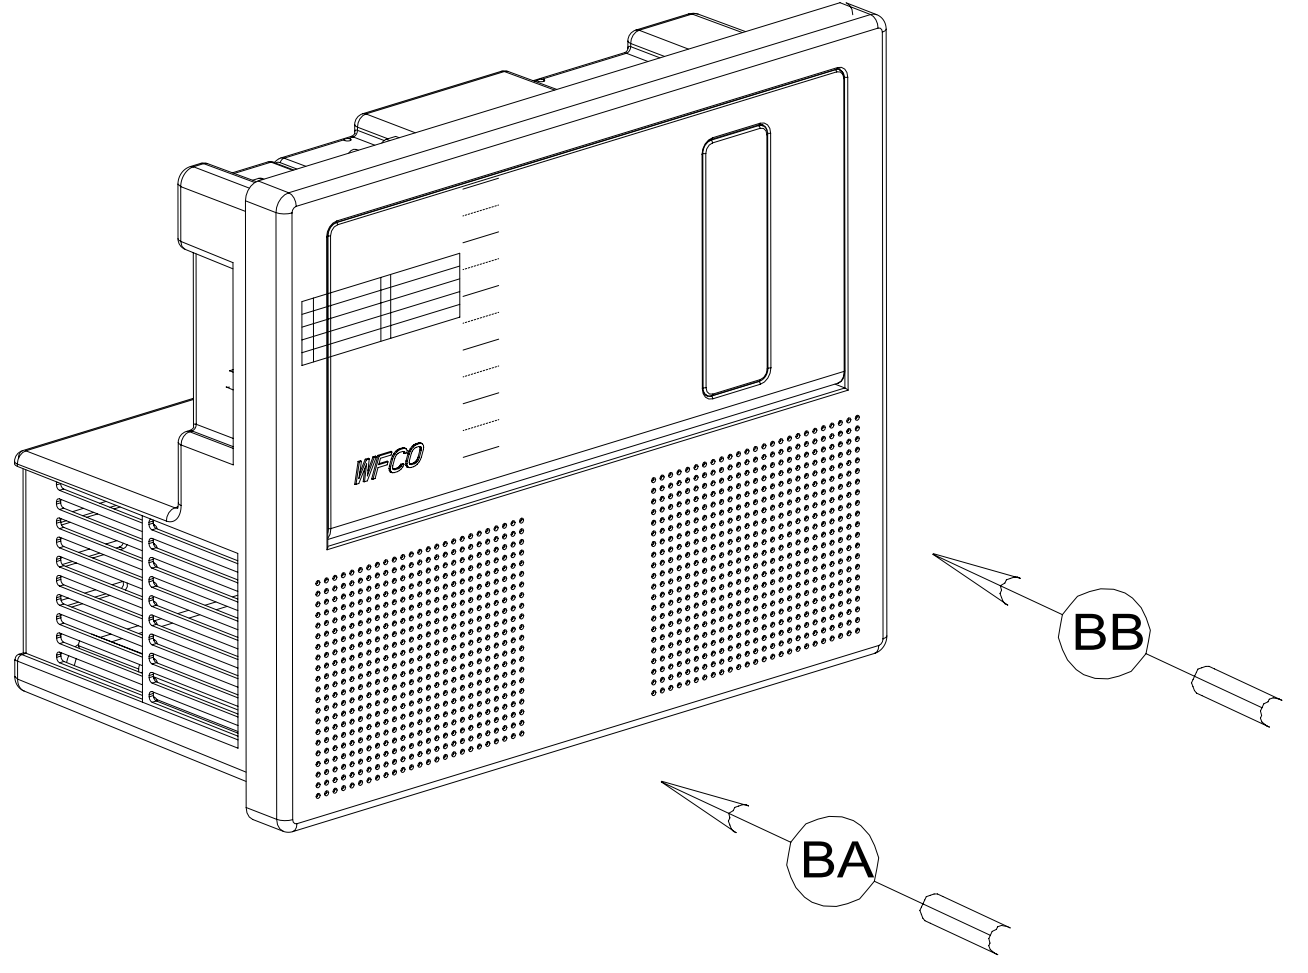


ITEM NUMBER	LEGACY NUMBER	MAIN 1
000113944	321838-01-000	008353-01-000
000113945	321838-02-000	093256-01-000

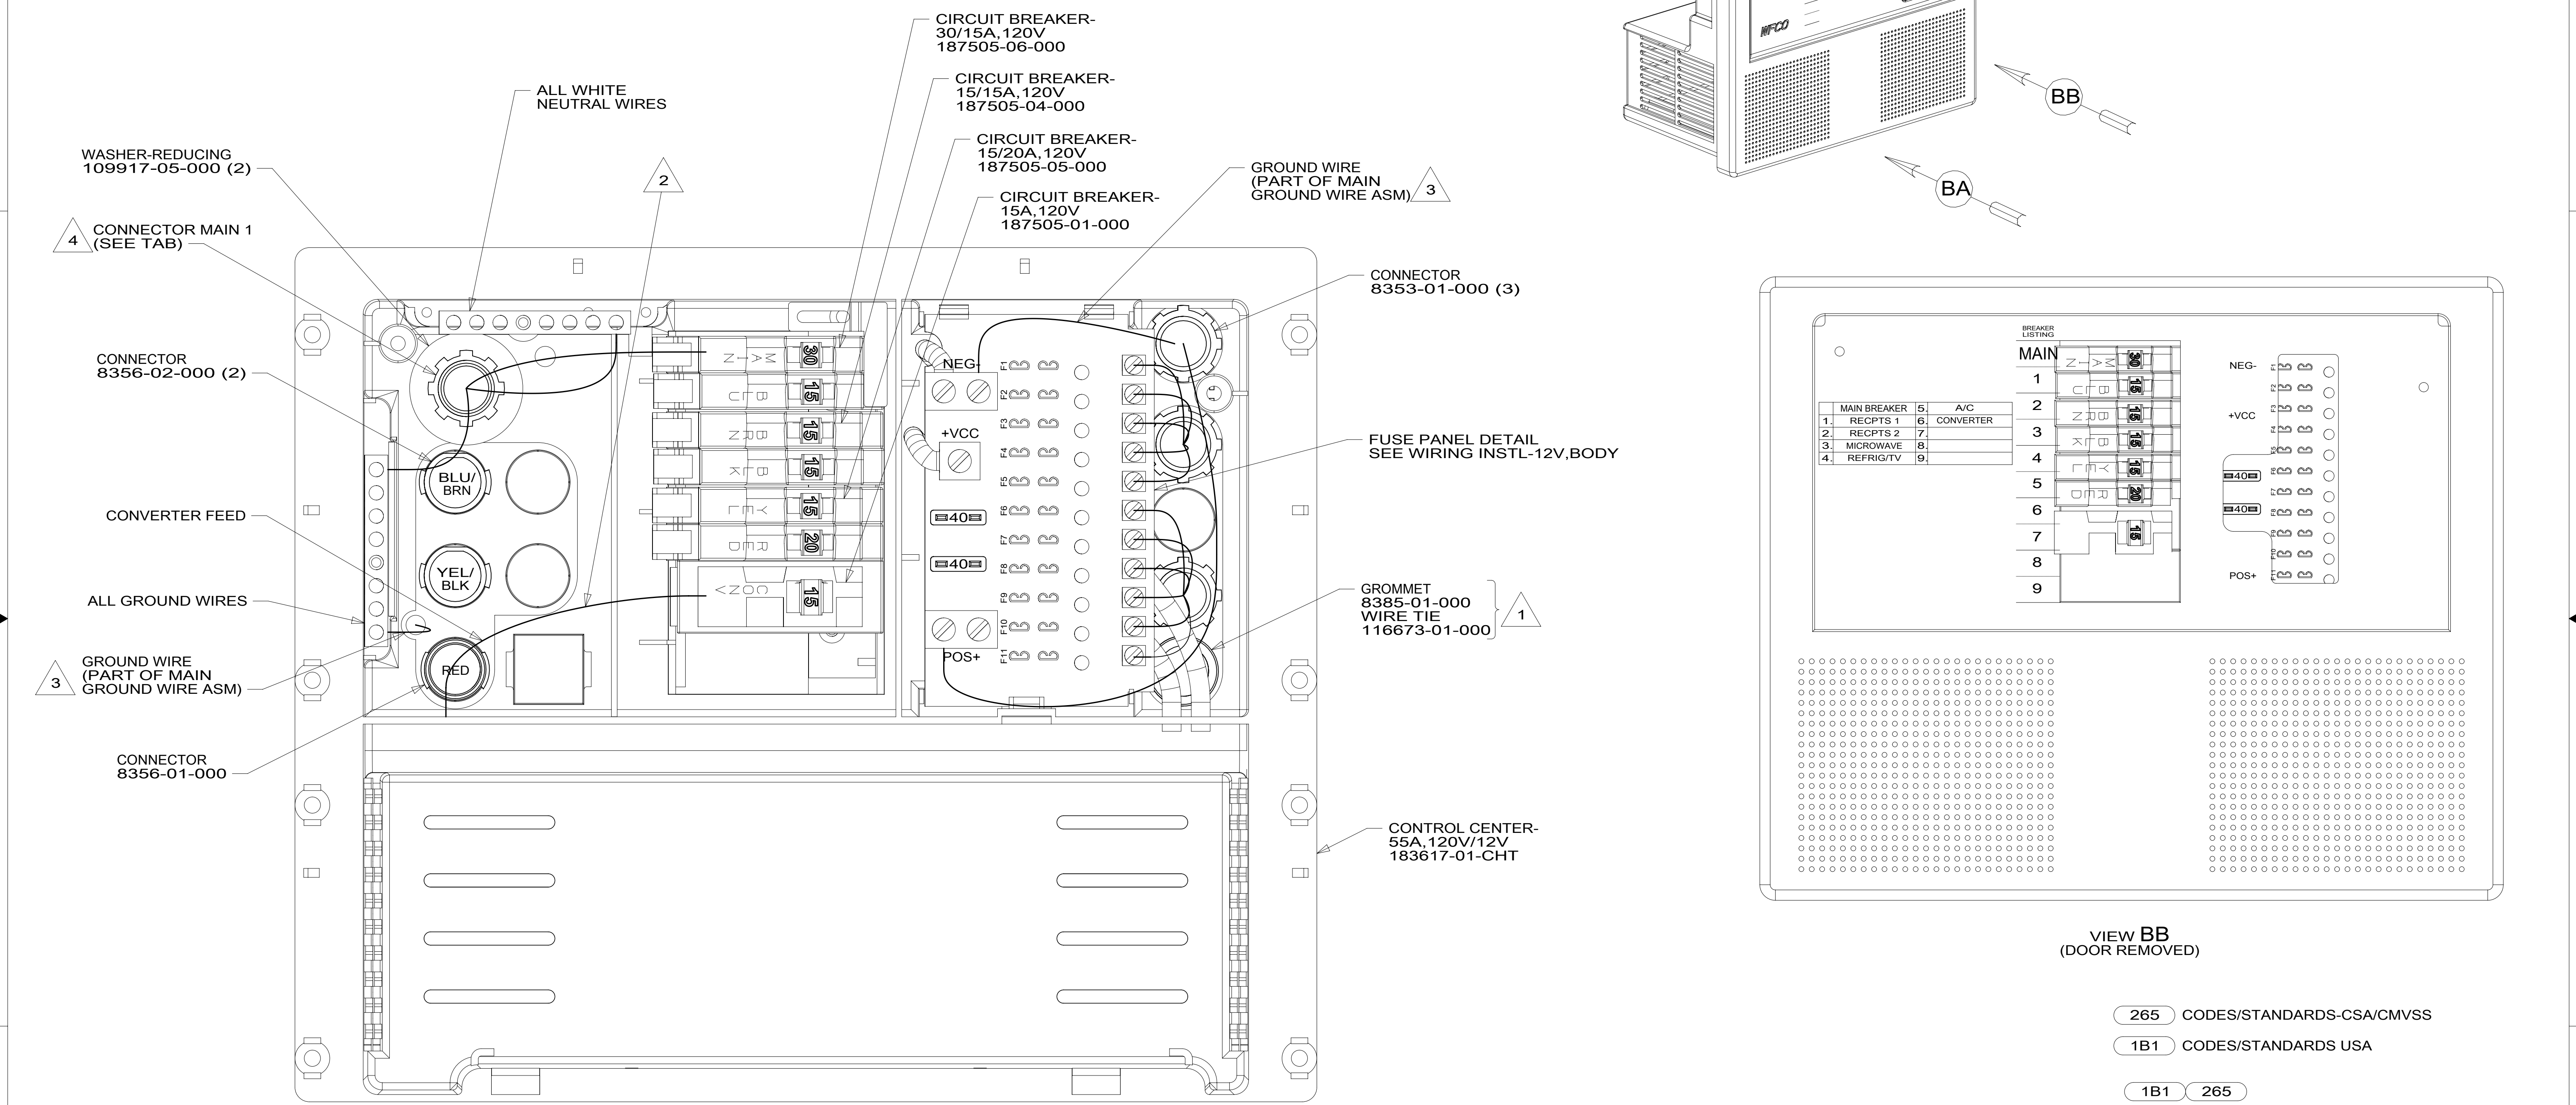

VIEW BA
(COVER REMOVED)

VIEW BB
(DOOR REMOVED)


- NOTES:
- 4 ATTACH MAIN DURING ASSEMBLY OF LOAD CENTER.
 - 3 SEE WIRING INSTL-BODY, 110V FOR ADDITIONAL INFORMATION.
 - 2 CONNECT ONE BRANCH OF CONVERTER POWER CIRCUIT INTO BREAKER. COVER OTHER BRANCH OF CONVERTER POWER CIRCUIT WITH SUPPLIED WIRE NUT.
 - 1 INSERT GROMMET FROM THE INSIDE OF CONTROL CENTER. SECURE 110V WIRES TO BACKSIDE OF CONTROL CENTER WITH WIRE TIE.

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

- 1B1 265

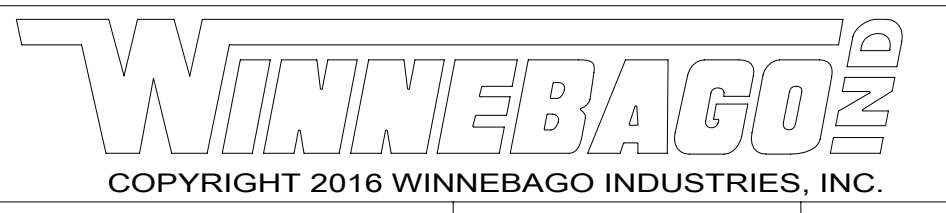

DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS	
DFFR:		
UNSPECIFIED TOLERANCES:	MATERIAL:	
WHOLE DIM (X) ± 3		
ONE-PLACE (X.X) ± 1.5		
TWO-PLACE (X.XX) ± 0.50		
ANGLE ± 1°		
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	WEIGHT: (LBS)	FIRST USED:
		18 V-SER

DESCRIPTION: LOAD CENTER ASM		
SHEET: 1 OF 1	ITEM/PART NO: 000113912 / 32183800T01	REV: