

CIRCUIT BREAKER-20 AMP
93654-03-000
SCREW
G52-06-04U
G52-06-05U
SPACER-CIRCUIT BREAKER
141789-01-000

CIRCUIT BREAKER-6 AMP
93654-01-000
SCREW
G52-06-04U
G52-06-05U
SPACER-CIRCUIT BREAKER
141789-01-000

CIRCUIT BREAKER-15 AMP
93654-02-000
SCREW
G52-06-05U
SPACER-CIRCUIT BREAKER
141789-01-000

CIRCUIT BREAKER-30 AMP
93655-02-000
SPACER-CIRCUIT BREAKER
141789-01-000
SCREW
G52-06-04U
G52-06-05U

CIRCUIT BREAKER-55 AMP
113482-01-000
SCREW
G19-10-08U

CIRCUIT BREAKER-6 AMP
93654-01-000
SCREW
G52-06-04U
G52-06-05U
SPACER-CIRCUIT BREAKER
141789-01-000

CIRCUIT BREAKER-55 AMP
113482-01-000
SCREW
G19-10-08U

CIRCUIT BREAKER-30 AMP
93655-02-000
SPACER-CIRCUIT BREAKER
141789-01-000
SCREW
G52-06-05U (2)

LABEL-CIRCUIT BREAKER
93236-53-000

PLATE-CIRCUIT BREAKER
118531-11-CHT
SCREW
G39-08-089 (2)

CIRCUIT BREAKER-30 AMP
93655-02-000
SPACER-CIRCUIT BREAKER
141789-01-000
SCREW
G52-06-04U
G52-06-05U

CIRCUIT BREAKER-30 AMP
93655-02-000
SPACER-CIRCUIT BREAKER
141789-01-000
SCREW
G52-06-04U (2)

SLOT TO BE ORIENTED
BELOW BREAKER HOLES

- 2 USE THE LONGER SCREW TO PROPERLY ATTACH BREAKER TO BUSS BAR.
- 1 REPLACE EXISTING SCREW TO PROPERLY ATTACH BREAKER TO BUSS BAR.


FOR ELECTRICAL
TORQUE
SPECIFICATIONS
SEE DWG NO.
128783-01-000

FOR
ELECTRICAL
CALLOUTS
SEE DWG NO.
121339-01-000

- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA
- 1B1 265

WINNEBAGO
COPYRIGHT 2016 WINNEBAGO INDUSTRIES, INC.

DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS
DIFFR:	
UNSPECIFIED TOLERANCES:	MATERIAL:
WHOLE DIM (X) : 3	
ONE-PLACE (X.X) : 1.5	
TWO-PLACE (X.XX) : 0.50	
ANGLE : 1°	
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	WEIGHT: (LBS) FIRST USED: 18 E27N
DESCRIPTION: CHASSIS ELECTRICAL BOX ASM	
SHEET: 1 OF 2	ITEM/PART NO: 000124573 / 32395301000
REF:	1 12-Jan-2018

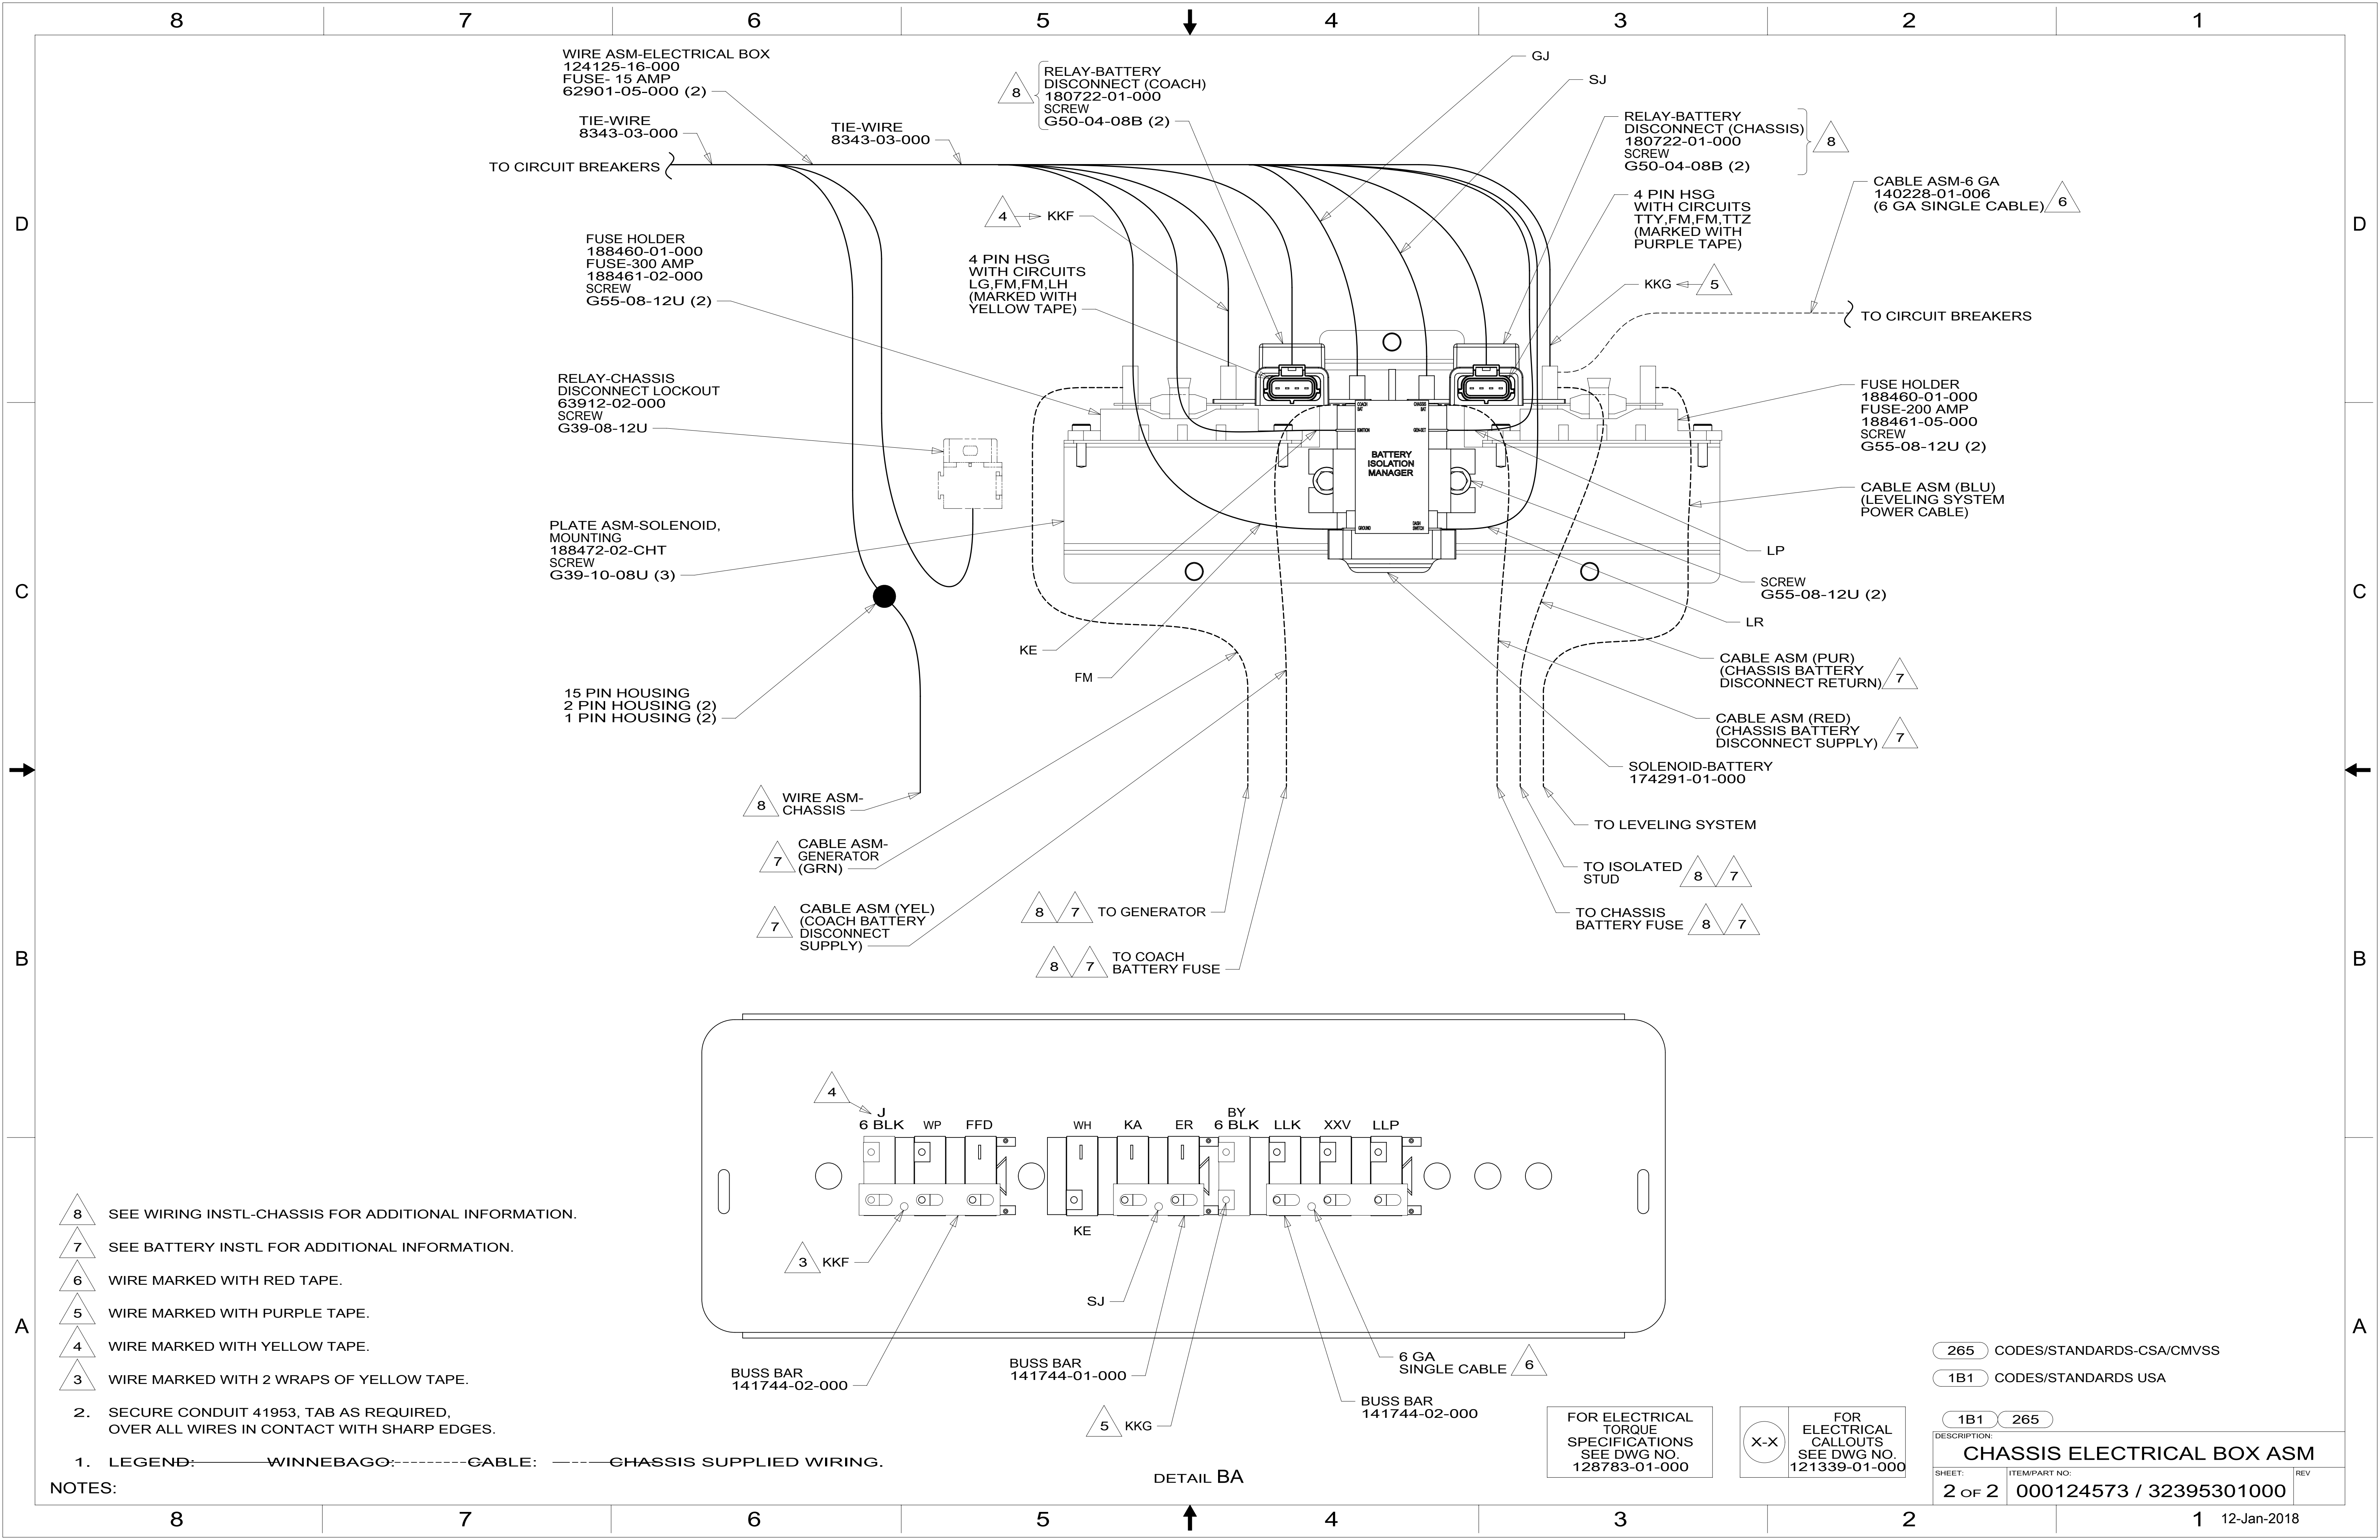

WIRE ASM-ELECTRICAL BOX
124125-16-000
FUSE- 15 AMP
62901-05-000 (2)

TIE-WIRE
8343-03-000

TIE-WIRE
8343-03-000

RELAY-BATTERY
DISCONNECT (COACH)
180722-01-000
SCREW
G50-04-08B (2)

RELAY-BATTERY
DISCONNECT (CHASSIS)
180722-01-000
SCREW
G50-04-08B (2)

CABLE ASM-6 GA
140228-01-006
(6 GA SINGLE CABLE)

FUSE HOLDER
188460-01-000
FUSE-300 AMP
188461-02-000
SCREW
G55-08-12U (2)

4 PIN HSG
WITH CIRCUITS
LG,FM,FM,LH
(MARKED WITH
YELLOW TAPE)

4 PIN HSG
WITH CIRCUITS
TTY,FM,FM,TTZ
(MARKED WITH
PURPLE TAPE)

FUSE HOLDER
188460-01-000
FUSE-200 AMP
188461-05-000
SCREW
G55-08-12U (2)

RELAY-CHASSIS
DISCONNECT LOCKOUT
63912-02-000
SCREW
G39-08-12U

PLATE ASM-SOLENOID,
MOUNTING
188472-02-CHT
SCREW
G39-10-08U (3)

15 PIN HOUSING
2 PIN HOUSING (2)
1 PIN HOUSING (2)

WIRE ASM-
CHASSIS

CABLE ASM-
GENERATOR
(GRN)

CABLE ASM (YEL)
(COACH BATTERY
DISCONNECT
SUPPLY)

TO GENERATOR

TO COACH
BATTERY FUSE

CABLE ASM (PUR)
(CHASSIS BATTERY
DISCONNECT RETURN)


CABLE ASM (RED)
(CHASSIS BATTERY
DISCONNECT SUPPLY)

SOLENOID-BATTERY
174291-01-000

TO LEVELING SYSTEM

TO ISOLATED
STUD

TO CHASSIS
BATTERY FUSE

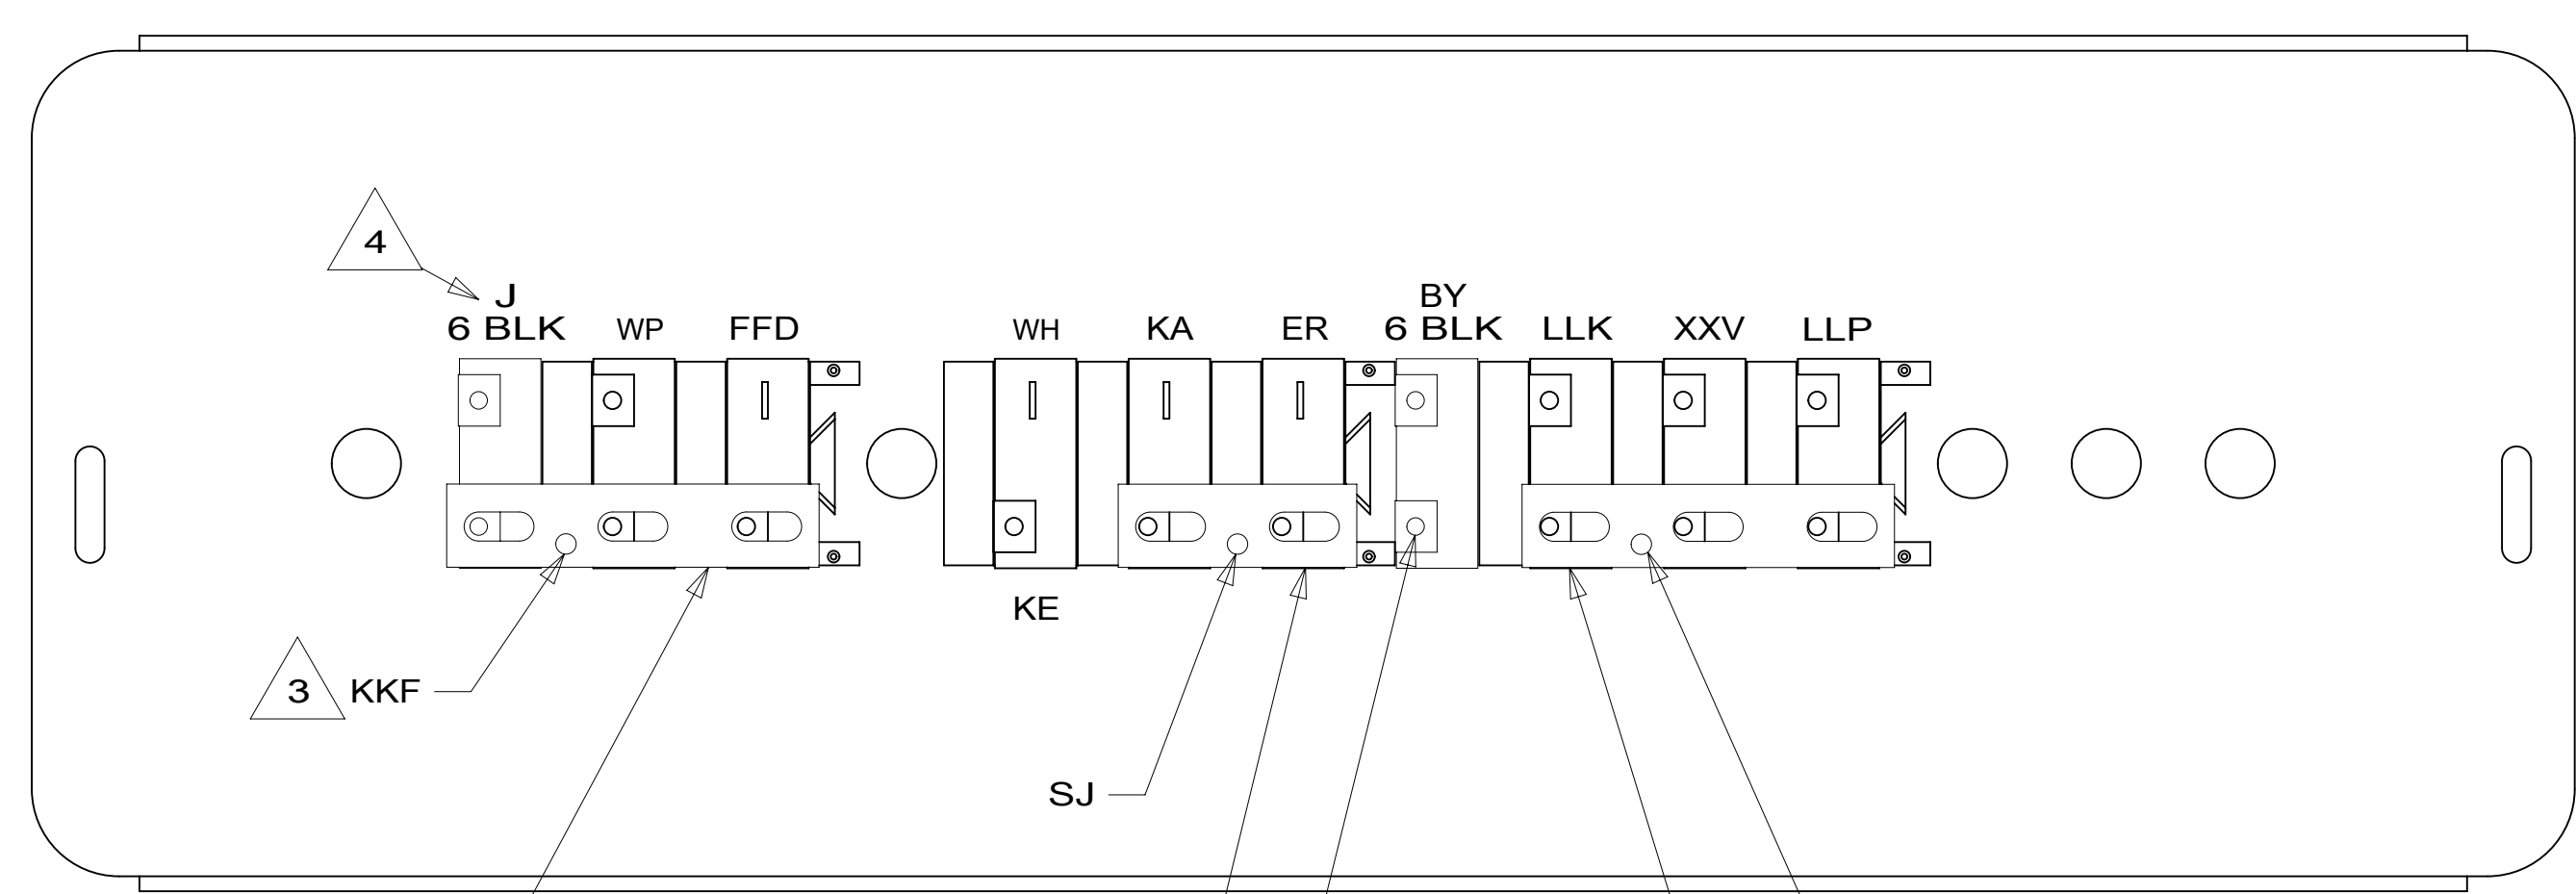

BUSS BAR
141744-02-000

BUSS BAR
141744-01-000

6 GA
SINGLE CABLE

BUSS BAR
141744-02-000

- 8 SEE WIRING INSTL-CHASSIS FOR ADDITIONAL INFORMATION.
- 7 SEE BATTERY INSTL FOR ADDITIONAL INFORMATION.
- 6 WIRE MARKED WITH RED TAPE.
- 5 WIRE MARKED WITH PURPLE TAPE.
- 4 WIRE MARKED WITH YELLOW TAPE.
- 3 WIRE MARKED WITH 2 WRAPS OF YELLOW TAPE.

- 2. SECURE CONDUIT 41953, TAB AS REQUIRED, OVER ALL WIRES IN CONTACT WITH SHARP EDGES.
- 1. LEGEND: — WINNEBAGO: - - - - - CABLE: - - - - - CHASSIS SUPPLIED WIRING.

FOR ELECTRICAL
TORQUE
SPECIFICATIONS
SEE DWG NO.
128783-01-000

FOR
ELECTRICAL
CALLOUTS
SEE DWG NO.
121339-01-000

265 CODES/STANDARDS-CSA/CMVSS
1B1 CODES/STANDARDS USA

DESCRIPTION: CHASSIS ELECTRICAL BOX ASM	
SHEET: 2 OF 2	ITEM/PART NO: 000124573 / 32395301000
REV	