

WASHER-REDUCING 109917-05-000 (2)

CONNECTOR MAIN 1 008353-01-000 (5)

CONNECTOR 8356-02-000 (2)

CONVERTER FEED (2)

ALL GROUND WIRES

GROUND WIRE (PART OF MAIN GROUND WIRE ASM) (3)

CONNECTOR 8356-01-000

CIRCUIT BREAKER-30/15A, 120V 187505-06-000

CIRCUIT BREAKER-15/15A, 120V 187505-04-000

CIRCUIT BREAKER-15A, 120V 187505-01-000 (79W)

GROUND WIRE (PART OF MAIN GROUND WIRE ASM) (3)


CONNECTOR 8353-01-000 (3)

FUSE PANEL (4)

GROMMET 8385-01-000 WIRE TIE 116673-01-000 (1)

CONTROL CENTER-55A, 120V/12V, REV. POL. 000239110 / 346113-01-CHT

CIRCUIT BREAKER-20A, 120V 187505-02-000

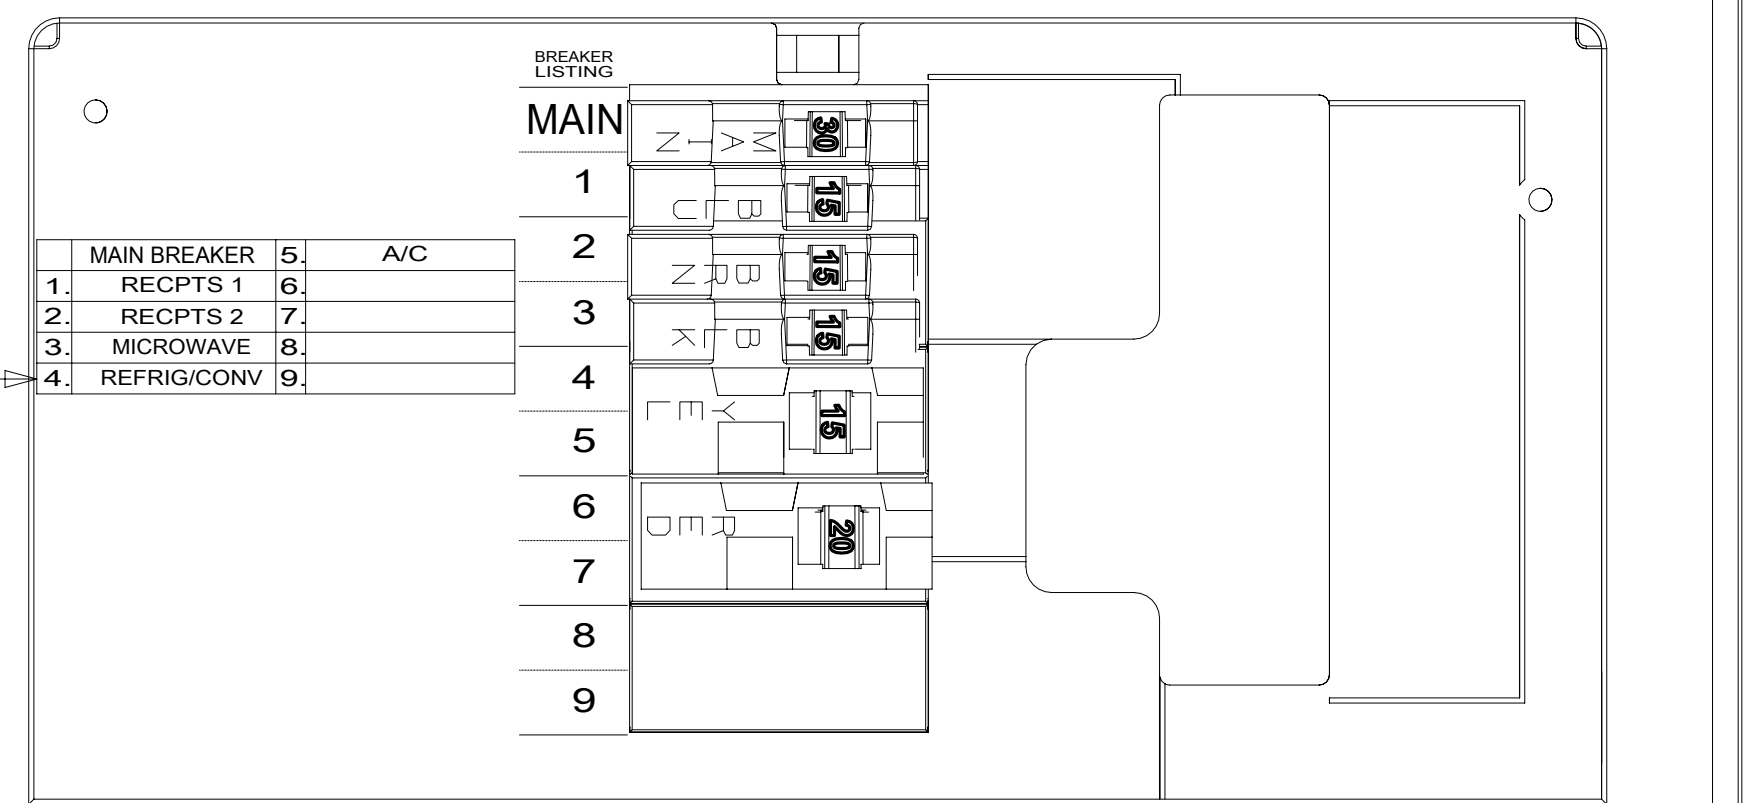

VIEW AA  
(COVER REMOVED)

VIEW AA  
(DOOR REMOVED)

- NOTES:**
- 5 ATTACH MAIN DURING ASSEMBLY OF LOAD CENTER.
  - 4 SEE WIRING INSTL-BODY, 12V FOR ADDITIONAL INFORMATION.
  - 3 SEE WIRING INSTL-BODY, 110V FOR ADDITIONAL INFORMATION.
  - 2 CONNECT CONVERTER POWER CIRCUIT INTO YELLOW BREAKER. USE SUPPLIED WIRE NUT TO CONNECT TO YELLOW CIRCUIT WIRE.
  - 1 INSERT GROMMET FROM THE INSIDE OF CONTROL CENTER. SECURE 110V WIRES TO BACKSIDE OF CONTROL CENTER WITH WIRE TIE.

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG NO. 121339-01-000

- 79W REFRIGERATOR-4 DOOR
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

**WINNEBAGO**  
COPYRIGHT 2016 WINNEBAGO INDUSTRIES, INC.

DSNR:	ALL DIMENSIONS ARE IN MILLIMETERS
DFFR:	MATERIAL:
UNSPECIFIED TOLERANCES:	
WHOLE DIM (X) :	3
ONE-PLACE (X.X) :	1.5
TWO-PLACE (X.XX) :	0.50
ANGLE :	1°
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES	WEIGHT: (LBS) FIRST USED: 21 E-SER
DESCRIPTION: <b>LOAD CENTER ASM</b>	
SHEET: 1 OF 1	ITEM/PART NO: 000202795 / 33777001000
REF:	1 15-Jul-2021