


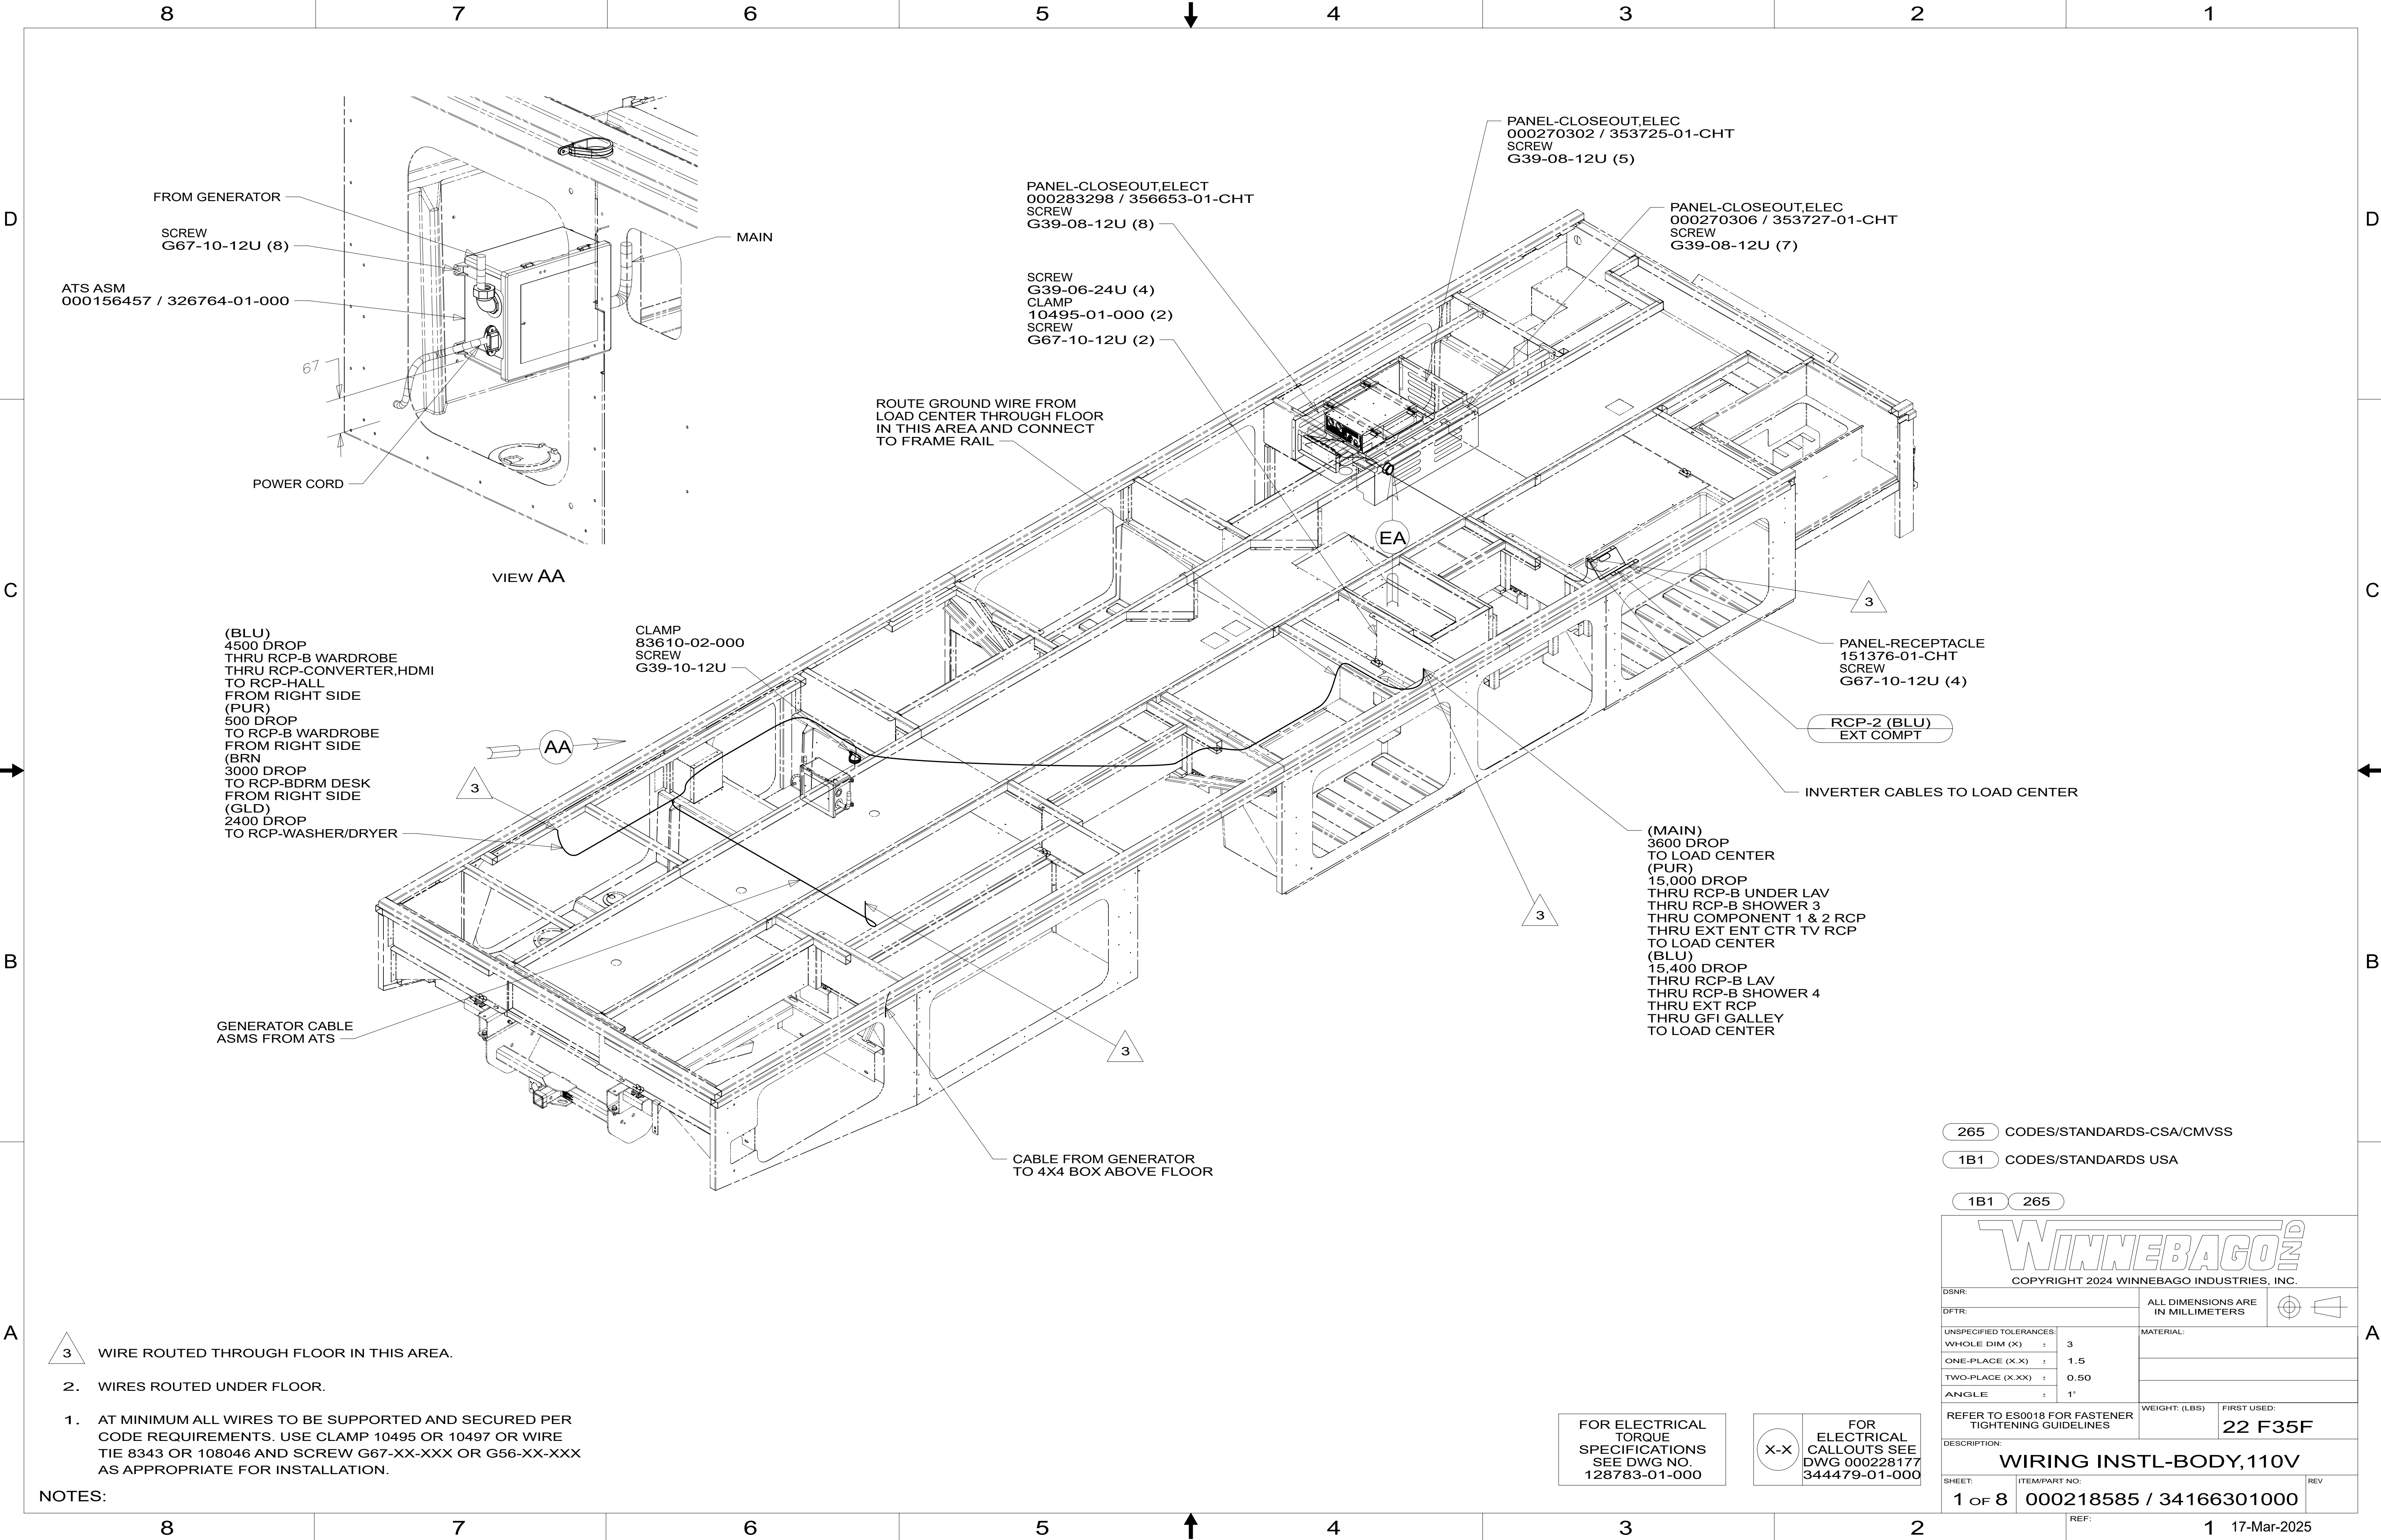

- 3 WIRE ROUTED THROUGH FLOOR IN THIS AREA.
2. WIRES ROUTED UNDER FLOOR.
1. AT MINIMUM ALL WIRES TO BE SUPPORTED AND SECURED PER CODE REQUIREMENTS. USE CLAMP 10495 OR 10497 OR WIRE TIE 8343 OR 108046 AND SCREW G67-XX-XXX OR G56-XX-XXX AS APPROPRIATE FOR INSTALLATION.

NOTES:











FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG 000228177 344479-01-000

- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA
- 1B1 265

COPYRIGHT 2024 WINNEBAGO INDUSTRIES, INC.

DSNR:		ALL DIMENSIONS ARE IN MILLIMETERS	
DFTR:			
UNSPECIFIED TOLERANCES:		MATERIAL:	
WHOLE DIM (X)	± 3		
ONE-PLACE (X.X)	± 1.5		
TWO-PLACE (X.XX)	± 0.50		
ANGLE	± 1°		
REFER TO ES0018 FOR FASTENER TIGHTENING GUIDELINES		WEIGHT: (LBS)	FIRST USED:
			22 F35F
DESCRIPTION:			
WIRING INSTL-BODY,110V			
SHEET:	ITEM/PART NO:	REV	
1 OF 8	000218585 / 34166301000		

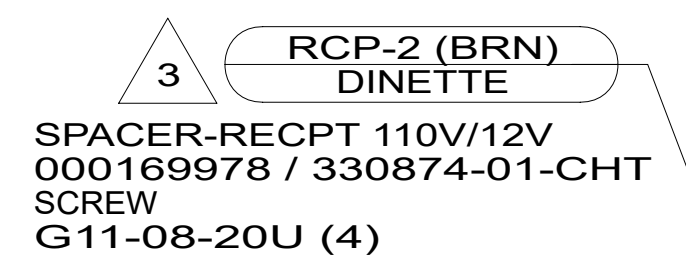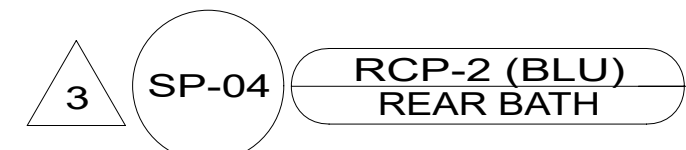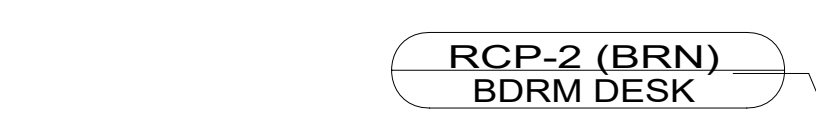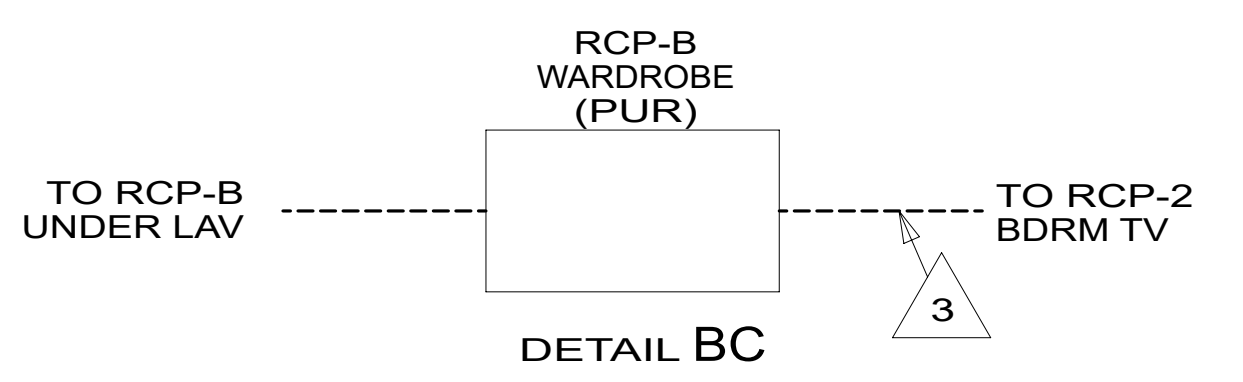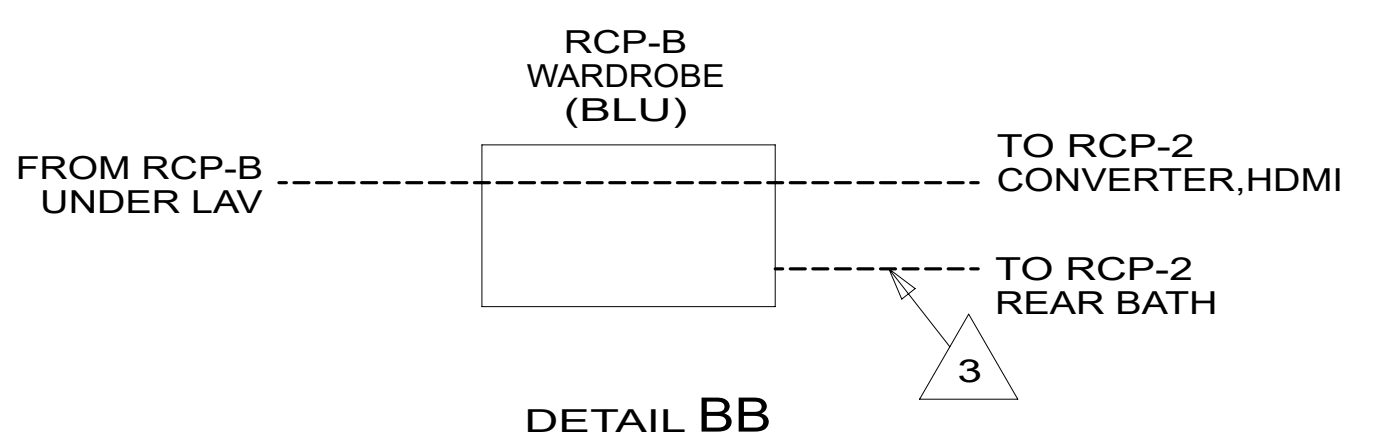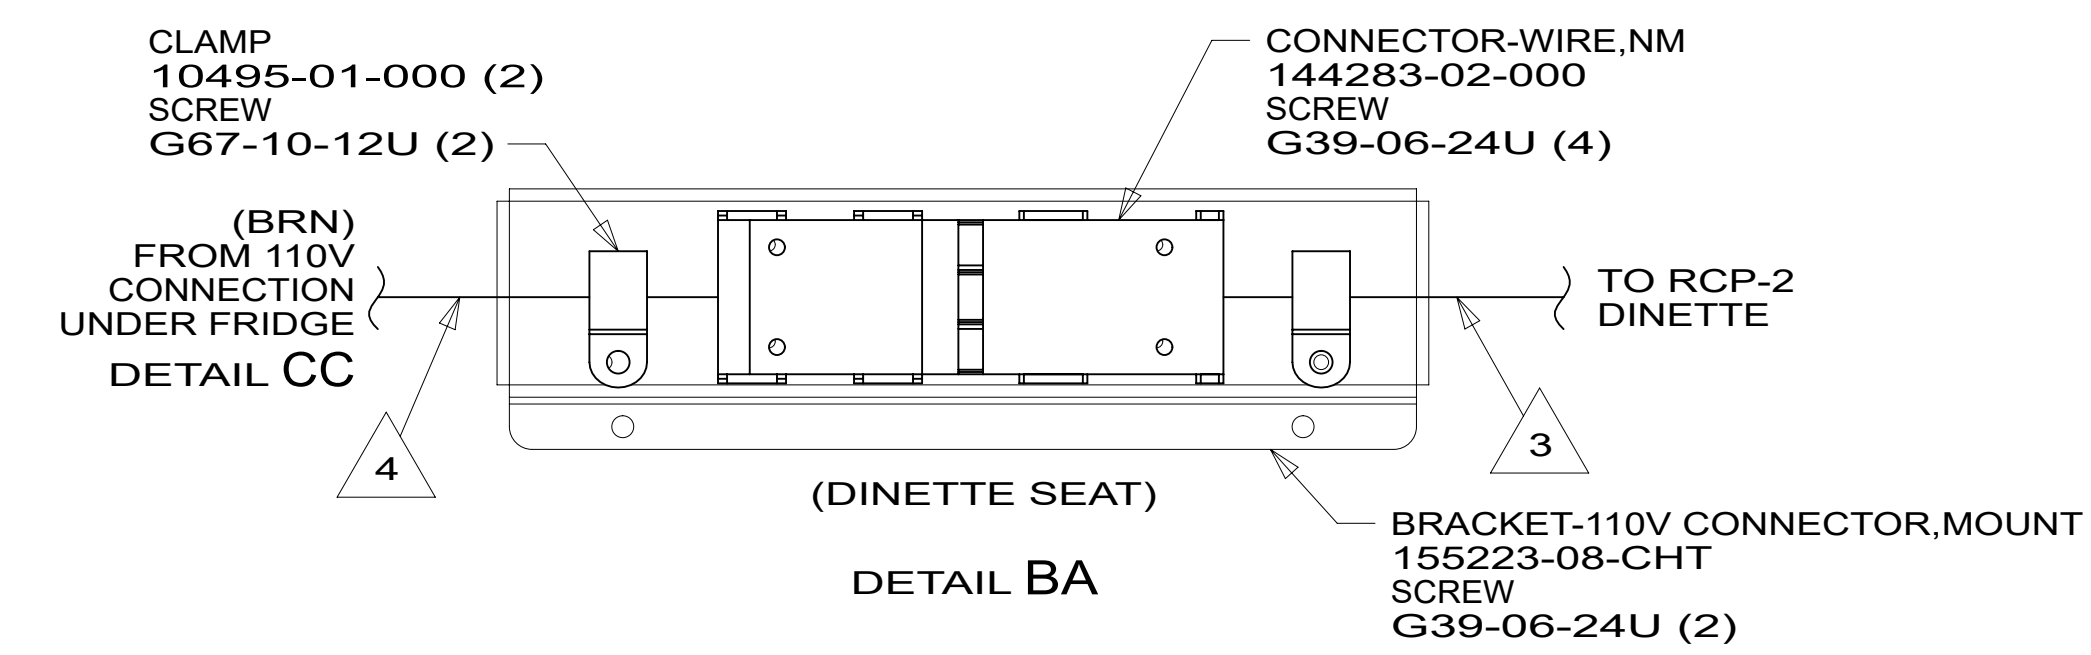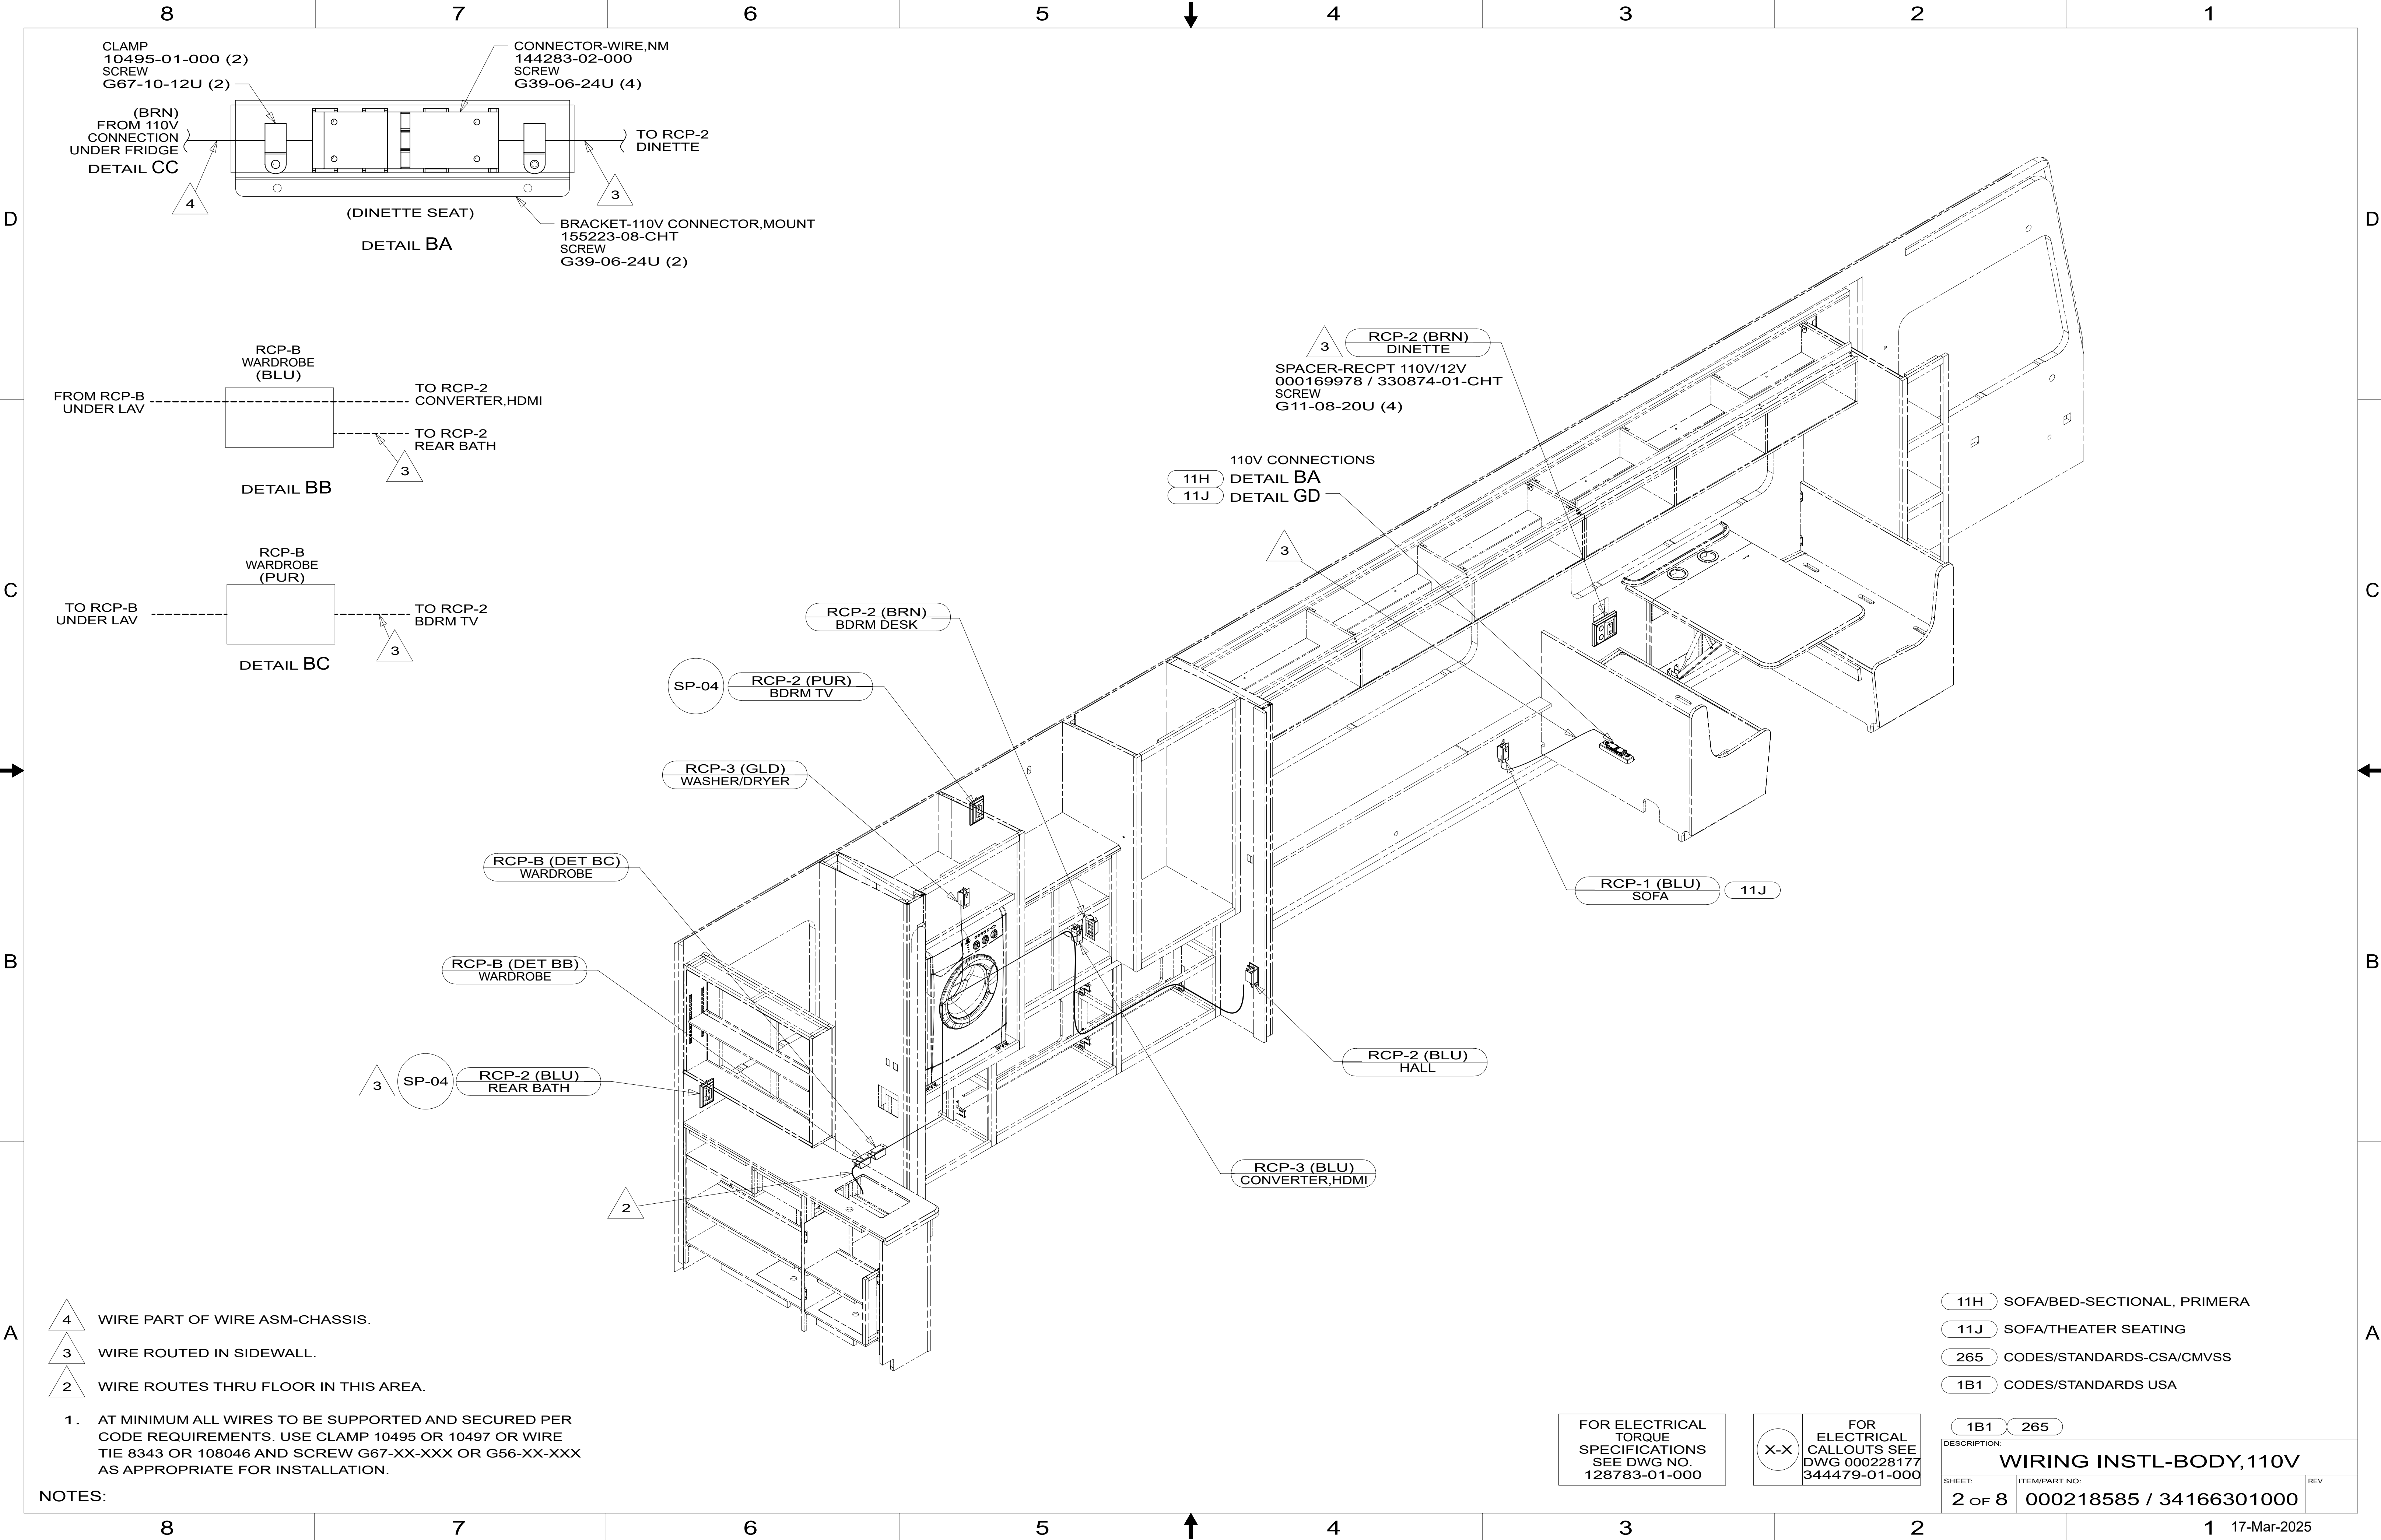

- 4 WIRE PART OF WIRE ASM-CHASSIS.
- 3 WIRE ROUTED IN SIDEWALL.
- 2 WIRE ROUTES THRU FLOOR IN THIS AREA.

1. AT MINIMUM ALL WIRES TO BE SUPPORTED AND SECURED PER CODE REQUIREMENTS. USE CLAMP 10495 OR 10497 OR WIRE TIE 8343 OR 108046 AND SCREW G67-XX-XXX OR G56-XX-XXX AS APPROPRIATE FOR INSTALLATION.


NOTES:




FOR ELECTRICAL
TORQUE
SPECIFICATIONS
SEE DWG NO.
128783-01-000

FOR
ELECTRICAL
CALLOUTS SEE
DWG 000228177
344479-01-000

- 11H SOFA/BED-SECTIONAL, PRIMERA
- 11J SOFA/THEATER SEATING
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

DESCRIPTION:	
1B1 265	
WIRING INSTL-BODY,110V	
SHEET:	ITEM/PART NO:
2 OF 8	000218585 / 34166301000
REV	

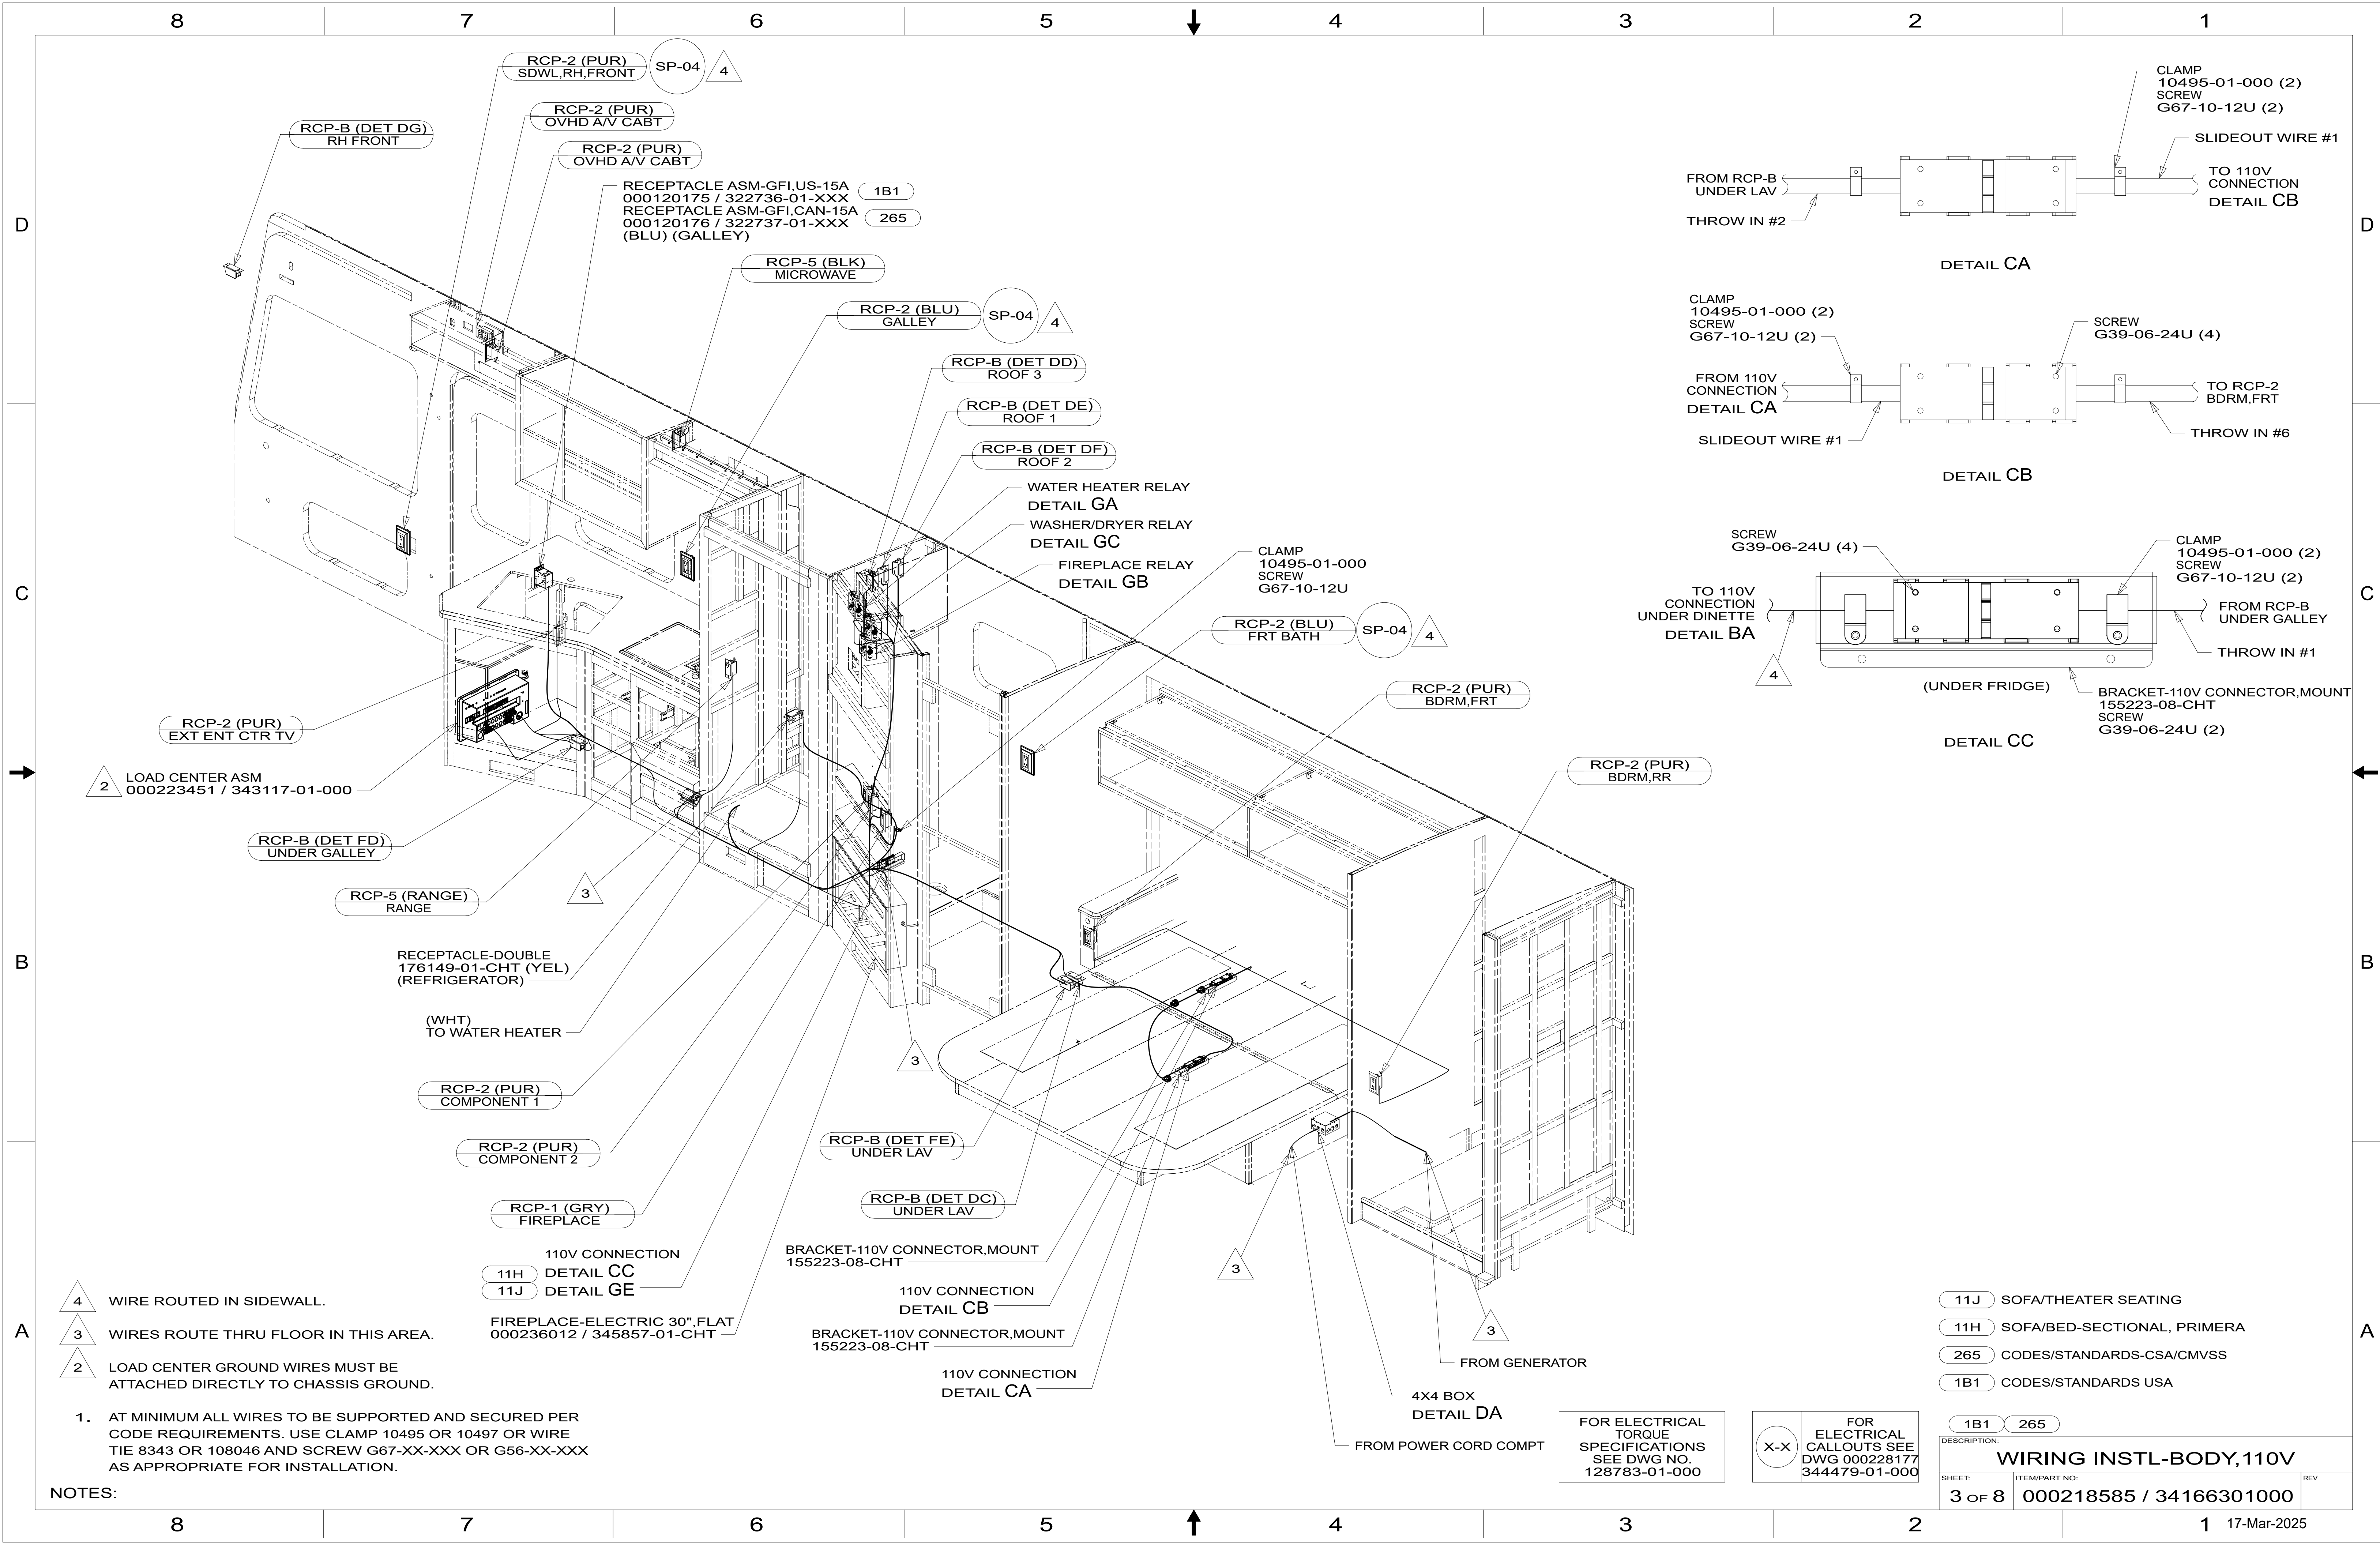

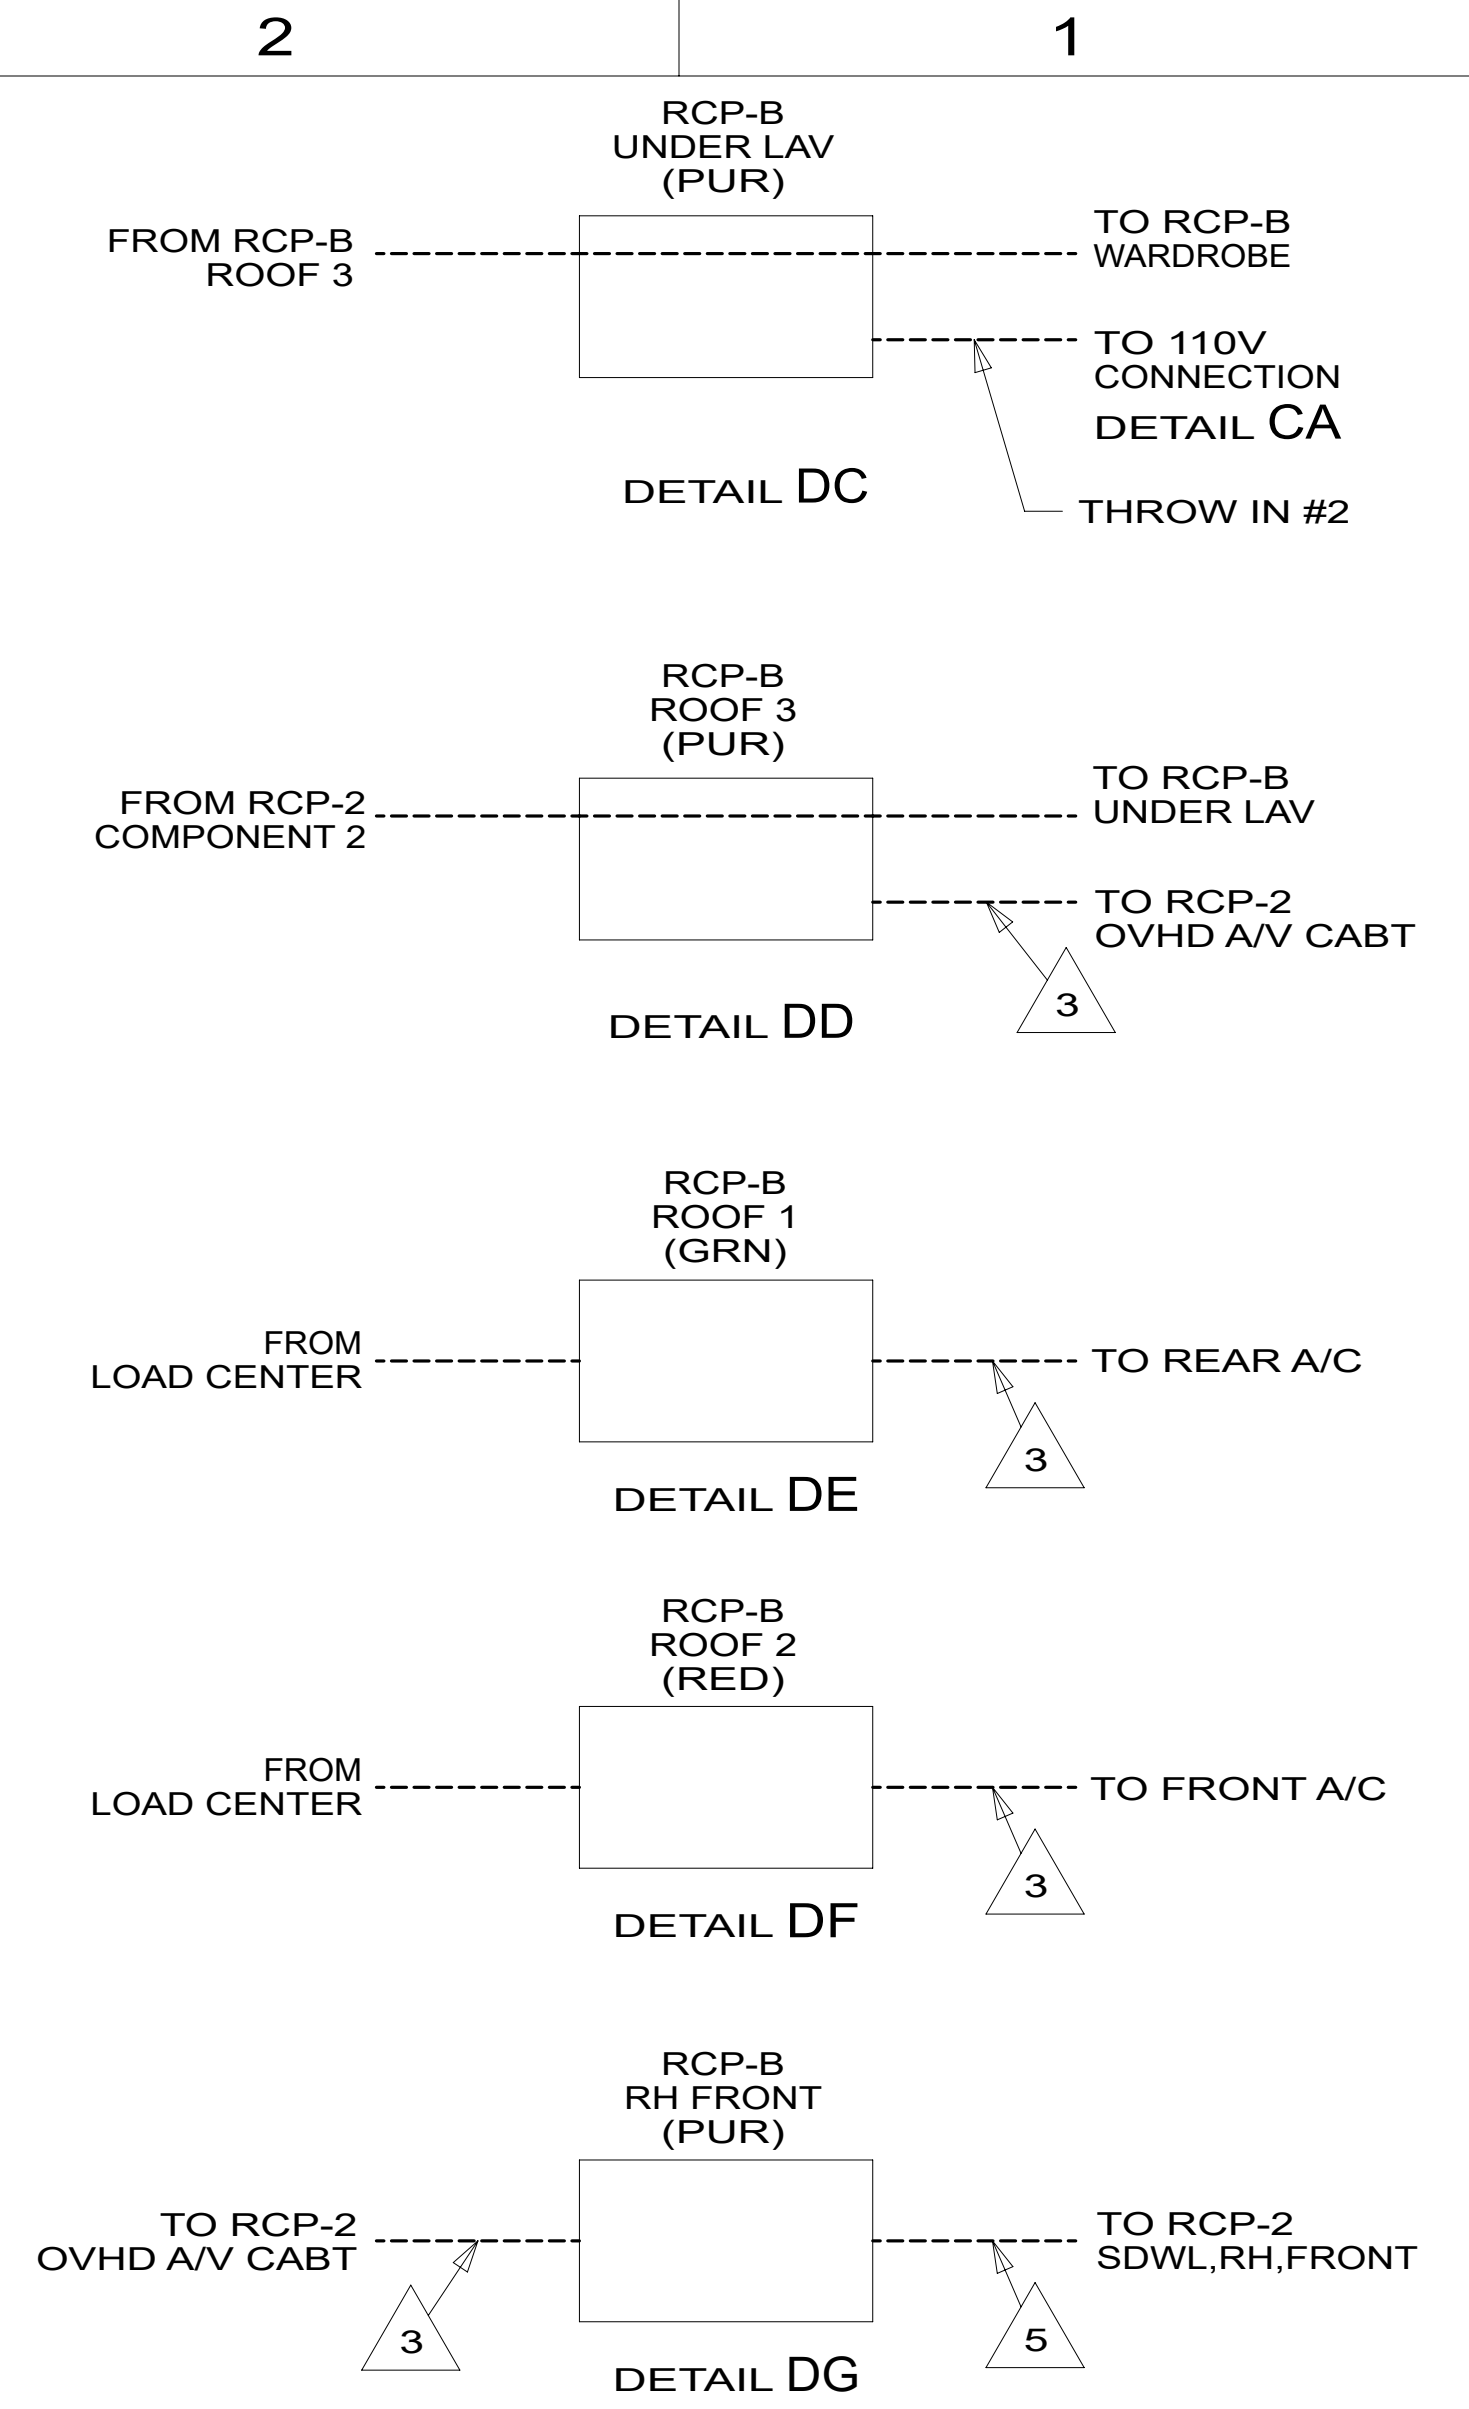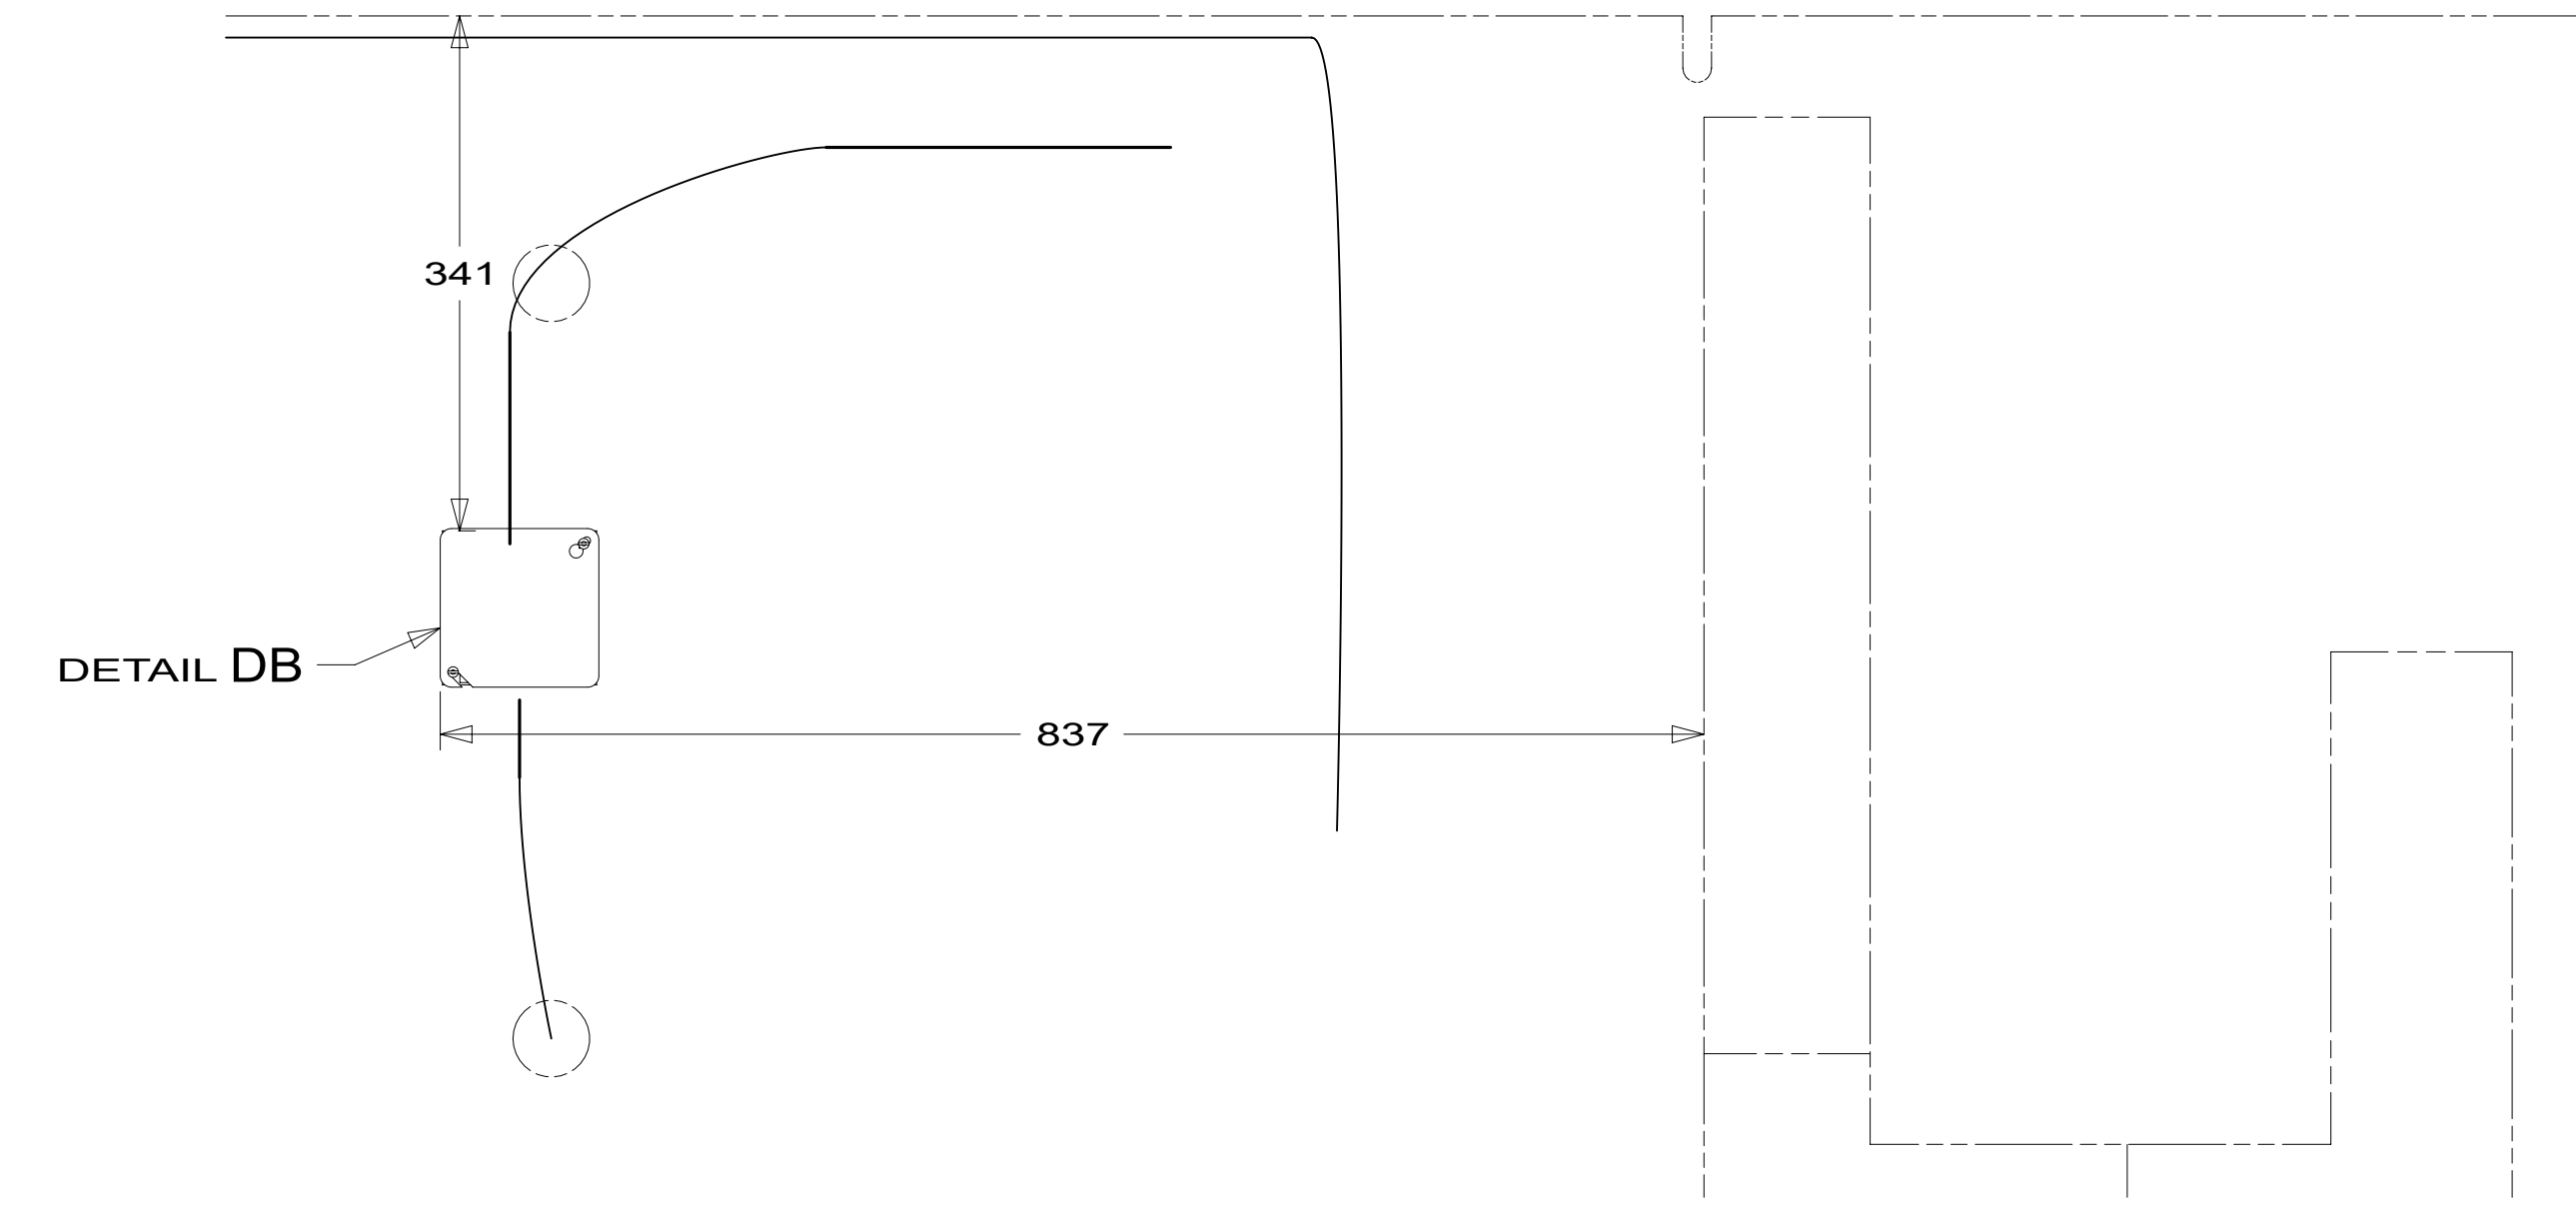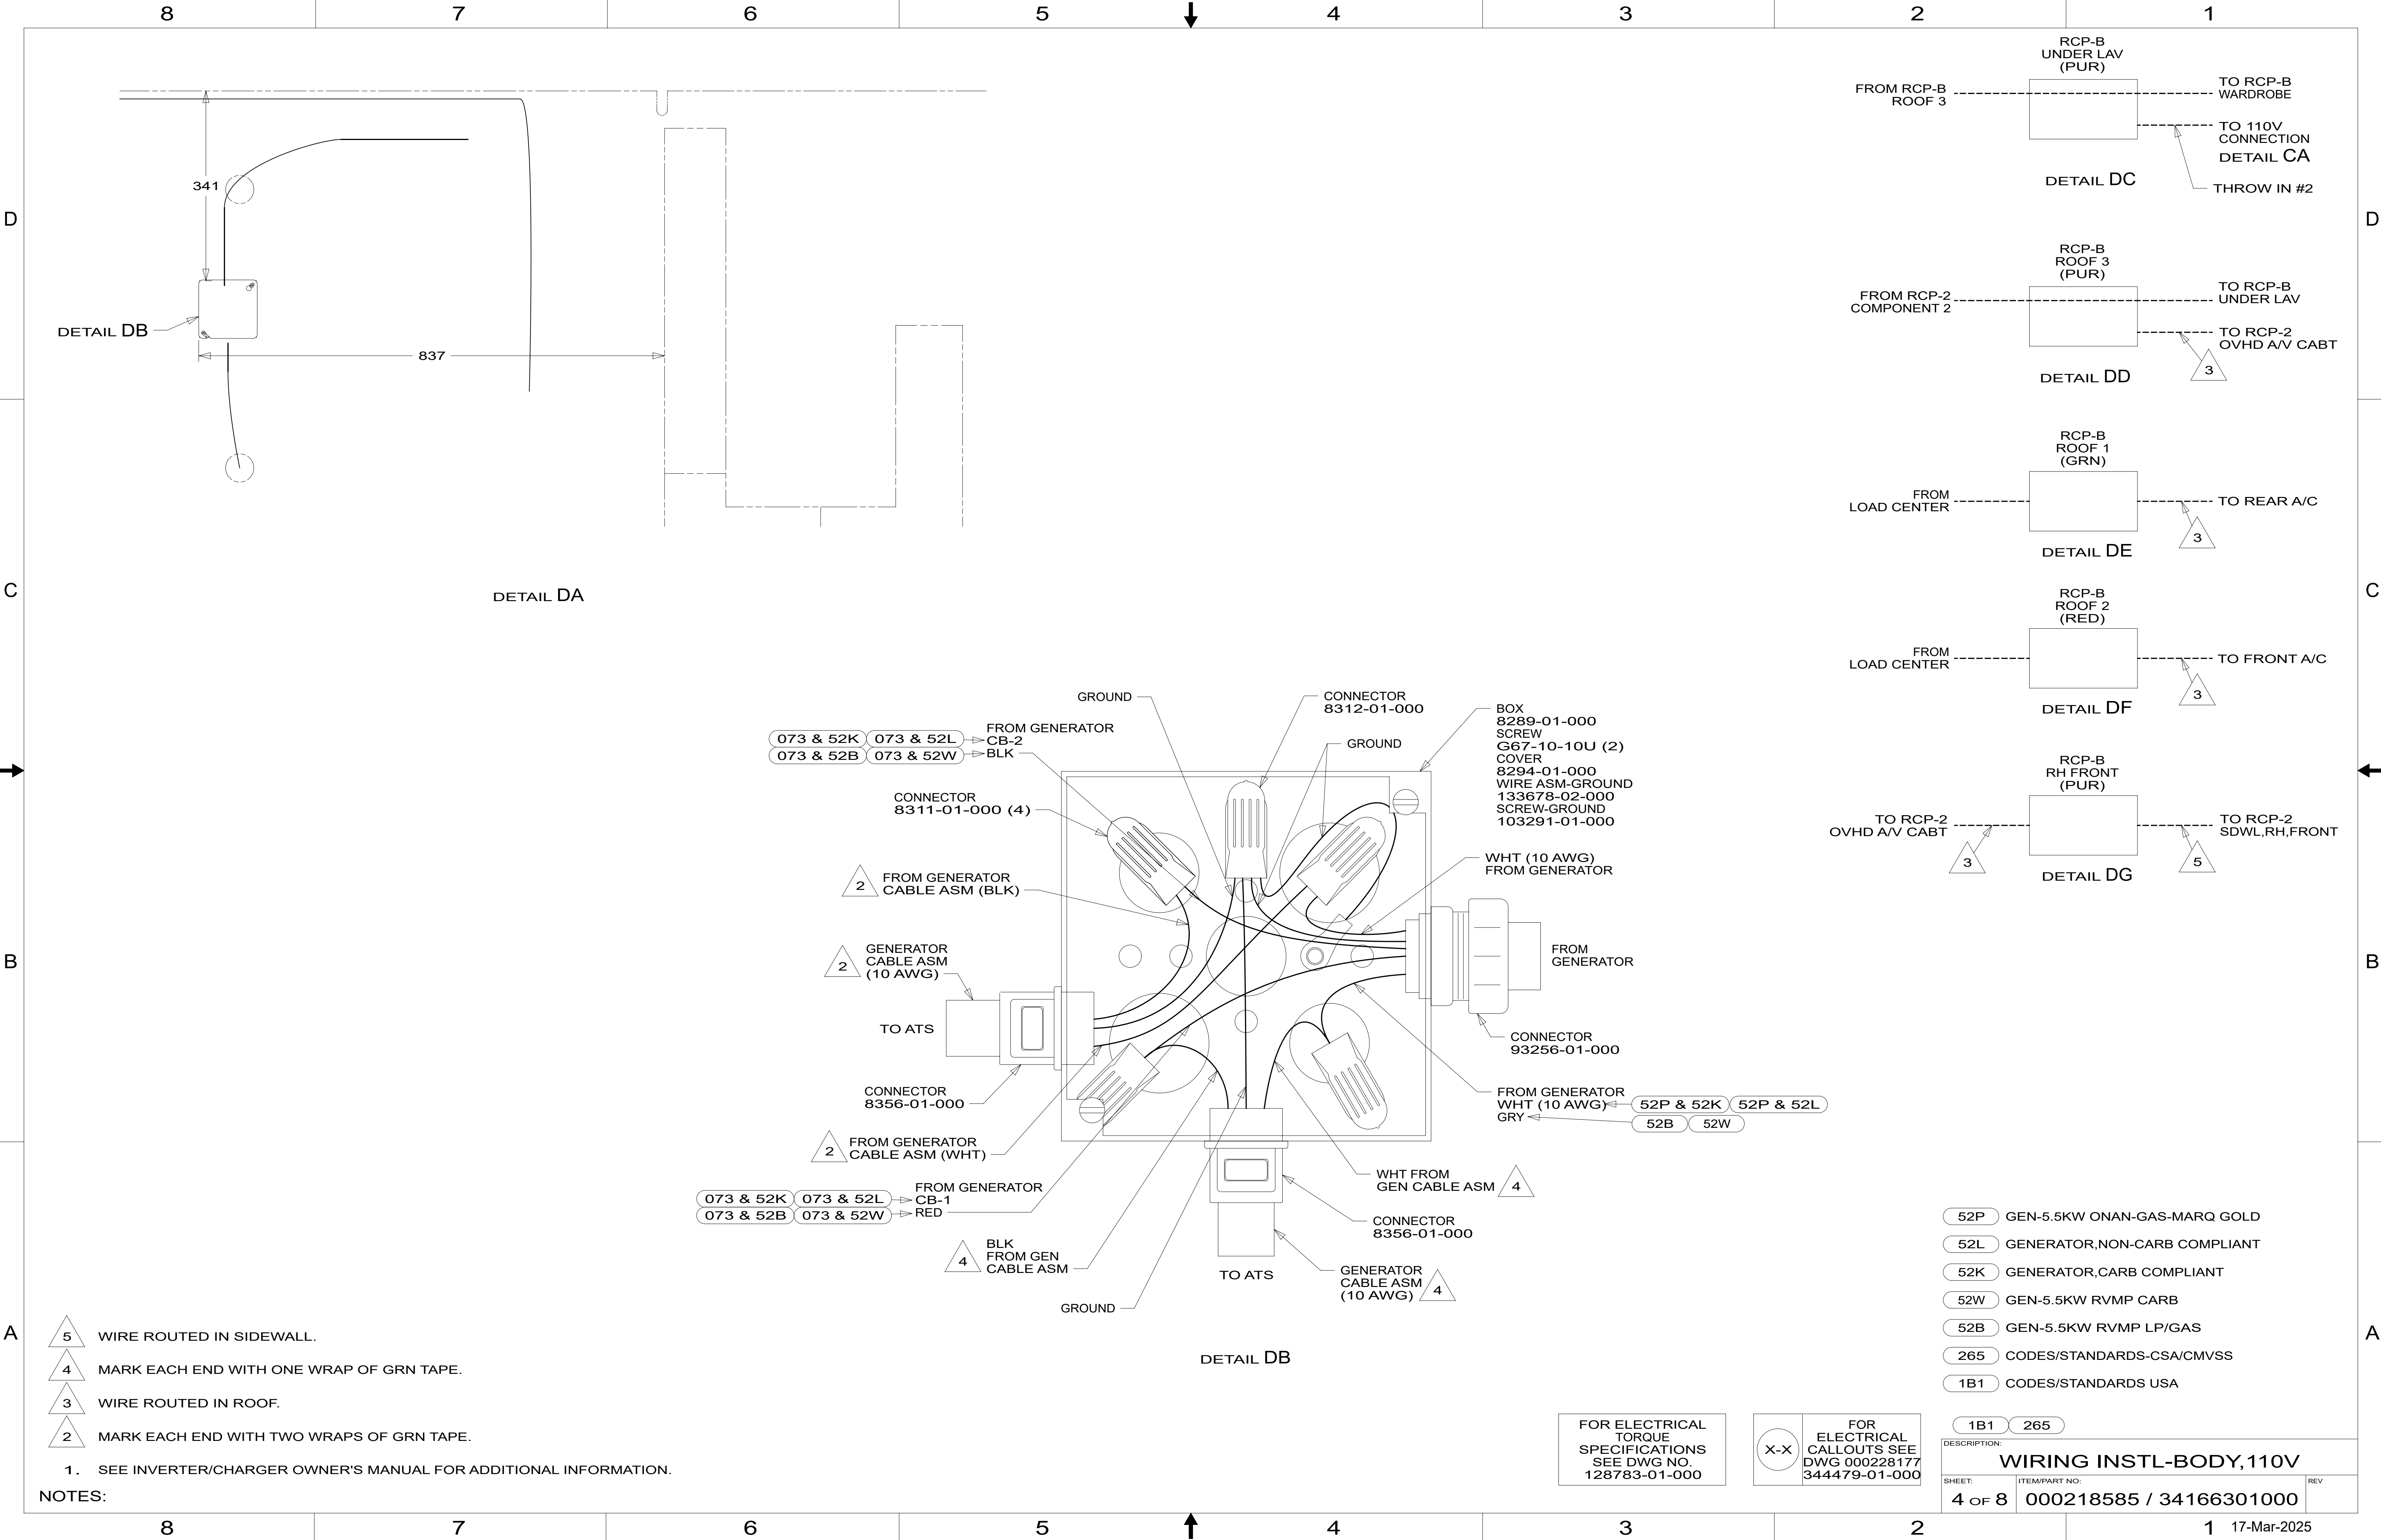

- 5 WIRE ROUTED IN SIDEWALL.
- 4 MARK EACH END WITH ONE WRAP OF GRN TAPE.
- 3 WIRE ROUTED IN ROOF.
- 2 MARK EACH END WITH TWO WRAPS OF GRN TAPE.


NOTES:
1. SEE INVERTER/CHARGER OWNER'S MANUAL FOR ADDITIONAL INFORMATION.

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG 000228177 344479-01-000

- 52P GEN-5.5KW ONAN-GAS-MARQ GOLD
- 52L GENERATOR, NON-CARB COMPLIANT
- 52K GENERATOR, CARB COMPLIANT
- 52W GEN-5.5KW RVMP CARB
- 52B GEN-5.5KW RVMP LP/GAS
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

DESCRIPTION:	
1B1 265	
WIRING INSTL-BODY, 110V	
SHEET:	ITEM/PART NO:
4 OF 8	000218585 / 34166301000
REV	
1 17-Mar-2025	

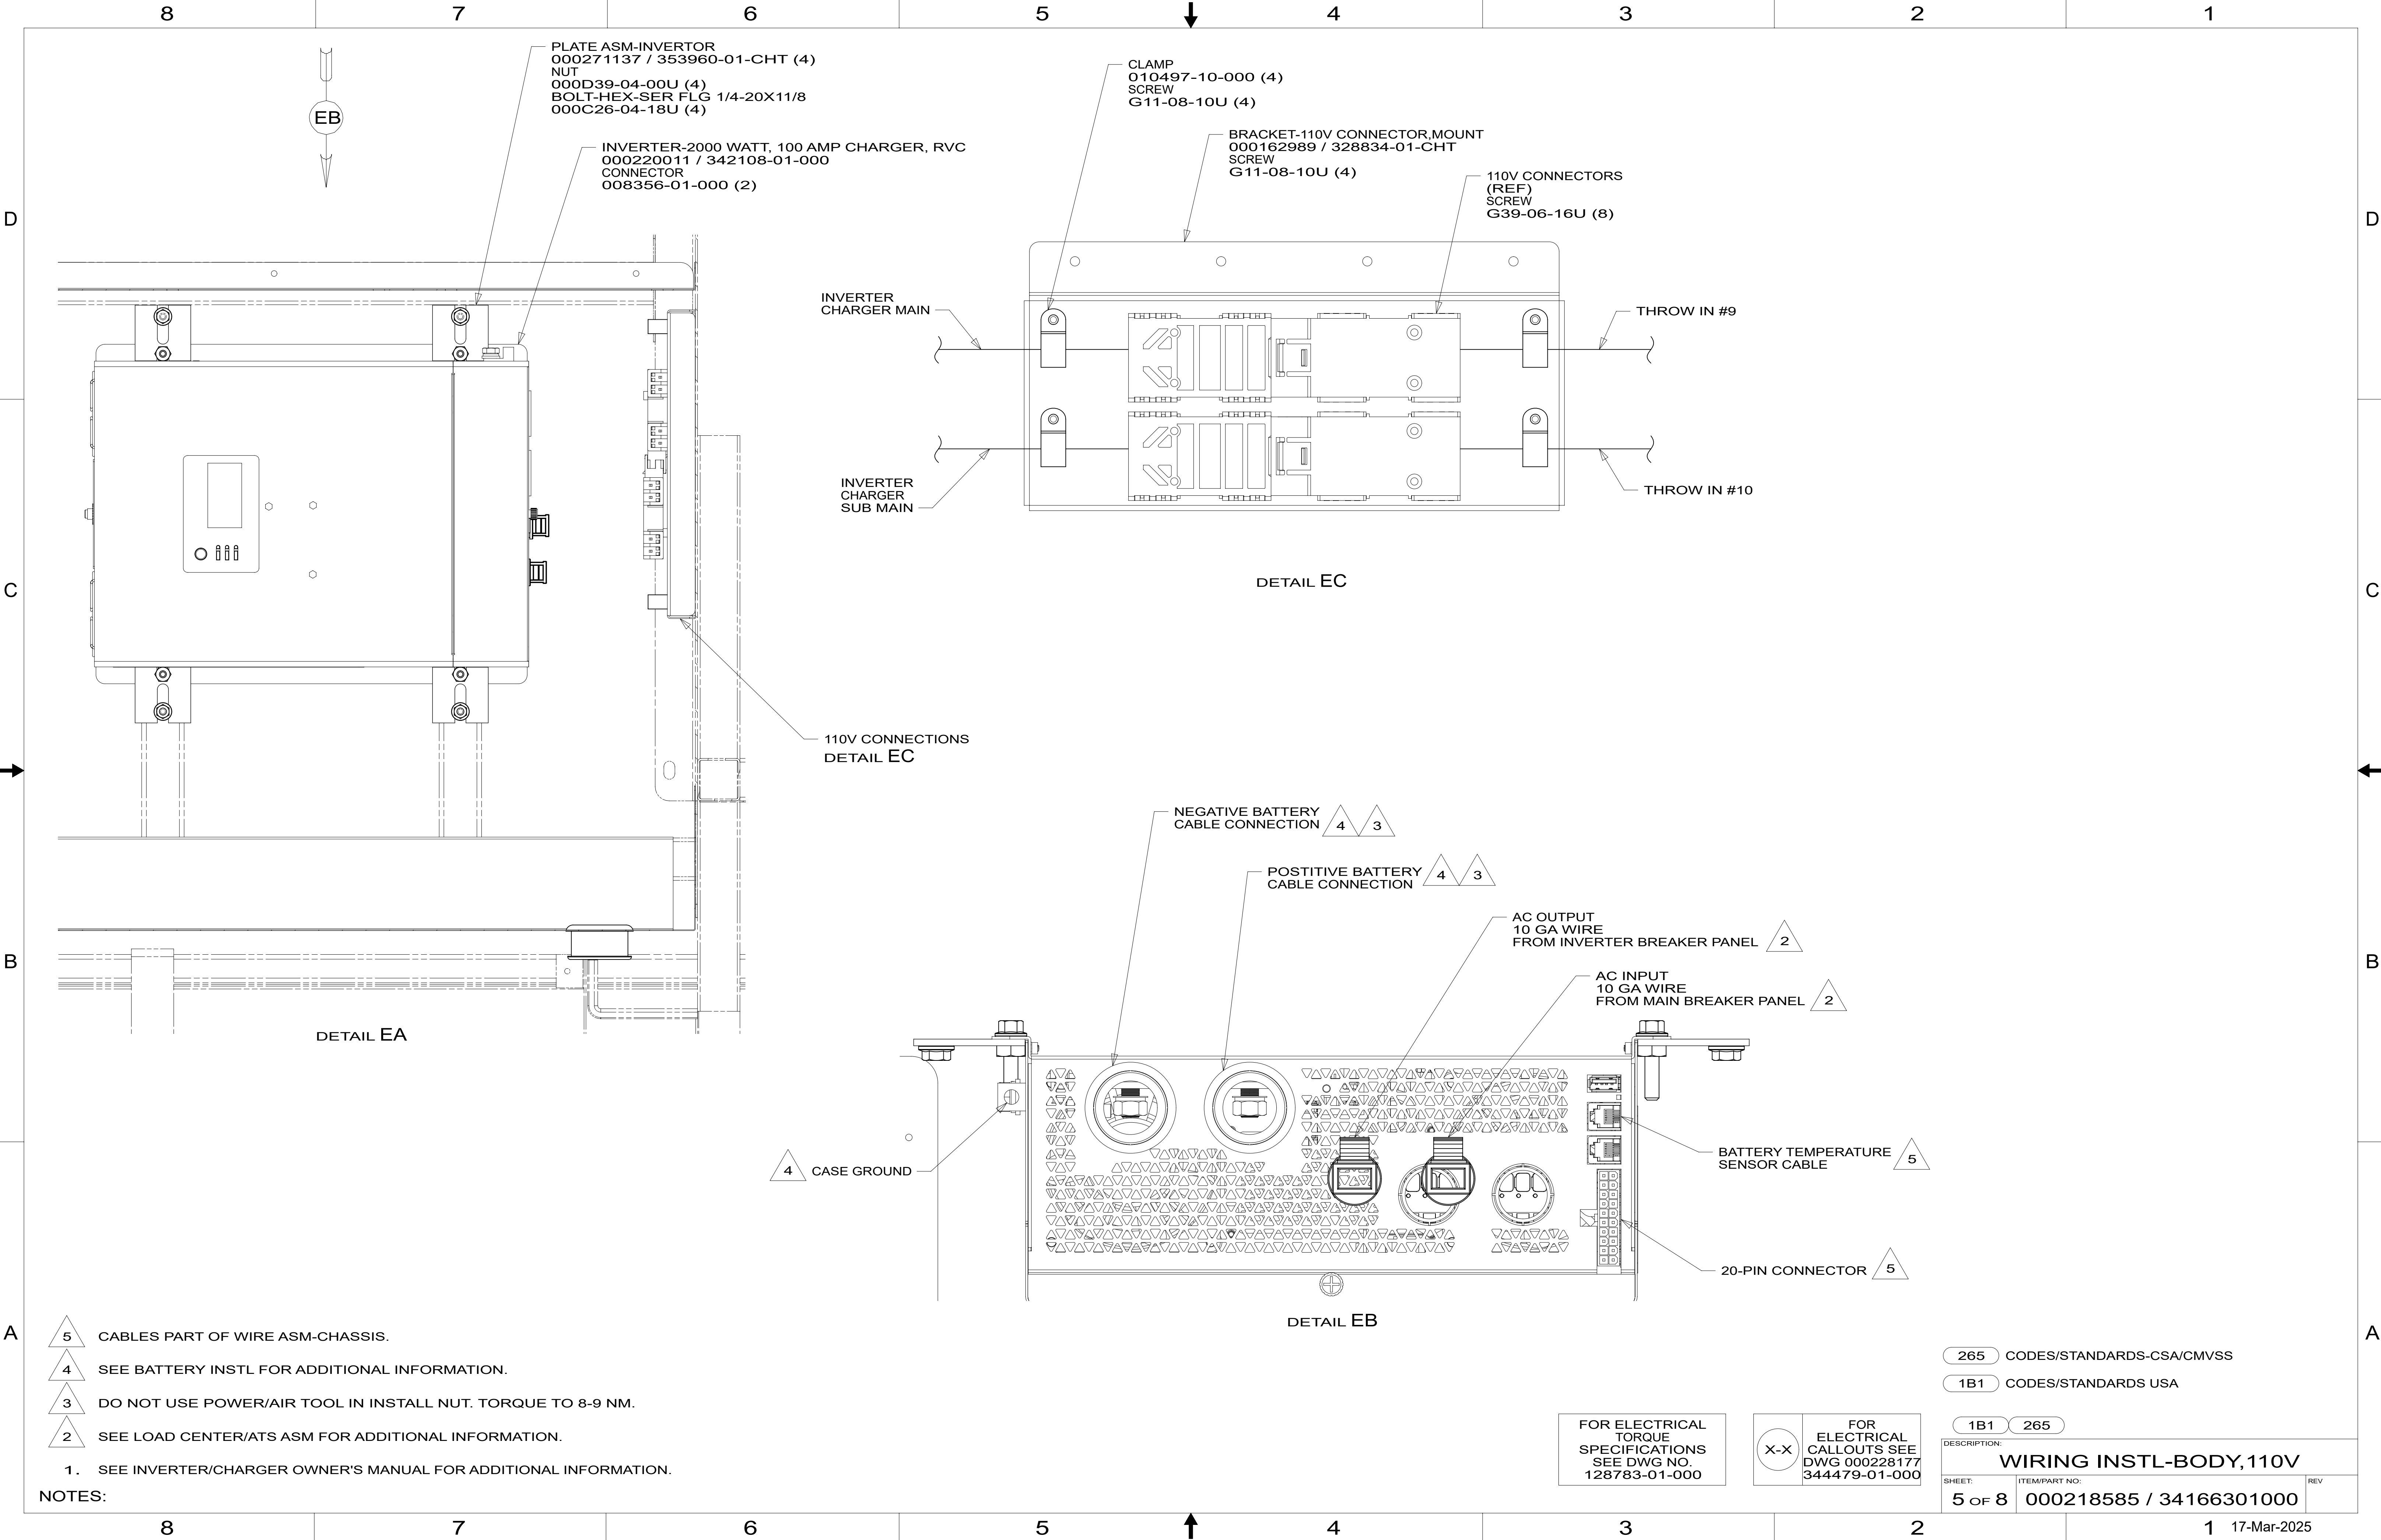

- 5 CABLES PART OF WIRE ASM-CHASSIS.
 - 4 SEE BATTERY INSTL FOR ADDITIONAL INFORMATION.
 - 3 DO NOT USE POWER/AIR TOOL IN INSTALL NUT. TORQUE TO 8-9 NM.
 - 2 SEE LOAD CENTER/ATS ASM FOR ADDITIONAL INFORMATION.
1. SEE INVERTER/CHARGER OWNER'S MANUAL FOR ADDITIONAL INFORMATION.


NOTES:


FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000


X-X

FOR ELECTRICAL CALLOUTS SEE DWG 000228177 344479-01-000

265	CODES/STANDARDS-CSA/CMVSS
1B1	CODES/STANDARDS USA
1B1	265
DESCRIPTION:	
WIRING INSTL-BODY,110V	
SHEET:	ITEM/PART NO:
5 OF 8	000218585 / 34166301000
REV	
1	17-Mar-2025

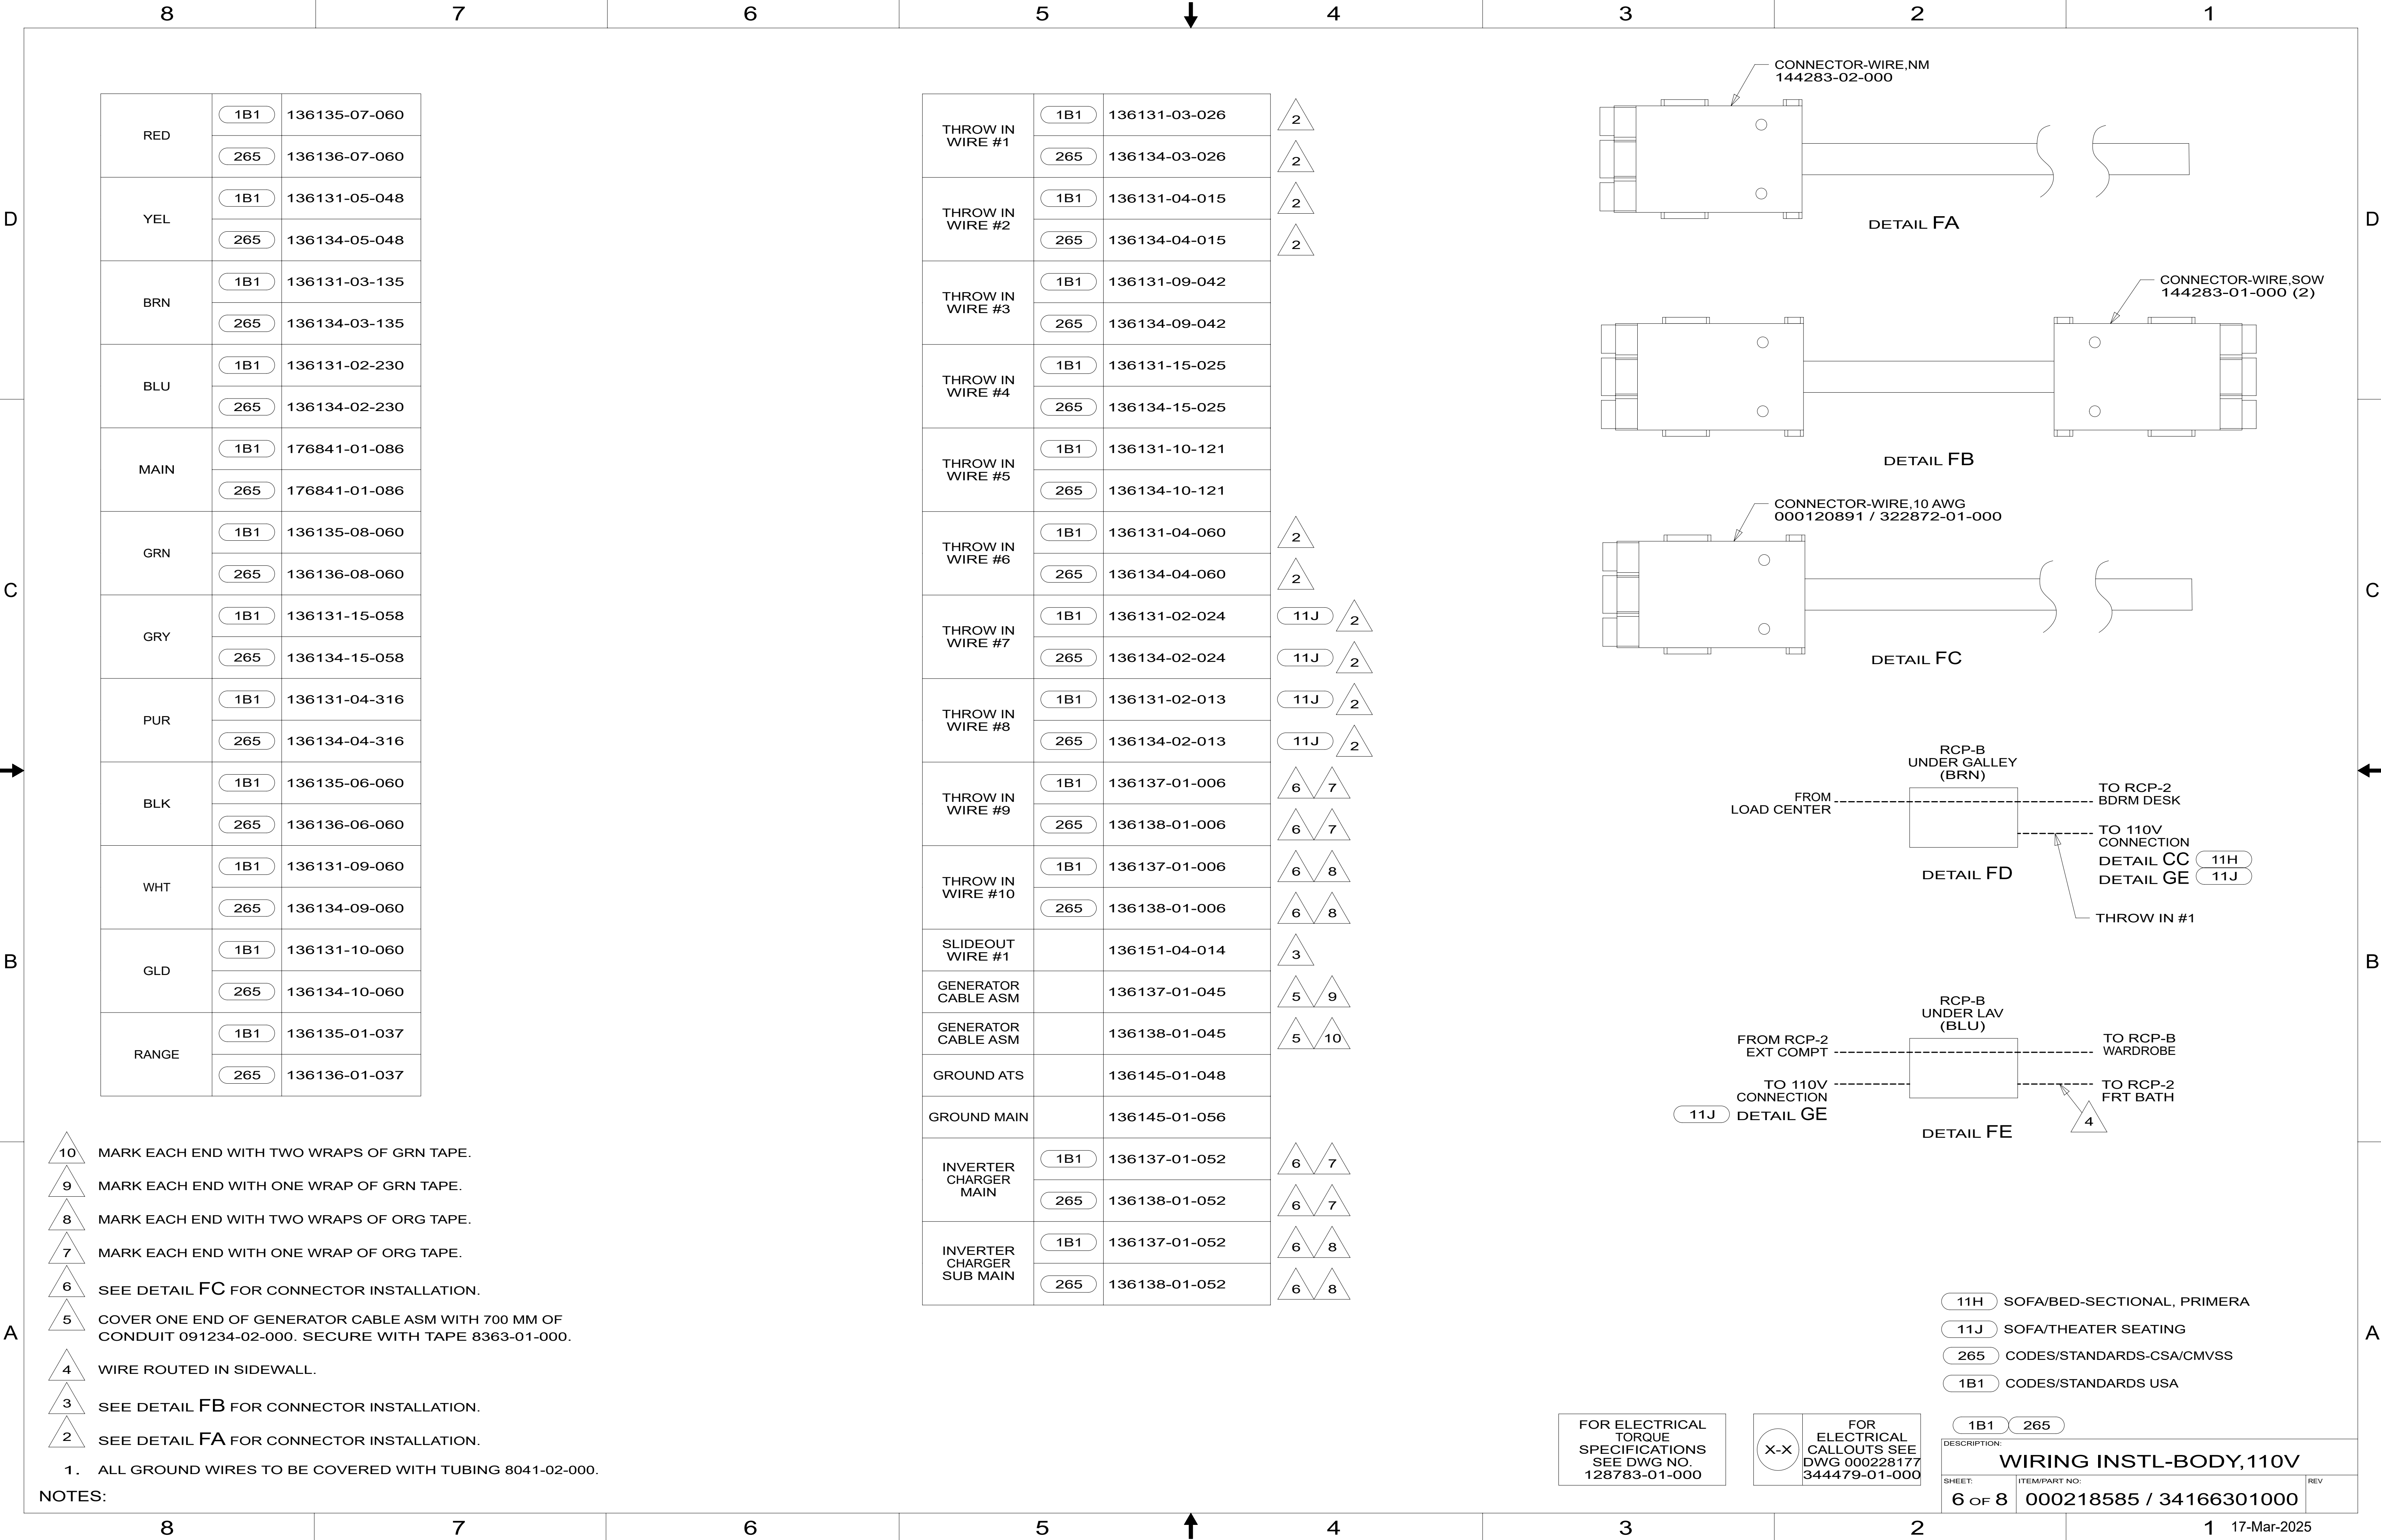

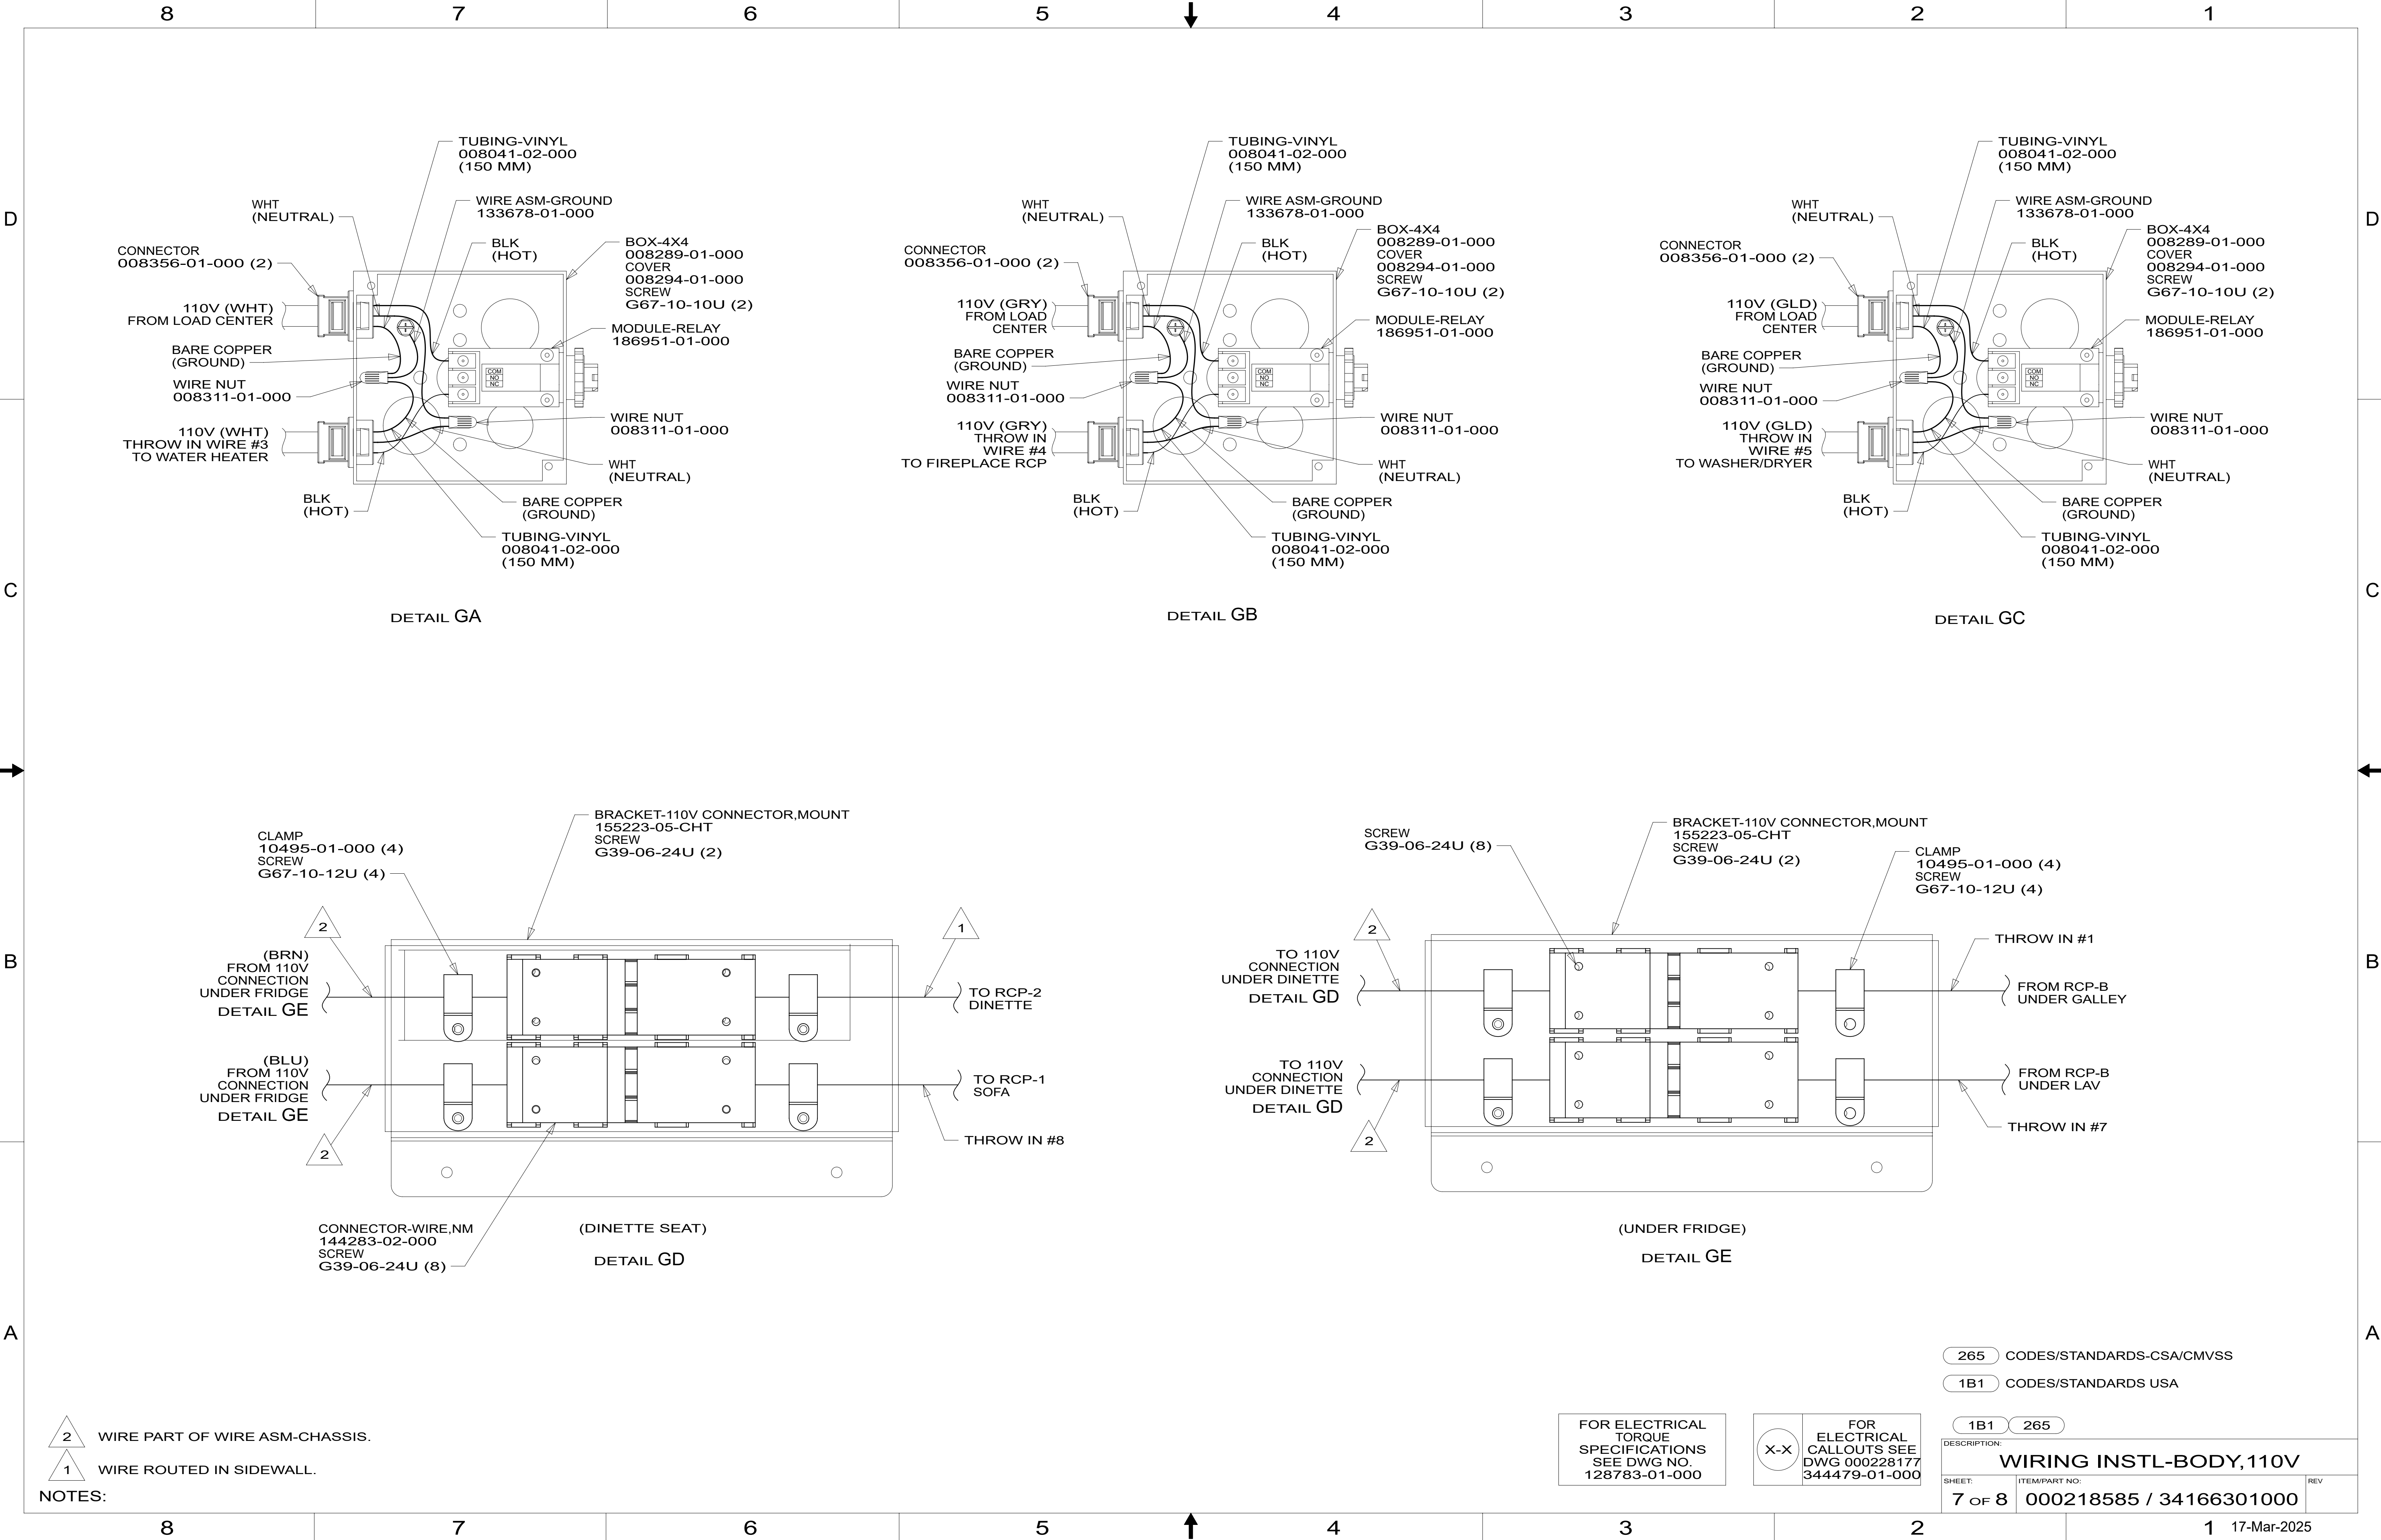

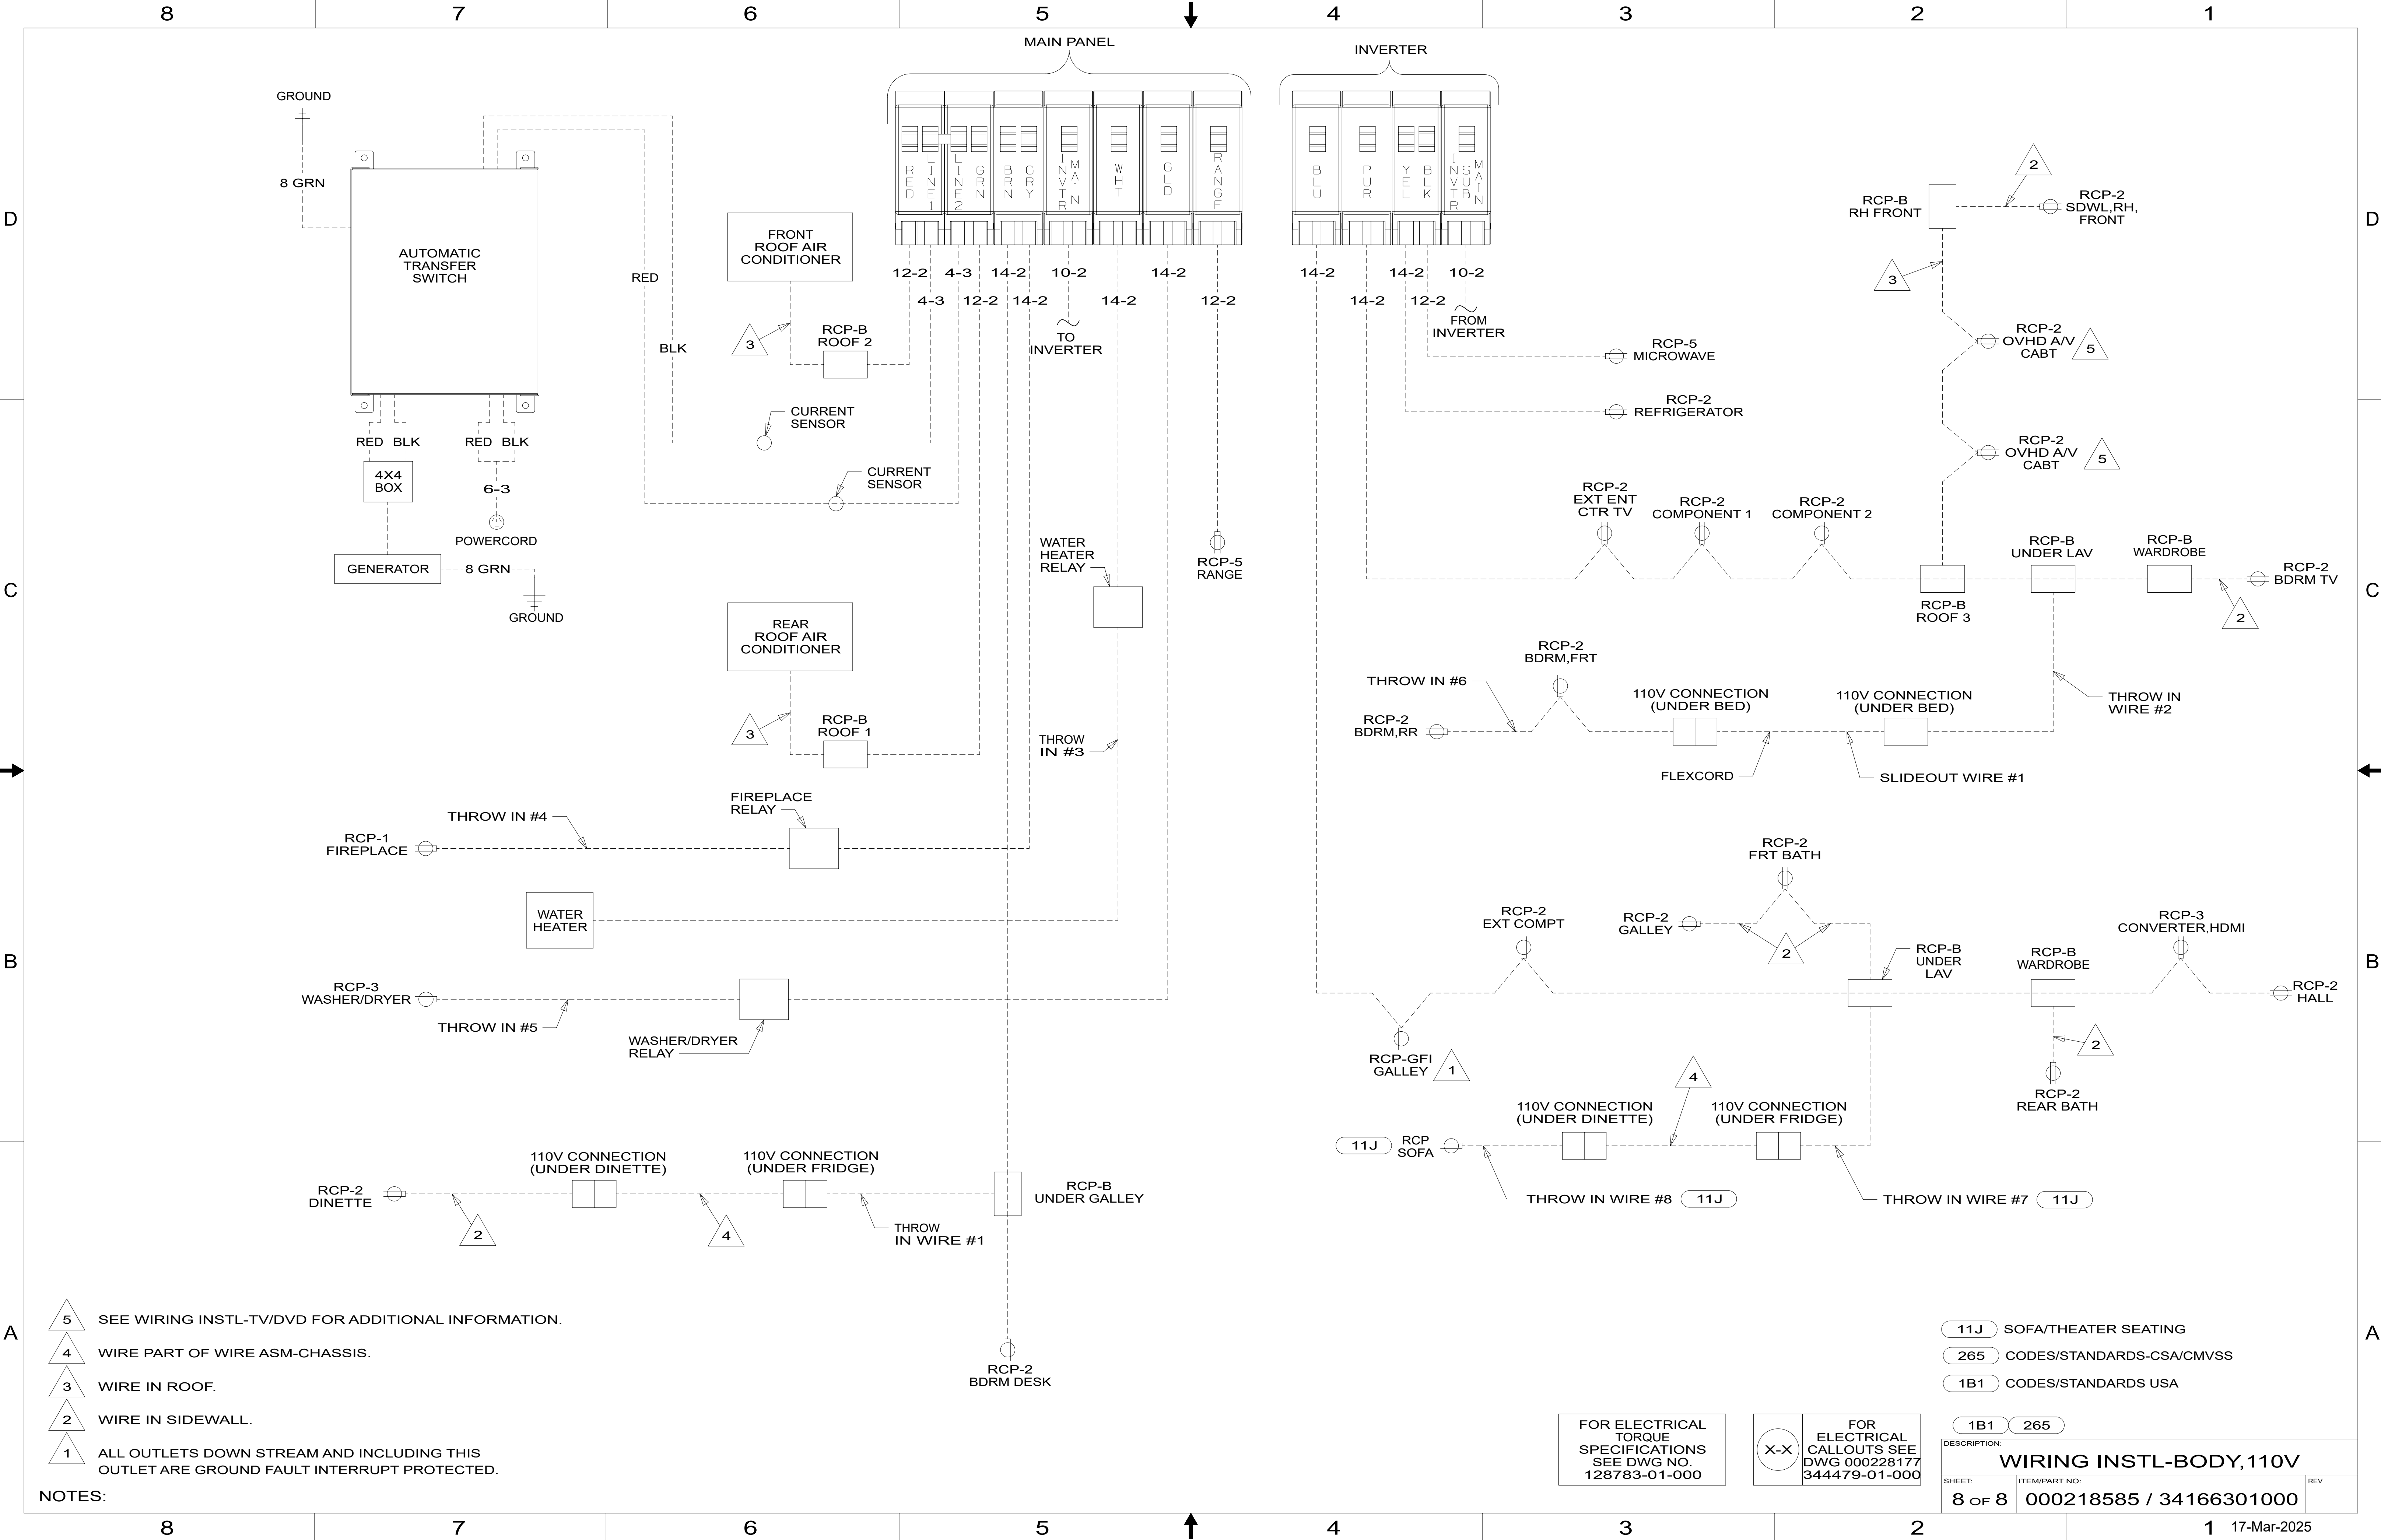

- 5 SEE WIRING INSTL-TV/DVD FOR ADDITIONAL INFORMATION.
- 4 WIRE PART OF WIRE ASM-CHASSIS.
- 3 WIRE IN ROOF.
- 2 WIRE IN SIDEWALL.
- 1 ALL OUTLETS DOWN STREAM AND INCLUDING THIS OUTLET ARE GROUND FAULT INTERRUPT PROTECTED.

NOTES:

FOR ELECTRICAL TORQUE SPECIFICATIONS SEE DWG NO. 128783-01-000

FOR ELECTRICAL CALLOUTS SEE DWG 000228177 344479-01-000

- 11J SOFA/THEATER SEATING
- 265 CODES/STANDARDS-CSA/CMVSS
- 1B1 CODES/STANDARDS USA

DESCRIPTION:		
WIRING INSTL-BODY,110V		
SHEET:	ITEM/PART NO:	REV
8 OF 8	000218585 / 34166301000	